

January 15, 2025

Peace River Regional District  
Box 810, 1981 Alaska Highway Avenue  
Dawson Creek, BC V1G 4H8

ISSUED FOR USE  
704-ENW.GENV03704-02  
Via Email: Daris.Gillis@prrd.bc.ca

**Attention:** Daris Gillis, Environmental Services Manager

**Subject:** 2024 Field Program Summary  
Alternate Water Source Viability Testing  
Rose Prairie Area

## 1.0 INTRODUCTION

The Peace River Regional District (PRRD) retained Tetra Tech Canada Inc. (Tetra Tech) for the provision of environmental consulting services. These services entail conducting a desktop hydrogeological assessment (Phase 1), and drilling exploratory boreholes, installing water source and observation wells, and conducting aquifer testing to support a groundwater licence application (Phase 2) at the properties listed below and shown on Figure 1 (herein referred to as 'the site').

- The Northwest Quadrant, Section 22, Township 86, Range 18, West of the 6th Meridian, Peace River District.
- The Southwest Quadrant, Section 22, Township 86, Range 18, West of the 6th Meridian, Peace River District.
- The Northwest Quadrant, Section 15, Township 86, Range 18, West of the 6th Meridian, Peace River District.

A technical memorandum (memo) presenting the results of the Phase 1 hydrogeological desktop assessment, proposed options for Phase 2 including exploratory drilling and well testing, and associated cost estimate was submitted to PRRD on April 20, 2024 (Tetra Tech 2024a).

During Phase 2 fieldwork, Tetra Tech oversaw the exploratory drilling of the three proposed drilling locations as shown on Figure 1. A prolific water bearing zone was observed at Location 3 and the core pipe was left in-place to allow for a future installation of a monitoring well if the Regional Board approves the drilling and installation of another well in the vicinity of Location 3. Locations 1 and 2 were deemed capable of producing insufficient quantity of water and are planned to be reclaimed.

This report provides methods and results of the Phase 2 fieldwork conducted until December 2024, including a summary of the exploratory drilling at Location 1 to Location 3, and core pipe installation, development, and groundwater and gas sampling at Location 3.

### 1.1 Objective

The objectives of the project were to:

- Conduct an exploratory drilling program to assess if an aquifer capable of producing a minimum of 20 US gallons per minute (USgpm) is present below the site; and
- Construct a water well and conduct an aquifer testing program to support a groundwater diversion licence application.

It is understood that the groundwater extracted needs to be free from hydrocarbons or dissolved explosive gases, and be suitable for treatment by the existing Rose Prairie Water Station.

## 2.0 SCOPE OF WORK

To achieve the project objective, the following scope of work was proposed:

1. Exploratory Borehole Drilling
2. Well Installation
3. Well Development
4. Groundwater and Gas Sampling
5. Aquifer Testing

Aquifer Testing was not completed as the water source well at Location 3 has not been installed. The details of the methods and results for the completed scope of work are provided in Sections 3.0 and 4.0, respectively. Conclusions and recommendations are provided in Sections 5.0 and 6.0, respectively.

## 3.0 METHODS

### 3.1 Exploratory Borehole Drilling

During the site visit and underground utility survey on August 12, 2024, Tetra Tech confirmed the proposed drilling locations with PRRD. From August 12 to 19, 2024 and September 6 to 7, 2024, Tetra Tech supervised the exploratory drilling of the three proposed locations (Location 1 to Location 3) as shown on Figure 1. Carbon Mountain Drilling (Carbon Drilling), based out of Fort St. John, BC, drilled at these locations using an air rotary drill rig. A 152 mm (6-inch) diameter exploratory borehole was advanced, and lithology was observed and logged at each location. During drilling, Tetra Tech personnel logged the drill cuttings to record the observed lithologies. Any other notable observations were also recorded, along with the associated depths.

A prolific water bearing zone was observed at Location 3 from about 140 to 159 m below grade. Locations 1 and 2 were deemed capable of producing insufficient quantity of water. The core pipe was installed at Location 3 to facilitate the collection of representative gas and groundwater samples.

The boreholes drilled at Locations 1 and 2 will need to be abandoned and backfilled with bentonite chips and/or drill cuttings following the regulatory requirements as per Part 3 – Well Construction, of the British Columbia Water Sustainability Act, Groundwater Protection Regulation B.C. Reg. 39/2016 (Government of B.C. 2022).

### 3.2 Initial Sampling from Borehole and Well Installation

Prior to installation of the the core pipe, gas and groundwater samples were collected from the open borehole at Location 3 on September 9, 2024. The collected gas samples were analyzed for methane (CH<sub>4</sub>), and sulphur compounds including hydrogen sulphide (H<sub>2</sub>S). The collected groundwater samples were analyzed for the following:

- Dissolved gases (CH<sub>4</sub>, H<sub>2</sub>S)
- Routine (Turbidity, Electrical Conductivity (EC), Total Dissolved Solids (TDS), Color, total Hardness, pH, total Alkalinity)

- Anions (chloride, Sulfate, Fluoride, Nitrate, Nitrite, Sulphide as S, Sulphide as H<sub>2</sub>S, hydroxide, carbonate, bicarbonate)
- Physical test (UV absorbance 254 nm, UV transmittance)
- H<sub>2</sub>S
- Dissolved metals
- Total metals (including mercury and cyanide)
- Dissolved Organic Carbon / Total Organic Carbon

The purpose of collecting and analyzing these samples was to confirm the presence or absence of gases or hydrocarbons. Table 1 and Table 2 summarize groundwater and gas sample results, respectively, and the laboratory reports are included in Appendix B. These results did not show detection of dissolved gases or soil vapour gases, and therefore, the core pipe was installed in the borehole at Location 3 to facilitate collection of groundwater and gas samples after the well development and to further confirm presence or absence of hydrocarbons and gases prior to drilling and installing a water source well.

Carbon Drilling completed the core pipe installation. Tetra Tech provided the well design and technical support during the installation. An initial well diagram based on the meeting held between Carbon Drilling, PRRD, and Tetra Tech on November 5, 2024, and the field observations made during the drilling of Location 3 was provided to Carbon Drilling on November 12, 2024 (Tetra Tech 2024b). A monitoring well was planned due to sloughing in the open borehole which restricted the open diameter, making it unable to install a pumping well.

### 3.3 Well Development

---

Following the core pipe installation at Location 3, Carbon Drilling developed the well thoroughly using a gas compressor and jetting tool. Tetra Tech provided technical support during the well development. The well development activities were completed to remove fines from the area immediately around the well screen, ensuring hydraulic connection to the aquifer, and that representative groundwater samples are collected, and aquifer properties are obtained during future testing.

The well development started at the top of the screen, working downwards in 6-inch depth increments. Development continued until produced water had less than 5 mL of fines (silt) in a 20 L pail.

The unsuccessful boreholes at Locations 1 and 2 were not developed.

### 3.4 Groundwater and Gas Sampling

---

Based on PRRD's request, a groundwater and gas sample were collected from the open borehole at Location 2 on August 20, 2024.

Following well development at Location 3 as described above, and further purging of the well for approximately three wellbore volumes, Carbon Drilling collected another set of groundwater and gas samples on November 20, 2024. Results of the groundwater and gas sample analytical results are summarized in Tables 1 and 2, respectively. The laboratory reports for the analytical results are available in Appendix B.

During sampling, nitrile gloves were worn to prevent cross-contamination during sample collection. Combustible headspace vapour/hydrogen sulfide readings were measured using an RKI Eagle at the surface casing immediately after opening the well and before sample collection.

The collected gas and groundwater samples were analyzed for the same analytical suite as presented in Section 3.2. Groundwater samples for dissolved metals and dissolved organic carbon were field filtered and preserved as per laboratory instructions. Samples were collected in laboratory supplied containers and stored in coolers. The collected samples were stored on ice and were submitted to ALS Laboratory of Fort St. John under standard chain-of-custody (CoC) procedures.

An ambient gas sample was collected by Carbon Drilling at the well head at time of groundwater sampling. The gas sample cannister was positioned at the opening of the well head, the valve was opened for 4 minutes and then closed and submitted for methane and hydrogen sulfide gas analysis to ALS Laboratory of Fort St. John under standard CoC procedures (completion of CoC).

## 4.0 RESULTS

Three exploratory borehole locations were advanced to total depths ranging from 152.4 m below grade (mbg) to 170.7 mbg. The observed lithology consisted of clay or silt units to depth ranging between approximately 45.5 mbg and 83.0 mbg overlying sandstone, shale or siltstone bedrock units to the maximum drilling depth. The borehole logs for the exploratory boreholes drilled at Locations 1 to 3 are included in Appendix A. Flow testing was recorded at Location 3 to range from 10 gpm at 122 mbg to 27 gpm at 152 mbg.

The core pipe was left in-place to allow for a future installation of a monitoring well if the Regional Board approves the drilling and installation of another well in the vicinity of Location 3. Based on the gas and groundwater sampling results for Location 3, there is no indication as to the presence of H<sub>2</sub>S CH<sub>4</sub> gases at this location (Tables 1 and 2), hence this location may be viable for installation and testing of a 152 mm (6-inch) diameter pumping well within a 50 m vicinity of the existing location as per the regulations.

## 5.0 CONCLUSIONS

The following conclusions can be made based on the collected data from the 2024 Field Program:

- Locations 1 and 2 were deemed capable of producing insufficient quantity and water quality of groundwater and are planned to be abandoned following the regulatory requirements.
- Preliminary estimated flow rates support a productive water well only at Location 3.
- Gas and groundwater samples were collected from the Location 3 borehole and no hydrocarbon and gases were observed.
- The core pipe was left in ground at Location 3 and developed to facilitate the collection of representative gas and groundwater samples and to further confirm presence or absence of hydrocarbons and gases.
- Water quality at Location 3 following well development reported no dissolved H<sub>2</sub>S in the groundwater sample. Additionally, there were no sulphur compounds, including H<sub>2</sub>S, or methane detected in the soil vapour sample collected. There were a few parameters, which exceeded the Contaminated Sites Regulation drinking water standards (CSR-DW) including dissolved antimony, dissolved lithium and dissolved sodium, and a few total metals. Total and dissolved antimony and total arsenic also exceeded the Guidelines for Canadian Drinking Water Quality (GCDWQ) maximum allowable concentrations, and total aluminum, dissolved and total iron, dissolved and total manganese, and dissolved and total sodium exceeded the aesthetic objectives or operational guidance values of the GCDWQ.

## 6.0 RECOMMENDATIONS

The analytical results of the gas and groundwater samples did not show presence of gases or hydrocarbons at Location 3. However, it can not be guaranteed that the gases or hydrocarbons will not be observed during long-term pumping at this location.

Based on the findings to date, if PRRD decides to install a water source well at Location 3, Tetra Tech, as described in the Phase 2 plan, recommends aquifer testing in the form of a pumping test to estimate hydraulic parameters of the aquifer. It is recommended that the water source well be drilled within about 50 m of the planned monitoring well borehole and the aquifer testing be comprised of a step rate test, a 72-hour constant-rate pumping test, and testing for groundwater quality. A monitoring well is recommended to be installed in the current borehole with core pipe left in ground.

The water quality should be tested again near the end of the 72-hour constant rate pumping test. The identified exceedances of the water sample collected after well development on November 20, 2024, indicate that the well water would have to be treated at minimum for arsenic and antimony which both exceeded the maximum allowable concentrations of the GCDWQ. Additional water treatment may be required for the parameters that exceeded the aesthetic objectives or operational guidance values of the GCDWQ and CSR-DW standards.

Tetra Tech also recommends abandoning the boreholes drilled at Locations 1 and 2 by backfilling with bentonite chips and/or drill cuttings following the regulatory requirements.

## 7.0 LIMITATIONS OF REPORT

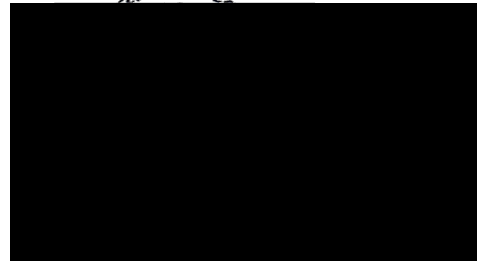
This report and its contents are intended for the sole use of Peace River Regional District and their agents. Tetra Tech Canada Inc. (Tetra Tech) does not accept any responsibility for the accuracy of any of the data, the analysis, or the recommendations contained or referenced in the report when the report is used or relied upon by any Party other than Peace River Regional District, or for any Project other than the proposed development at the subject site. Any such unauthorized use of this report is at the sole risk of the user. Use of this document is subject to the Limitations on the Use of this Document attached in Appendix C or Contractual Terms and Conditions executed by both parties.

## 8.0 CLOSURE

We trust this report meets your present requirements. If you have any questions or comments, please contact the undersigned.

Respectfully submitted,  
Tetra Tech Canada Inc.

7  
7  
7



Prepared by:  
Thom Kolb, B.Sc., P.Geo.  
Hydrogeologist  
Environment & Water Practice  
Direct Line: 236.983.0195  
Thom.Kolb@tetrattech.com

Reviewed by:  
Aziz Shaikh, M.Sc., P.Eng.  
Principal Hydrogeologist  
Environment & Water Practice  
Direct Line: 403.899.7064  
Aziz.Shaikh@tetrattech.com

/jmt

Attachments: Tables (2)  
Figure (1)  
Appendix A – Borehole Logs  
Appendix B – Laboratory Reports  
Appendix C – Tetra Tech's Limitations on the Use of this Document

**PERMIT TO PRACTICE  
TETRA TECH CANADA INC.  
PERMIT NUMBER: 1001972**

## REFERENCES

- Government of British Columbia (Government of B.C.) 2022, Water Sustainability Act, Groundwater Protection Regulation, B.C. Reg 39/2016. Deposited and effective February 29, 2016. Last amended December 1, 2022 by B.C. Reg 253/2022. Consolidation current to May 23, 2023.
- Tetra Tech Canada Inc (Tetra Tech) 2024a. Hydrogeological Desktop Assessment. Submitted to Peace River Regional District April 30, 2024.
- Tetra Tech Canada Inc (Tetra Tech) 2024b. 2024 Well Completion Work Plan. Submitted to Peace River Regional District November 12, 2024.

## TABLES

Table 1	Groundwater Analytical Results
Table 2	Soil Vapor Analytical Results



**Table 1: Groundwater Analytical Results**

Parameter	Unit	Location Code			Location 2	Location 3	
		Field ID			Location 2	Location 3	Location 3
		Date			20 Aug 2024	09 Sep 2024	20 Nov 2024
		Lab Report Number			FJ2402491	FJ2402712	FJ2403536
		Sample Code			FJ2402491-001	FJ2402712-001	FJ2403536-001
		GCDWQ		CSR - DW			
		MAC	OV				
<b>Physical Parameters</b>							
pH	pH Units	-	7 - 10.5	-	7.99	8.39	8.34
Electrical Conductivity (EC)	µS/cm	-	-	-	975	1,800	1,890
Total Dissolved Solids (TDS)	µg/L	-	500,000	-	<b>906,000</b>	<b>1,340,000</b>	<b>1,230,000</b>
Turbidity	NTU	-	1	-	<b>&gt;4,000</b>	<b>316</b>	<b>26</b>
Hardness as CaCO <sub>3</sub>	µg/L	-	-	-	227,000	350,000	251,000
Hardness as CaCO <sub>3</sub> (filtered)	µg/L	-	-	-	41,200	353,000	238,000
Alkalinity (total as CaCO <sub>3</sub> )	µg/L	-	-	-	534,000	882,000	946,000
Alkalinity (pp as CaCO <sub>3</sub> )	µg/L	-	-	-	<1,000	10,400	6,700
Alkalinity (Bicarbonate as CaCO <sub>3</sub> )	µg/L	-	-	-	534,000	861,000	933,000
Alkalinity (Carbonate as CaCO <sub>3</sub> )	µg/L	-	-	-	<1,000	20,800	13,300
Alkalinity (Hydroxide) as CaCO <sub>3</sub>	µg/L	-	-	-	<1,000	<1,000	<1,000
Bromide	µg/L	-	-	-	<250	<500	<500
Chloride	µg/L	-	250,000	250,000	19,000	38,800	38,600
Fluoride	µg/L	1,500	-	1,500	478	<200	629
Sulphate	µg/L	-	500,000	500,000	12,700	136,000	120,000
Sulphide	µg/L	-	-	-	350	<10	<10
Sulphide (as H <sub>2</sub> S)	µg/L	-	50	50	<b>372</b>	<11	<11
Colour, True	Col. Unit	-	15	-	5.8	<5.0	<5.0
UV Absorbance @ 254nm	AU/cm	-	-	-	0.141	0.062	0.083
Transmittance, UV (@ 254nm)	% T/cm	-	-	-	72.3	86.7	82.6
<b>Carbon</b>							
Dissolved Organic Carbon (DOC)	µg/L	-	-	-	27,500	3,370	4,000
Total Organic Carbon (TOC)	µg/L	4,000	-	-	<b>101,000</b>	<b>7,250</b>	3,740
<b>Cyanide</b>							
Cyanide Total	µg/L	200	-	200	<5.0	<5.0	<5.0
<b>Gases</b>							
Methane	µg/L	-	-	-	10.5	<5.0	-
Methane	ppmv	-	-	-	43,600	-	-
<b>Nutrients</b>							
Nitrate (as N)	µg/L	10,000	-	10,000	41.2	<50.0	<50.0
Nitrite (as N)	ug/L	1,000	-	1,000	<5.0	<10.0	<10.0
<b>Dissolved Metals</b>							
Aluminum	µg/L	2,900	100	9,500	<b>136</b>	7.8	2.7
Antimony	µg/L	6	-	6	2.06	0.91	<b>6.71</b>
Arsenic	µg/L	10	-	10	1.14	0.9	6.23
Barium	µg/L	2,000	-	1,000	352	48.3	418
Beryllium	µg/L	-	-	8	<0.100	<0.100	<0.100
Bismuth	µg/L	-	-	-	<0.050	<0.050	<0.100
Boron	µg/L	5,000	-	5,000	240	371	329
Cadmium	µg/L	7	-	5	0.0186	0.0304	0.0734
Calcium	µg/L	-	-	-	7,600	62,600	38,900
Chromium	µg/L	50	-	50	<0.50	<0.50	<1.00
Cesium	µg/L	-	-	-	0.057	0.053	0.078
Cobalt	µg/L	-	-	1	0.42	0.48	<b>1.74</b>
Copper	µg/L	2,000	1,000	1,500	0.53	<0.20	0.55
Iron	µg/L	-	300	6,500	174	178	787
Lead	µg/L	5	-	10	0.073	<0.050	<0.100
Lithium	µg/L	-	-	8	6.8	<b>20.6</b>	<b>14.1</b>
Magnesium	µg/L	-	-	-	5,390	47,700	34,200
Manganese	µg/L	120	20	1,500	<b>141</b>	<b>110</b>	<b>112</b>
Mercury	µg/L	1	-	1	<0.0050	<0.0050	<0.0050
Molybdenum	µg/L	-	-	250	19.2	3.92	30.4
Nickel	µg/L	-	-	80	3.47	1.52	11.1
Phosphorus	µg/L	-	-	-	<50	<50	<100
Potassium	µg/L	-	-	-	5,180	4,400	3,390
Rubidium	µg/L	-	-	-	1.88	2.4	2.38
Selenium	µg/L	50	-	10	0.941	1.76	3.01
Silicon	µg/L	-	-	-	2,040	4,860	4,070
Silver	µg/L	-	-	20	<0.010	<0.010	<0.020
Sodium	µg/L	-	200,000	200,000	<b>244,000</b>	<b>360,000</b>	<b>401,000</b>
Strontium	µg/L	7,000	-	2,500	150	994	598
Sulphur	µg/L	-	-	-	11,000	51,000	42,800
Tellurium	µg/L	-	-	-	<0.20	<0.20	<0.40
Thallium	µg/L	-	-	-	<0.010	<0.010	0.023
Thorium	µg/L	-	-	-	<0.10	<0.10	<0.20
Tin	µg/L	-	-	2,500	<0.10	<0.10	<0.20
Titanium	µg/L	-	-	-	5.27	<0.30	<0.60
Tungsten	µg/L	-	-	3	<0.10	<0.10	0.3
Uranium	µg/L	20	-	20	2.63	1.41	6.24
Vanadium	µg/L	-	-	20	0.59	<0.50	<1.00
Zinc	µg/L	-	5,000	3,000	2	2.2	4.3
Zirconium	µg/L	-	-	-	<0.20	0.35	0.41
<b>Total Metals</b>							
Aluminum	µg/L	2,900	100	9,500	<b>72,300</b>	<b>3,140</b>	<b>165</b>
Antimony	µg/L	6	-	6	1.68	0.99	<b>6.96</b>
Arsenic	µg/L	10	-	10	<b>32.5</b>	3.62	<b>21.4</b>
Barium	µg/L	2,000	-	1,000	<b>9,270</b>	206	467
Beryllium	µg/L	-	-	8	5.83	0.213	<0.100
Bismuth	µg/L	-	-	-	1.36	<0.100	<0.100
Boron	µg/L	5,000	-	5,000	284	319	352
Cadmium	µg/L	7	-	5	<b>14.7</b>	0.318	0.116
Calcium	µg/L	-	-	-	32,500	55,300	41,000
Chromium	µg/L	50	-	50	<b>194</b>	8.17	<1.00

**Table 1: Groundwater Analytical Results**

Parameter	Unit	Location Code			Location 2	Location 3	
		Field ID			Location 2	Location 3	Location 3
		Date			20 Aug 2024	09 Sep 2024	20 Nov 2024
		Lab Report Number			FJ2402491	FJ2402712	FJ2403536
		Sample Code			FJ2402491-001	FJ2402712-001	FJ2403536-001
Parameter	Unit	GCDWQ		CSR - DW			
		MAC	OV				
Cesium	µg/L	-	-	-	16.1	1.53	0.125
Cobalt	µg/L	-	-	1	89.1	3.41	1.9
Copper	µg/L	2,000	1,000	1,500	295	13.4	2.64
Iron	µg/L	-	300	6,500	<b>274000</b>	<b>18,800</b>	<b>3,170</b>
Lead	µg/L	5	-	10	<b>102</b>	<b>5.62</b>	0.556
Lithium	µg/L	-	-	8	119	22.8	15.4
Magnesium	µg/L	-	-	-	35,500	51,400	36,200
Manganese	µg/L	120	20	1,500	<b>4,590</b>	<b>251</b>	<b>115</b>
Mercury	µg/L	1	-	1	<b>1.43</b>	0.0608	<0.0050
Molybdenum	µg/L	-	-	250	9.22	3.97	33.5
Nickel	µg/L	-	-	80	328	12	11.9
Phosphorus	µg/L	-	-	-	4,070	140	<100
Potassium	µg/L	-	-	-	14,400	4,600	3,390
Rubidium	µg/L	-	-	-	97.2	9.91	2.7
Selenium	µg/L	50	-	10	4.38	1.9	3.15
Silicon	µg/L	-	-	-	87,200	10,000	4,680
Silver	µg/L	-	-	20	3.59	0.122	<0.020
Sodium	µg/L	-	200,000	200,000	<b>232,000</b>	<b>362,000</b>	<b>395,000</b>
Strontium	µg/L	7,000	-	2,500	528	1,040	665
Sulphur	µg/L	-	-	-	14,000	57,800	48,800
Tellurium	µg/L	-	-	-	<1.00	<0.40	<0.40
Thallium	µg/L	-	-	-	1.35	0.088	0.028
Thorium	µg/L	-	-	-	34.8	1.5	<0.20
Tin	µg/L	-	-	2,500	<0.50	<0.20	<0.20
Titanium	µg/L	-	-	-	107	18.7	5.54
Tungsten	µg/L	-	-	3	<0.50	<0.20	0.33
Uranium	µg/L	20	-	20	10.7	1.79	6.95
Vanadium	µg/L	-	-	20	<b>233</b>	11.8	1.27
Zinc	µg/L	-	5,000	3,000	1,030	76.7	9.2
Zirconium	µg/L	-	-	-	<1.00	<0.40	0.64
<b>BTEXS &amp; MTBE</b>							
Benzene	µg/L	5	-	5	-	<0.50	-
Toluene	µg/L	60	24	60	-	<0.50	-
Ethylbenzene	µg/L	140	1.6	140	-	<0.50	-
Xylenes (m & p)	µg/L	-	-	-	-	<0.40	-
Xylene (o)	µg/L	-	-	-	-	<0.30	-
Xylenes Total	µg/L	90	20	90	-	<0.50	-
Styrene	µg/L	-	-	800	-	<0.50	-
Methyl t-butyl ether (MTBE)	µg/L	-	15	95	-	<0.50	-
<b>Hydrocarbons</b>							
F1 (C <sub>6</sub> -C <sub>10</sub> )	µg/L	-	-	-	-	<100	-
F1 (C <sub>6</sub> -C <sub>10</sub> ) less BTEX	µg/L	-	-	-	-	<100	-
<b>Volatile Hydrocarbons</b>							
VHs (C <sub>6</sub> -C <sub>10</sub> )	ug/L	-	-	-	-	<100	-
VPHw	µg/L	-	-	-	-	<100	-

**Notes:**

- CSR Environmental Management Act (EMA). 2023. Contaminated Sites Regulation (CSR), B.C. Reg. 375/96, deposited 1996/12/16, O.C. 1480/96, effective 1997/04/01 (including amendments up to B.C. Reg. 133/2022, effective March 1, 2023). Schedule 3.2
- DW Drinking Water Standards
- GCDWQ Health Canada. 2022. Guidelines for Canadian Drinking Water Quality Summary Table.
- MAC Maximum Allowable Concentration.
- OV Other Value refers to the aesthetic objectives of operational guidance values according to the GCDWQ criteria.
- Bold Underlined** Bold underlined indicates an exceedance of one or more GCDWQ standards.
- Shaded** Shaded indicates an exceedance of the applicable CSR DW standards.

**Table 2: Soil Vapour Analytical Results**

		Location Code	Location 2	Location 3	
		Field ID	Location 2	Location 3	Location 3
		Date	23 Aug 2024	09 Sep 2024	20 Nov 2024
		Lab Report Number	FJ2402552	FJ2402713	FJ2403535
		Sample Code	FJ2402552-001	FJ2402713-001	FJ2403535-001
Parameter	Unit	CSR - RL			
<b>Physical Parameters</b>					
Pressure on receipt	Inches Hg	-	-8.17	-2.05	-6.13
<b>Gases</b>					
Methane	%	-	<0.050	<0.050	<0.050
<b>Sulfur Compounds/Volatile Organic Compounds (VOCs)</b>					
1-Butyl mercaptan	ppbv	-	<4.0	<4.0	<4.0
	µg/m3	-	<15	<15	<15
Carbon disulfide	ppbv	-	45.7	<2.0	<2.0
	µg/m3	700	142	<6.2	<6.2
Carbonyl Sulphide	ppbv	-	247	9.6	<4.0
	µg/m3	-	607	24	<10
Diethyl Disulfide	ug/m3	-	<10	<10	<10
	ppbv	-	<2.0	<2.0	<2.0
Diethyl sulphide	ppbv	-	<4.0	<4.0	<4.0
	µg/m3	-	<15	<15	<15
Dimethyl Disulphide	ppbv	-	<2.0	<2.0	<2.0
	mg/m3	-	<0.0077	<0.0077	<0.0077
Dimethyl Sulfide	ppbv	-	<4.0	<4.0	<4.0
	µg/m3	-	<10	<10	<10
Dimethylthiophene, 2,5-	ppbv	-	<4.0	<4.0	<4.0
	ug/m3	-	<18	<18	<18
Ethyl Mercaptan	ppbv	-	<4.0	<4.0	<4.0
	µg/m3	-	<10	<10	<10
Ethyl Methyl Sulfide	ug/m3	-	<12	<12	<12
	ppbv	-	<4.0	<4.0	<4.0
Ethylthiophene, 2-	ppbv	-	<4.0	<4.0	<4.0
	ug/m3	-	<18	<18	<18
Hydrogen sulfide	ppbv	-	13.5	<4.0	<4.0
	µg/m3	-	18.8	<5.6	<5.6
iso-Butyl mercaptan	ppbv	-	<4.0	<12	<4.0
	ug/m3	-	<15	<4.0	<15
Isopropyl Mercaptan	ug/m3	-	<12	<4.0	<12
	ppbv	-	<4.0	<15	<4.0
Methyl Mercaptan	ppbv	-	<4.0	<4.0	<4.0
	µg/m3	2	<7.9	<7.9	<7.9
1-Propanethiol	ppbv	-	<4.0	<4.0	<4.0
	µg/m3	-	<12	<12	<12
Methylthiophene, 2-	ppbv	-	<4.0	<4.0	<4.0
	ug/m3	-	<16	<16	<16
Methylthiophene, 3-	ppbv	-	<4.0	<4.0	<4.0
	ug/m3	-	<16	<16	<16
sec-Butyl Mercaptan + Thiophene	ppbv	-	<6.0	<6.0	<6.0
	ug/m3	-	<21	<21	<21
Sulfur, total reduced (as H2S), 10 compounds	ug/m3	-	427	<16	<16
Sulfur, total reduced (as H2S), 22 compounds	ug/m3	-	427	<25	<25
Sulfur, total reduced (as H2S), NPRI 6	ug/m3	-	427	13	<12
Sulfur, total reduced (as H2S), Ontario 4	ug/m3	-	19	<11	<11
t-Butyl mercaptan	ppbv	-	<4.0	<4.0	<4.0
	ug/m3	-	<15	<15	<15
tetrahydrothiophene	ppbv	-	<4.0	<4.0	<4.0
	µg/m3	-	<14	<14	<14

**Notes:**

**CSR**

Environmental Management Act (EMA). 2023. Contaminated Sites Regulation (CSR), B.C. Reg. 375/96, deposited 1996/12/16, O.C. 1480/96, effective 1997/04/01 (including amendments up to B.C. Reg. 133/2022, effective March 1, 2023). Schedule 3.3

**RL**

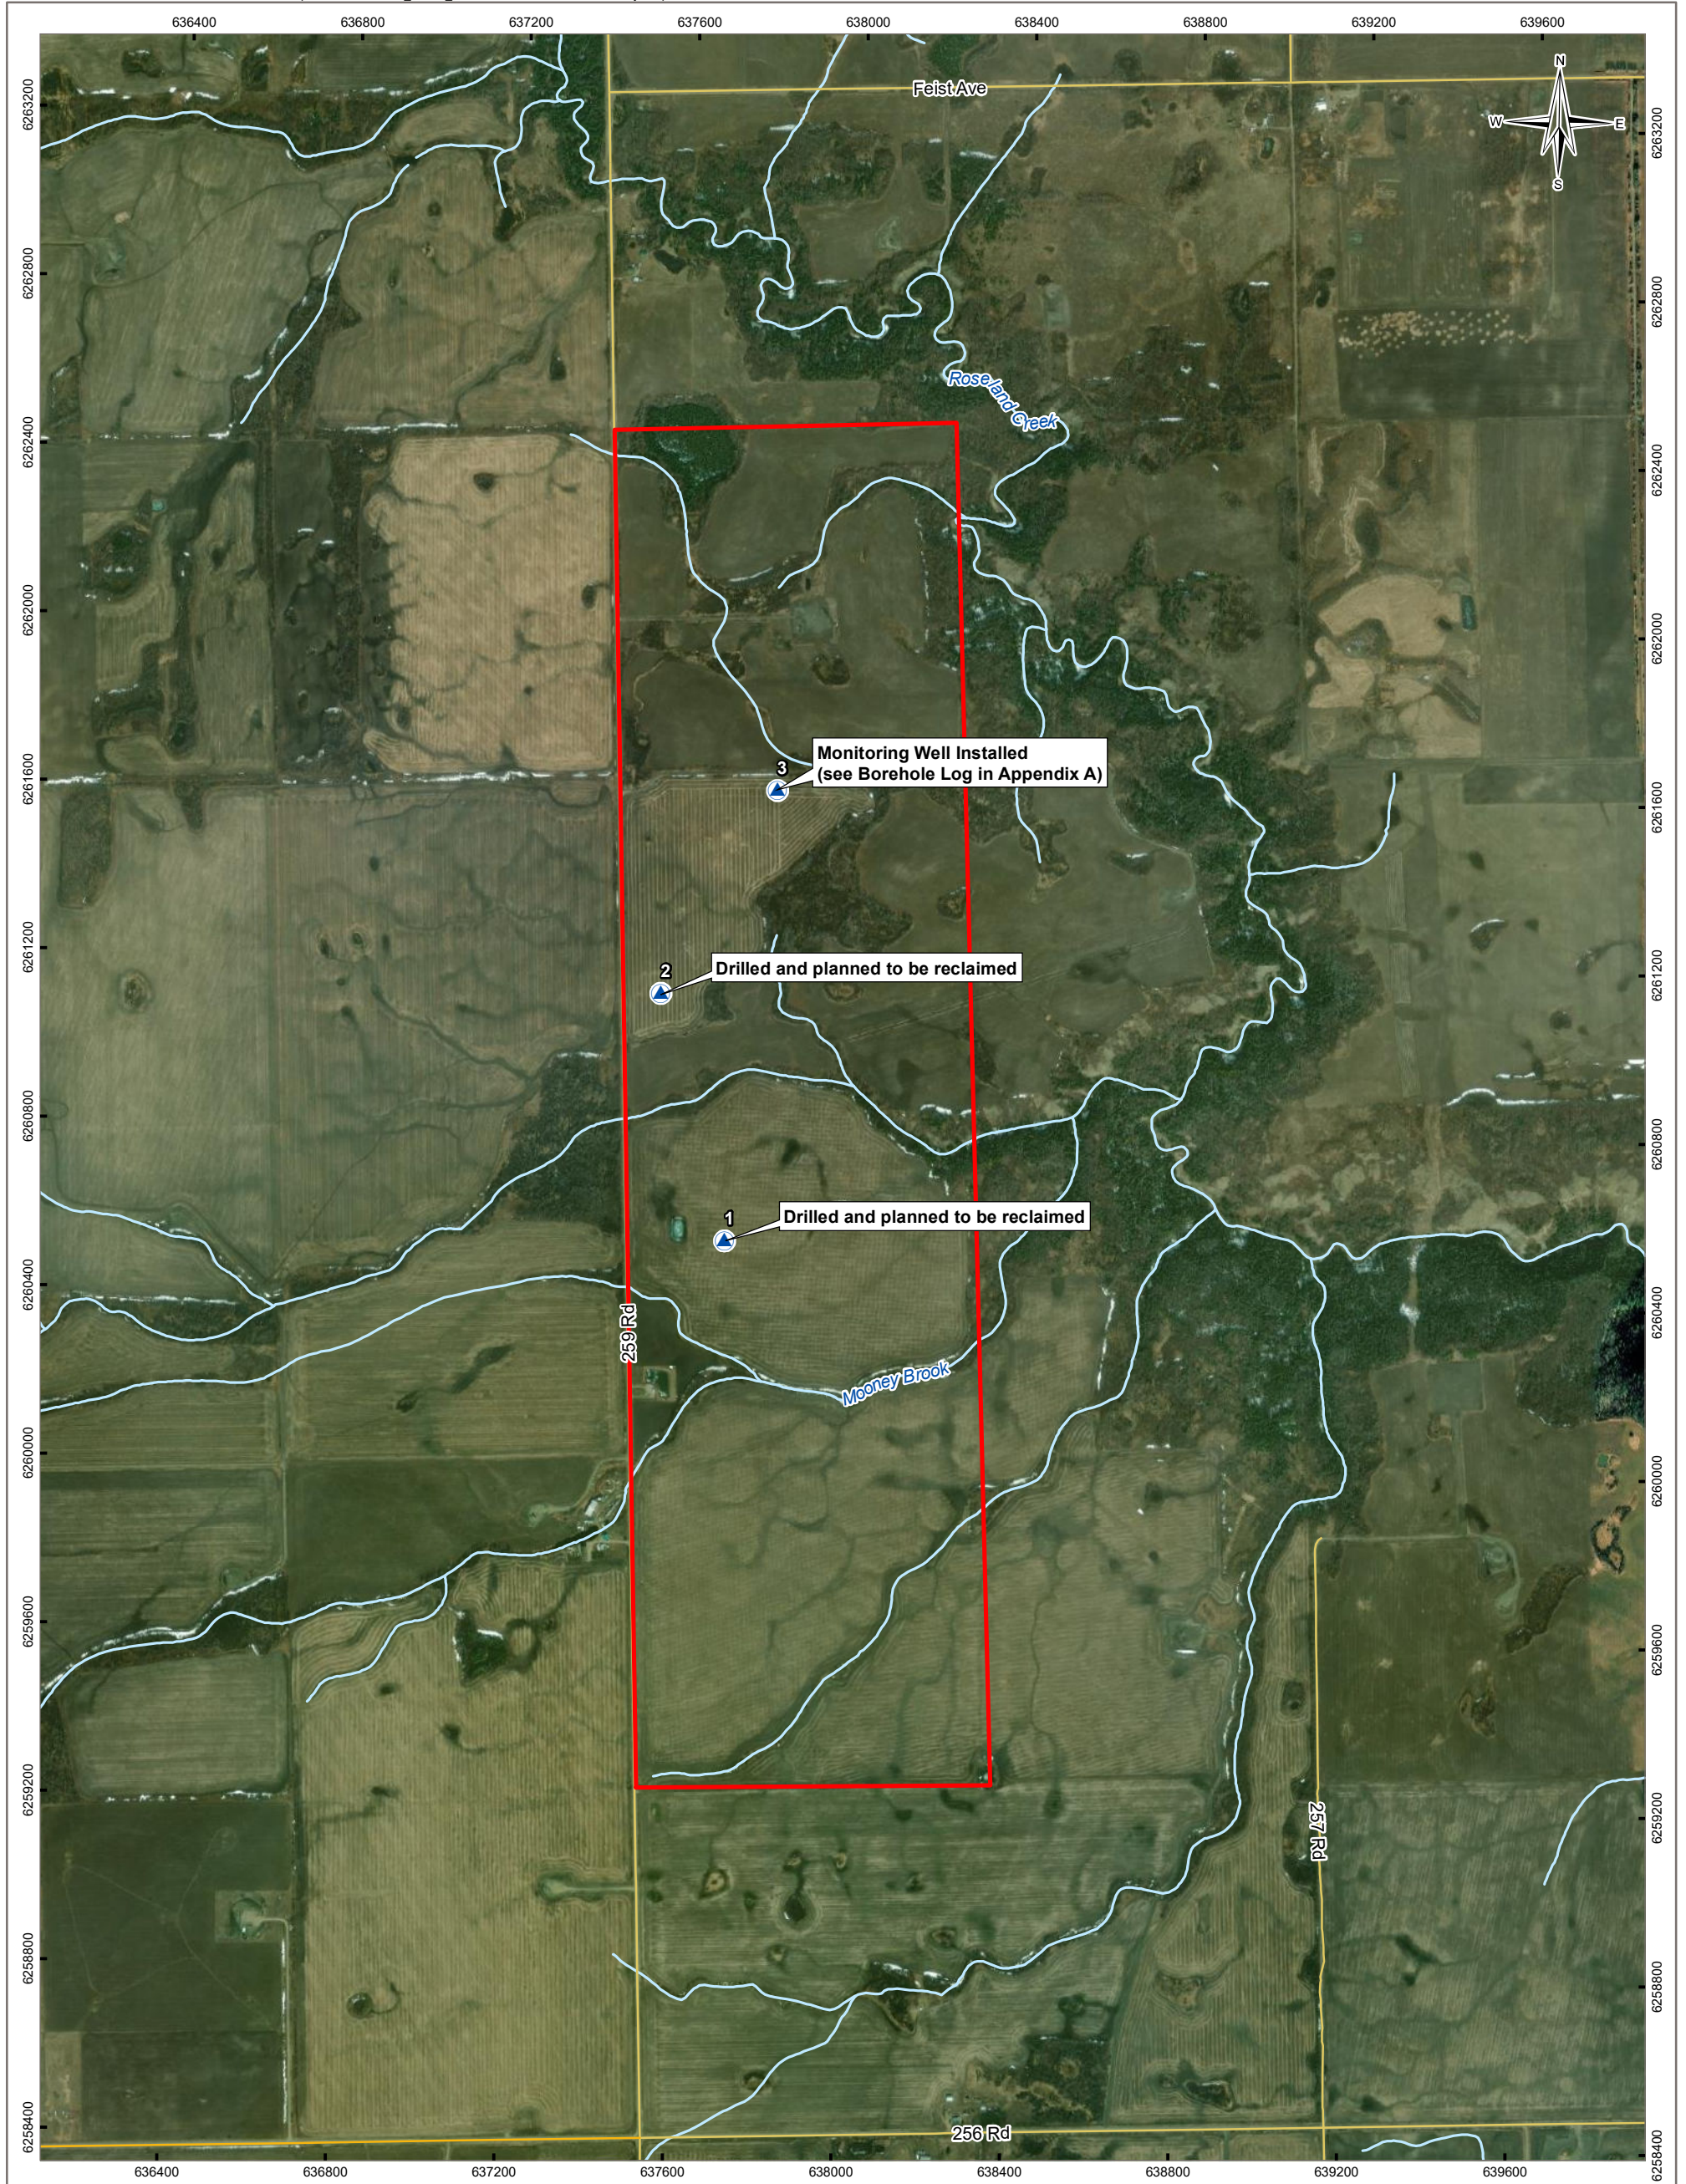
Residential Land Use

**Shaded**






Shaded indicates an exceedance of the CSR Schedule standards prior to applying applicable attenuation factors.

## FIGURES

Figure 1 Water Well Drilling Locations & Order of Preference



**LEGEND**


-  Water Well Drilling Location (labelled with order of preference)
-  Permitted Drilling Area
- Base Data**
-  Main Road
-  Local Road
-  Watercourse

**NOTES**  
Imagery: ESRI, Maxar (2023)

**STATUS**  
ISSUED FOR USE

**PRRD HYDROGEOLOGICAL ASSESSMENT  
PHASE 2**

**Water Well Drilling Locations  
& Order of Preference**

<b>PROJECTION</b> UTM Zone 10		<b>DATUM</b> NAD83		<b>CLIENT</b> Peace River Regional District	
Scale: 1:15,000					
					
<b>FILE NO.</b> GENV03704-02_FIG01_Wells.mxd					
<b>OFFICE</b> TL-VANC		<b>DWN</b> SL	<b>CKD</b> BB	<b>APVD</b> AM	<b>REV</b> 0
<b>DATE</b> December 12, 2024		<b>PROJECT NO.</b> ENW.GENV03704-02			
					<b>Figure 1</b>



## APPENDIX A

### BOREHOLE LOGS

<b>Peace River Regional District</b>	<b>Borehole No: Location 1</b>	
	Project: Rose Prairie Water Well Drilling & Pump Test	Project No: ENW.GENV03704-02
	Location:	
	Rose Prairie, British Columbia	

Depth (m)	Method	Soil Description	Notes and Comments	Depth (ft)
0				0
5		CLAY - massive, dry, firm, low plastic, dark grey, some iron oxidation		10
10		- trace gravel, angular gravel to 5 mm diameter		20
15		SILT - clayey, trace to some gravel, angular gravel to 5 mm diameter, massive, sticky, dry, firm, low plastic, grey, trace iron oxides		30
20		CLAY - trace gravel, angular gravel to 10 mm diameter, massive, very sticky, moist, medium plastic, grey, 2 mm thick brownish yellow clay lenses		40
25	Air rotary	- some gravel, sticky, firm		50
30		- trace gravel		60
35		- dry, low plastic, dark grey		70
40		- homogeneous, gravel to 5 mm diameter, dense		80
45				90
50		SANDSTONE (BEDROCK) - coarse grained sandstone, dark grey		100



Contractor: Carbon Mountain Drilling	Completion Depth: 170.7 m
Equipment Type: Truck mounted RC	Start Date: 2024 August 12
Logged By: FN	Completion Date: 2024 August 19
Reviewed By:	Page 1 of 4

**Peace River Regional District**

**Borehole No: Location 1**

Project: Rose Prairie Water Well Drilling & Pump Test

Project No: ENW.GENV03704-02

Location:

Rose Prairie, British Columbia

Depth (m)	Method	Soil Description	Notes and Comments	Depth (ft)
50				
55	Air rotary	SHALE (BEDROCK) - brittle, hard, black, interbedded yellowish brown sand		170
60		- softer, dark greyish brown, no visible inclusions		180
65		SANDSTONE (BEDROCK) - soft, brownish yellow, intermixed with clay - sticky, low plastic, grey		190
70		SHALE (BEDROCK) - trace sand, coarse grained white sand, brittle, black, intermixed with siltstone - firm, hard, grey, intermixed with sandstone - loose, yellowish brown		200
75		SILTSTONE (BEDROCK) - firm to hard, dense, dark grey, intermixed with clay - sticky, soft		210
80		SHALE (BEDROCK) - brittle, hard, dark grey, intermixed with sticky clay		220
85				230
90				240
95		SANDSTONE (BEDROCK) - soft, light brown, intermixed with shale - brittle, platy, firm to hard, dark greyish black		250
100		- fine grained sandstone, very hard, grey, no visible intermix		260



**TETRA TECH**

Contractor: Carbon Mountain Drilling

Completion Depth: 170.7 m

Equipment Type: Truck mounted RC

Start Date: 2024 August 12

Logged By: FN

Completion Date: 2024 August 19


Reviewed By:

Page 2 of 4



<b>Peace River Regional District</b>	<b>Borehole No: Location 1</b>	
	Project: Rose Prairie Water Well Drilling & Pump Test	Project No: ENW.GENV03704-02
	Location:	
	Rose Prairie, British Columbia	

Depth (m)	Method	Soil Description	Notes and Comments	Depth (ft)
100				
105	Air rotary	- dark grey		330
110		SAND - trace gravel, coarse grained sand, subangular gravel to 10 mm diameter, dry, loose, grey		340
115		SHALE (BEDROCK) - brittle, firm, dark grey		350
120		SANDSTONE (BEDROCK) - stiff, compacted, dark grey		360
125		SHALE (BEDROCK) - brittle, platy, firm, dark greyish black		370
130		SANDSTONE (BEDROCK) - broken to subrounded chunks to 10 mm diameter, very stiff to hard, dark grey		380
135				390
140		SHALE (BEDROCK) - brittle, platy, sticky, firm, dark greyish black		400
145		- compact, very hard		410
150		SANDSTONE (BEDROCK) - coarse grained sandstone, extremely hard, light grey, salt and pepper (white, grey and black)		420
				430
				440
				450
				460
				470
				480
				490

 <b>TETRA TECH</b>	Contractor: Carbon Mountain Drilling	Completion Depth: 170.7 m
	Equipment Type: Truck mounted RC	Start Date: 2024 August 12
	Logged By: FN	Completion Date: 2024 August 19
	Reviewed By:	Page 3 of 4

<b>Peace River Regional District</b>	<b>Borehole No: Location 1</b>	
	Project: Rose Prairie Water Well Drilling & Pump Test	Project No: ENW.GENV03704-02
	Location:	
	Rose Prairie, British Columbia	

Depth (m)	Method	Soil Description	Notes and Comments	Depth (ft)
150	Air rotary	- fine grained sandstone, dark grey		500
155		SHALE (BEDROCK) - brittle, platy, soft, dark grey		510
160		SHALE AND SANDSTONE (BEDROCK) - intermixed, harder		520
165		SANDSTONE - trace soft shale, fine grained sandstone, gritty, soft, light grey		530
170		- hard, limited recovery		540
170		END OF BOREHOLE (170.7 metres)		550
175				560
180				570
185				580
190				590
195				600
200				610
				620
				630
				640
				650



Contractor: Carbon Mountain Drilling	Completion Depth: 170.7 m
Equipment Type: Truck mounted RC	Start Date: 2024 August 12
Logged By: FN	Completion Date: 2024 August 19
Reviewed By:	Page 4 of 4

<b>Peace River Regional District</b>	<b>Borehole No: Location 2</b>	
	Project: Rose Prairie Water Well Drilling & Pump Test	Project No: ENW.GENV03704-02
	Location:	
	Rose Prairie, British Columbia	

Depth (m)	Method	Soil Description	Notes and Comments	Depth (ft)
0				0
5	Air rotary	CLAY - massive, dry, stiff, low plastic, dark grey, iron oxides, trace white fine grained material		10
10		- angular gravel to 10 mm diameter, sticky		20
15		- hard boulder approximately 300 mm thick, gravel to 50 mm diameter		30
20		- some gravel, angular gravel to 10 mm diameter, moist, firm, intermixed with dark brown sand lenses		40
25		- gravel to 5 mm diameter, medium plastic		50
30		- sandy, low plastic, dark brown sand		60
35		- trace sand, soft		70
40		- silty, sandy, medium plastic		80
45		SAND - coarse grained sand, wet, loose, intermixed with clay - trace gravel, low plastic		90
50		CLAY - trace gravel, moist, dense, low plastic, dark grey, intermixed with silt and fine grained sand		100



Contractor: Carbon Mountain Drilling	Completion Depth: 152.4 m
Equipment Type: Truck mounted RC	Start Date: 2024 August 15
Logged By: FN	Completion Date: 2024 August 17
Reviewed By:	Page 1 of 4

<b>Peace River Regional District</b>	<b>Borehole No: Location 2</b>	
	Project: Rose Prairie Water Well Drilling & Pump Test	Project No: ENW.GENV03704-02
	Location:	
	Rose Prairie, British Columbia	

Depth (m)	Method	Soil Description	Notes and Comments	Depth (ft)
50				
55	Air rotary	SHALE (BEDROCK) - fissile, soft, low plastic, dark grey to black, dark brown sand layers		170
60		- dry, very dense, dark grey, no visible sand, silt or gravel		180
65				190
70		- angular gravel to 20 mm diameter for 300 mm - trace sand, trace gravel, coarse grained sand, gravel to 5 mm diameter, sticky, dark grey to black		200
75				210
80				220
85				230
90				240
95		SANDSTONE (BEDROCK) - angular gravel to 7 mm diameter, hard, dark grey SHALE (BEDROCK) - angular gravel to 7 mm diameter, fissile, dry, very dense, dark grey		250
100		SANDSTONE (BEDROCK) - coarse grained sandstone, very hard, dark grey SHALE (BEDROCK) - fissile, dry, very dense, low plastic, dark grey to black, intermixed with fine grained brown sand		260



Contractor: Carbon Mountain Drilling	Completion Depth: 152.4 m
Equipment Type: Truck mounted RC	Start Date: 2024 August 15
Logged By: FN	Completion Date: 2024 August 17
Reviewed By:	Page 2 of 4

**Peace River Regional District**

**Borehole No: Location 2**

Project: Rose Prairie Water Well Drilling & Pump Test

Project No: ENW.GENV03704-02

Location:

Rose Prairie, British Columbia

Depth (m)	Method	Soil Description	Notes and Comments	Depth (ft)
100				
		SANDSTONE (BEDROCK) - well graded, hard, grey		330
		SHALE (BEDROCK) - sticky, hard, low plastic, dark grey to dark brown, intermixed with dark brown sand		340
105				350
		SANDSTONE (BEDROCK) - hard, dark brown		360
110				370
115				380
			Note: Circulation lost, stratigraphy estimated based of Driller interpretation	390
120				400
125	Air rotary			410
130				420
		- non sticky, soft		430
135				440
		- harder		450
140				460
145				470
150				480
				490



Contractor: Carbon Mountain Drilling

Completion Depth: 152.4 m

Equipment Type: Truck mounted RC

Start Date: 2024 August 15

Logged By: FN


Completion Date: 2024 August 17

Reviewed By:

Page 3 of 4

<b>Peace River Regional District</b>	<b>Borehole No: Location 2</b>	
	Project: Rose Prairie Water Well Drilling & Pump Test	Project No: ENW.GENV03704-02
	Location:	
	Rose Prairie, British Columbia	

Depth (m)	Method	Soil Description	Notes and Comments	Depth (ft)
150				
		END OF BOREHOLE (152.4 metres)		500
155				510
160				520
165				530
170				540
175				550
180				560
185				570
190				580
195				590
200				600
				610
				620
				630
				640
				650

 <b>TETRA TECH</b>	Contractor: Carbon Mountain Drilling	Completion Depth: 152.4 m
	Equipment Type: Truck mounted RC	Start Date: 2024 August 15
	Logged By: FN	Completion Date: 2024 August 17
	Reviewed By:	Page 4 of 4

# Peace River Regional District

# Borehole No: Location 3

Project: Rose Prairie Water Well Drilling & Pump Test

Project No: ENW.GENV03704-02

Location:

Rose Prairie, British Columbia

Depth (m)	Method	Soil Description	Sample Type	VOC				Notes and Comments	Monitoring well	Depth (ft)
				5	10	15	20			
0				1	2	3	4	51 mm diameter PVC pipe	1.0 m stickup	0
0 - 5		CLAY - trace organics, trace gravel, homogeneous, subangular gravel to 20 mm diameter, moist, firm, medium plastic, light brown  - boulder								0 - 5
5 - 15		- no visible organics, soft to firm, grey								5 - 15
15 - 20		- fine to coarse grained gravel								15 - 20
20 - 30	Air rotary	- firm								20 - 30
30 - 35		- trace to some gravel, trace silt, high plastic								30 - 35
35 - 40		- increased silt, medium plastic								35 - 40
40 - 45										40 - 45
45 - 50										45 - 50



Contractor: Carbon Mountain Drilling

Completion Depth: 158.5 m

Equipment Type: Truck mounted RC

Start Date: 2024 September 4

Logged By: TK

Completion Date: 2024 September 7

Reviewed By:

Page 1 of 4

# Peace River Regional District

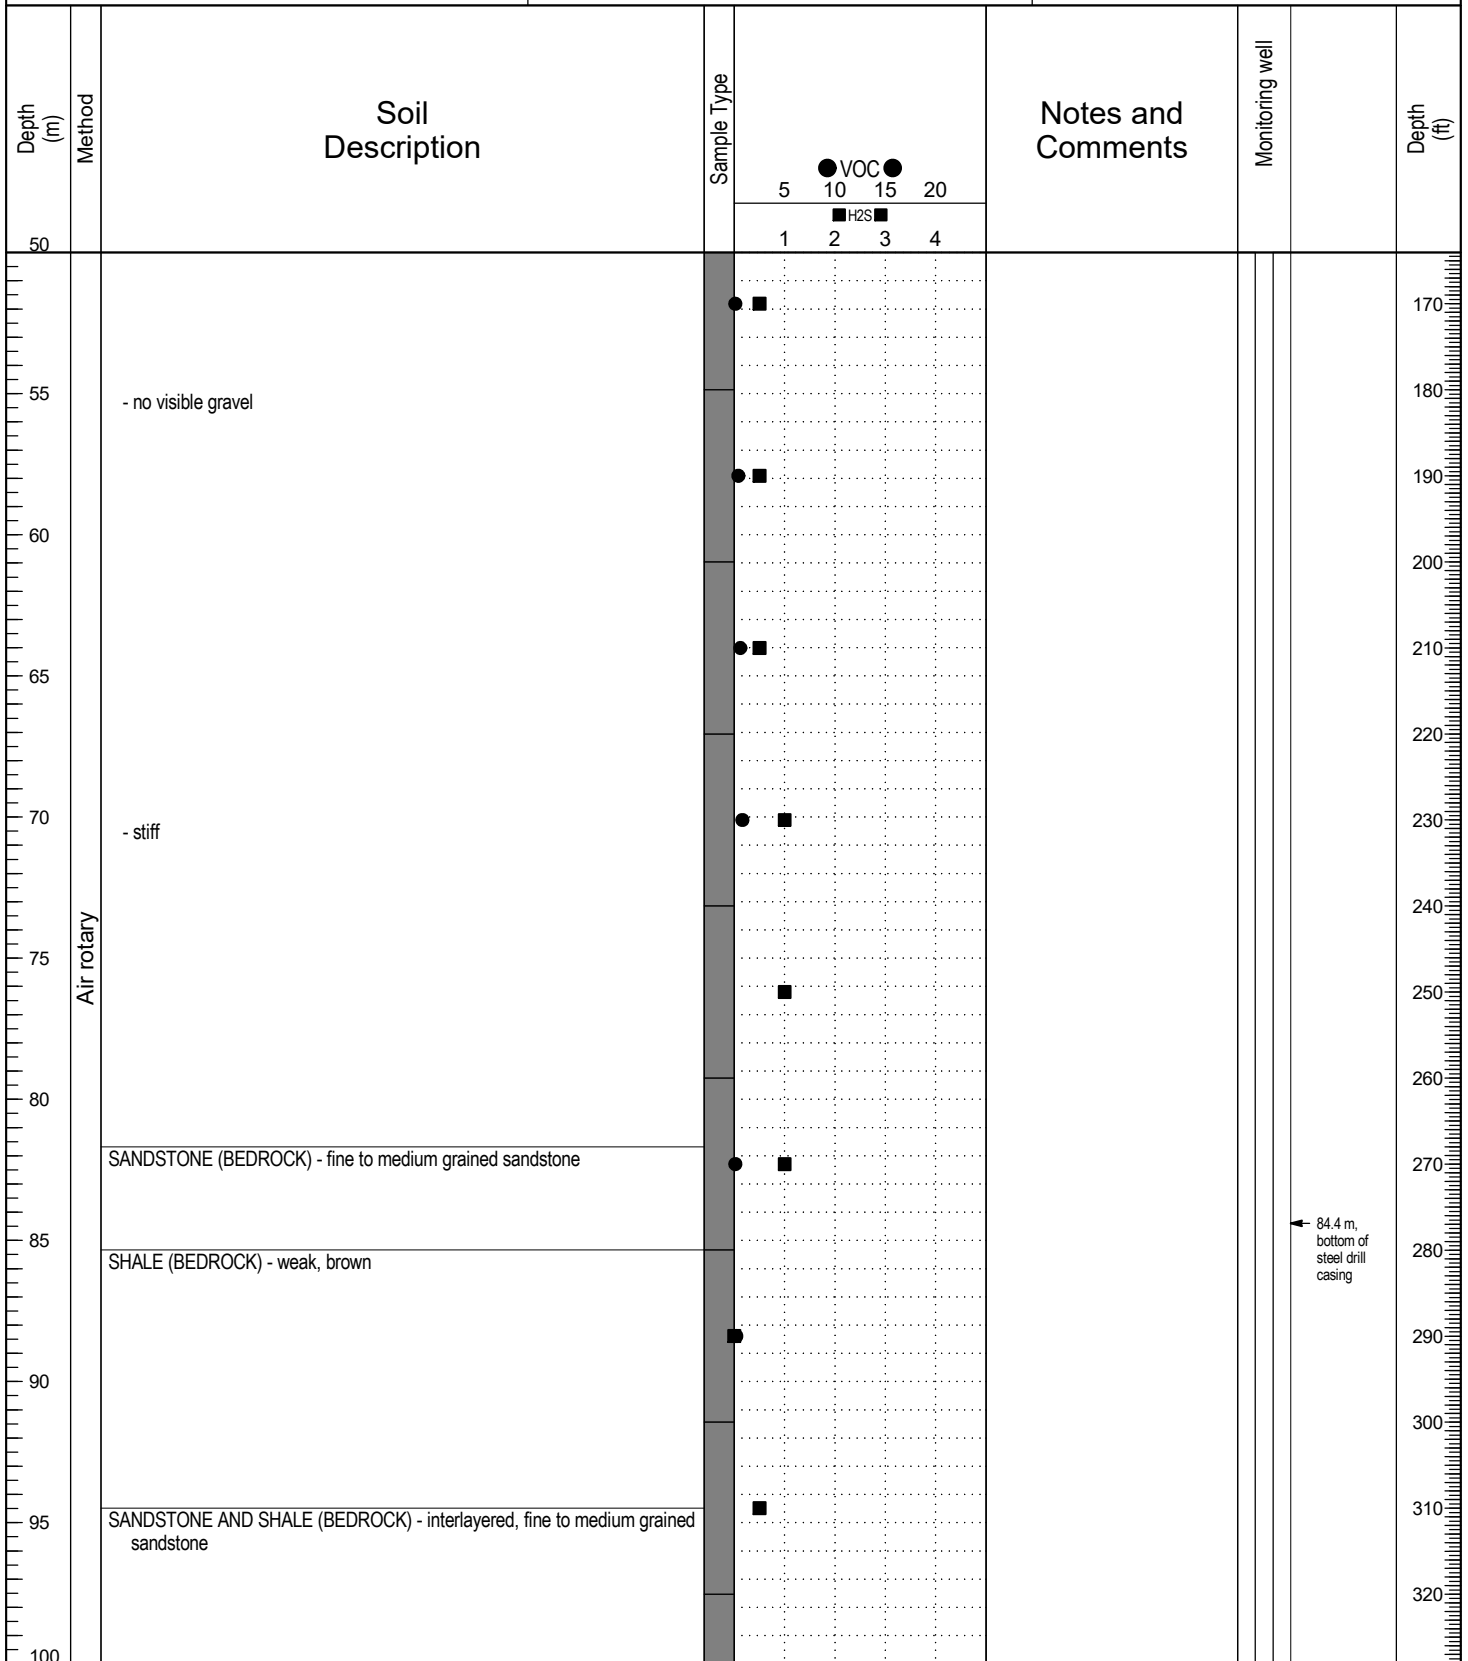
# Borehole No: Location 3

Project: Rose Prairie Water Well Drilling & Pump Test

Project No: ENW.GENV03704-02

Location:

Rose Prairie, British Columbia



Contractor: Carbon Mountain Drilling

Completion Depth: 158.5 m

Equipment Type: Truck mounted RC

Start Date: 2024 September 4

Logged By: TK

Completion Date: 2024 September 7

Reviewed By:

Page 2 of 4



# Peace River Regional District

# Borehole No: Location 3

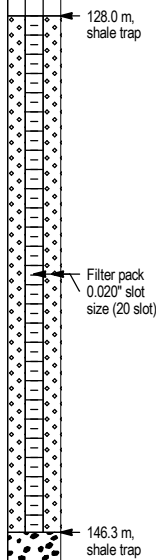
Project: Rose Prairie Water Well Drilling & Pump Test

Project No: ENW.GENV03704-02

Location:

Rose Prairie, British Columbia

Depth (m)	Method	Soil Description	Sample Type	VOC				Notes and Comments	Monitoring well	Depth (ft)
				5	10	15	20			
			H2S							
			1	2	3	4				
100										
105		- weak, brownish grey								330
110										340
115										350
120		SANDSTONE (BEDROCK) - greyish black, some shale lenses								360
125	Air rotary	- some shale, weathered, weak, H2S odour observed from 121.92 metres on								370
130		SHALE (BEDROCK) - weak, grey								380
135		SANDSTONE (BEDROCK) - medium to coarse grained sandstone								390
140		- harder								400
145		SHALE (BEDROCK) - weak, dark grey, intermixed fine grained sandstone								410
150		- some fine grained sandstone, dense								420



Contractor: Carbon Mountain Drilling

Completion Depth: 158.5 m

Equipment Type: Truck mounted RC

Start Date: 2024 September 4

Logged By: TK

Completion Date: 2024 September 7

Reviewed By:

Page 3 of 4

**Peace River Regional District**

**Borehole No: Location 3**

Project: Rose Prairie Water Well Drilling & Pump Test

Project No: ENW.GENV03704-02

Location:

Rose Prairie, British Columbia

Depth (m)	Method	Soil Description	Sample Type	VOC				Notes and Comments	Monitoring well	Depth (ft)
				5	10	15	20			
			H2S							
			1	2	3	4				
150	Air rotary								500	
155									510	
160		END OF BOREHOLE (158.5 metres) Monitoring well installed to 146.3 metres							520	
165									530	
170									540	
175									550	
180									560	
185									570	
190									580	
195									590	
200									600	



Contractor: Carbon Mountain Drilling

Completion Depth: 158.5 m

Equipment Type: Truck mounted RC

Start Date: 2024 September 4

Logged By: TK

Completion Date: 2024 September 7

Reviewed By:

Page 4 of 4

## APPENDIX B

### LABORATORY REPORTS



## CERTIFICATE OF ANALYSIS

<p><b>Work Order</b> : <b>FJ2402491</b></p> <p>Client : <b>Tetra Tech Canada Inc.</b></p> <p>Contact : Andrea McMillan</p> <p>Address : 110, 140 Quarry Park Blvd SE Calgary AB Canada T2C 3G3</p> <p>Telephone : ----</p> <p>Project : 704.ENV.GENV 03704-02</p> <p>PO : ----</p> <p>C-O-C number : 20-964332</p> <p>Sampler : Fahim Nazari</p> <p>Site : ----</p> <p>Quote number : VA24-EBAE100-013</p> <p>No. of samples received : 1</p> <p>No. of samples analysed : 1</p>	<p>Page : 1 of 7</p> <p>Laboratory : ALS Environmental - Fort St. John</p> <p>Account Manager : Wendy Sears</p> <p>Address : 11007 Alaska Road Fort St. John BC Canada V1J 6P3</p> <p>Telephone : +1 250 261 5517</p> <p>Date Samples Received : 21-Aug-2024 09:00</p> <p>Date Analysis Commenced : 22-Aug-2024</p> <p>Issue Date : 26-Aug-2024 18:23</p>
--	---

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Certificate of Analysis contains the following information:

- General Comments
- Analytical Results

Additional information pertinent to this report will be found in the following separate attachments: Quality Control Report, QC Interpretive report to assist with Quality Review and Sample Receipt Notification (SRN).

### Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

<i>Signatories</i>	<i>Position</i>	<i>Laboratory Department</i>
Andrea Armstrong	Department Manager - Air Quality and Volatiles	Air Quality, Waterloo, Ontario
Angela Ren	Team Leader - Metals	Metals, Burnaby, British Columbia
Ilnaz Badbezanchi	Supervisor - Metals Prep & Mercury	Metals, Burnaby, British Columbia
Kate Dimitrova	Supervisor - Inorganic	Inorganics, Burnaby, British Columbia
Manpreet Cheema	Lab Assistant	Metals, Burnaby, British Columbia
Maya Urquhart	Lab Analyst	Metals, Burnaby, British Columbia
Owen Cheng		Metals, Burnaby, British Columbia



## General Comments

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Refer to the ALS Quality Control Interpretive report (QCI) for applicable references and methodology summaries. Reference methods may incorporate modifications to improve performance.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis.

Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

Please refer to Quality Control Interpretive report (QCI) for information regarding Holding Time compliance.

Key : CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances  
 LOR: Limit of Reporting (detection limit).

<i>Unit</i>	<i>Description</i>
-	no units
% T/cm	% transmittance per centimetre
µg/L	micrograms per litre
µS/cm	microsiemens per centimetre
AU/cm	absorbance units per centimetre
CU	colour units (1 cu = 1 mg/l pt)
mg/L	milligrams per litre
NTU	nephelometric turbidity units
pH units	pH units
ppmv	parts per million (volume/volume)

<: less than.

>: greater than.

Surrogate: An analyte that is similar in behavior to target analyte(s), but that does not occur naturally in environmental samples. For applicable tests, surrogates are added to samples prior to analysis as a check on recovery.

Test results reported relate only to the samples as received by the laboratory.

UNLESS OTHERWISE STATED on SRN or QCI Report, ALL SAMPLES WERE RECEIVED IN ACCEPTABLE CONDITION.

## Qualifiers

<i>Qualifier</i>	<i>Description</i>
DLA	Detection Limit adjusted for required dilution.
DLDS	Detection Limit Raised: Dilution required due to high Dissolved Solids / Electrical Conductivity.
DTMF	Dissolved concentration exceeds total for field-filtered metals sample. Metallic contaminants may have been introduced to dissolved sample during field filtration.



## Analytical Results

Sub-Matrix: Water					Client sample ID	Location 2	---	---	---	---
(Matrix: Water)					Client sampling date / time	20-Aug-2024 17:00	---	---	---	---
Analyte	CAS Number	Method/Lab	LOR	Unit	FJ2402491-001	-----	-----	-----	-----	
					Result	---	---	---	---	
<b>Physical Tests</b>										
Absorbance, UV (@ 254nm)	---	E404/VA	0.0050	AU/cm	0.141	---	---	---	---	
Alkalinity, bicarbonate (as CaCO3)	---	E290/VA	1.0	mg/L	534	---	---	---	---	
Alkalinity, carbonate (as CaCO3)	---	E290/VA	1.0	mg/L	<1.0	---	---	---	---	
Alkalinity, hydroxide (as CaCO3)	---	E290/VA	1.0	mg/L	<1.0	---	---	---	---	
Alkalinity, phenolphthalein (as CaCO3)	---	E290/VA	1.0	mg/L	<1.0	---	---	---	---	
Alkalinity, total (as CaCO3)	---	E290/VA	1.0	mg/L	534	---	---	---	---	
Colour, true	---	E329/VA	5.0	CU	5.8	---	---	---	---	
Conductivity	---	E100/VA	2.0	µS/cm	975	---	---	---	---	
Hardness (as CaCO3), dissolved	---	EC100/VA	0.60	mg/L	41.2	---	---	---	---	
Hardness (as CaCO3), from total Ca/Mg	---	EC100A/VA	0.60	mg/L	227	---	---	---	---	
pH	---	E108/VA	0.10	pH units	7.99	---	---	---	---	
Solids, total dissolved [TDS]	---	E162/VA	10	mg/L	906	---	---	---	---	
Turbidity	---	E121/VA	0.10	NTU	>4000	---	---	---	---	
Transmittance, UV (@ 254nm)	---	E404/VA	1.0	% T/cm	72.3	---	---	---	---	
<b>Anions and Nutrients</b>										
Bromide	24959-67-9	E235.Br-L/VA	0.050	mg/L	<0.250 <sup>DLDS</sup>	---	---	---	---	
Chloride	16887-00-6	E235.Cl/VA	0.50	mg/L	19.0	---	---	---	---	
Fluoride	16984-48-8	E235.F/VA	0.020	mg/L	0.478	---	---	---	---	
Nitrate (as N)	14797-55-8	E235.NO3-L/V A	0.0050	mg/L	0.0412	---	---	---	---	
Nitrite (as N)	14797-65-0	E235.NO2-L/V A	0.0010	mg/L	<0.0050 <sup>DLDS</sup>	---	---	---	---	
Sulfate (as SO4)	14808-79-8	E235.SO4/VA	0.30	mg/L	12.7	---	---	---	---	
<b>Cyanides</b>										
Cyanide, strong acid dissociable (Total)	---	E333/VA	0.0050	mg/L	<0.0050	---	---	---	---	
<b>Organic / Inorganic Carbon</b>										
Carbon, dissolved organic [DOC]	---	E358-L/VA	0.50	mg/L	27.5	---	---	---	---	
Carbon, total organic [TOC]	---	E355-L/VA	0.50	mg/L	101	---	---	---	---	
<b>Total Sulfides</b>										
Sulfide, total (as H2S)	7783-06-4	E395-H/VA	0.011	mg/L	0.372	---	---	---	---	



## Analytical Results

Sub-Matrix: Water					Client sample ID	Location 2	----	----	----	----
(Matrix: Water)					Client sampling date / time	20-Aug-2024 17:00	---	---	---	---
Analyte	CAS Number	Method/Lab	LOR	Unit	FJ2402491-001	-----	-----	-----	-----	
						Result	---	---	---	---
<b>Total Sulfides</b>										
Sulfide, total (as S)	18496-25-8	E395-H/VA	0.010	mg/L	0.350	---	---	---	---	
<b>Total Metals</b>										
Aluminum, total	7429-90-5	E420/VA	0.0030	mg/L	72.3	---	---	---	---	
Antimony, total	7440-36-0	E420/VA	0.00010	mg/L	0.00168	---	---	---	---	
Arsenic, total	7440-38-2	E420/VA	0.00010	mg/L	0.0325	---	---	---	---	
Barium, total	7440-39-3	E420/VA	0.00010	mg/L	9.27	---	---	---	---	
Beryllium, total	7440-41-7	E420/VA	0.000100	mg/L	0.00583	---	---	---	---	
Bismuth, total	7440-69-9	E420/VA	0.000050	mg/L	0.00136	---	---	---	---	
Boron, total	7440-42-8	E420/VA	0.010	mg/L	0.284	---	---	---	---	
Cadmium, total	7440-43-9	E420/VA	0.0000050	mg/L	0.0147	---	---	---	---	
Calcium, total	7440-70-2	E420/VA	0.050	mg/L	32.5	---	---	---	---	
Cesium, total	7440-46-2	E420/VA	0.000010	mg/L	0.0161	---	---	---	---	
Chromium, total	7440-47-3	E420/VA	0.000050	mg/L	0.194	---	---	---	---	
Cobalt, total	7440-48-4	E420/VA	0.00010	mg/L	0.0891	---	---	---	---	
Copper, total	7440-50-8	E420/VA	0.000050	mg/L	0.295	---	---	---	---	
Iron, total	7439-89-6	E420/VA	0.010	mg/L	274	---	---	---	---	
Lead, total	7439-92-1	E420/VA	0.000050	mg/L	0.102	---	---	---	---	
Lithium, total	7439-93-2	E420/VA	0.0010	mg/L	0.119	---	---	---	---	
Magnesium, total	7439-95-4	E420/VA	0.0050	mg/L	35.5	---	---	---	---	
Manganese, total	7439-96-5	E420/VA	0.00010	mg/L	4.59	---	---	---	---	
Mercury, total	7439-97-6	E508/VA	0.0000050	mg/L	0.00143	---	---	---	---	
Molybdenum, total	7439-98-7	E420/VA	0.000050	mg/L	0.00922	---	---	---	---	
Nickel, total	7440-02-0	E420/VA	0.000050	mg/L	0.328	---	---	---	---	
Phosphorus, total	7723-14-0	E420/VA	0.050	mg/L	4.07	---	---	---	---	
Potassium, total	7440-09-7	E420/VA	0.050	mg/L	14.4	---	---	---	---	
Rubidium, total	7440-17-7	E420/VA	0.000020	mg/L	0.0972	---	---	---	---	
Selenium, total	7782-49-2	E420/VA	0.000050	mg/L	0.00438	---	---	---	---	
Silicon, total	7440-21-3	E420/VA	0.10	mg/L	87.2	---	---	---	---	
Silver, total	7440-22-4	E420/VA	0.000010	mg/L	0.00359	---	---	---	---	
Sodium, total	7440-23-5	E420/VA	0.050	mg/L	232	---	---	---	---	



## Analytical Results

Sub-Matrix: Water					Client sample ID	Location 2	----	----	----	----
(Matrix: Water)					Client sampling date / time	20-Aug-2024 17:00	---	---	---	---
Analyte	CAS Number	Method/Lab	LOR	Unit	FJ2402491-001	-----	-----	-----	-----	
					Result	---	---	---	---	
<b>Total Metals</b>										
Strontium, total	7440-24-6	E420/VA	0.00020	mg/L	0.528	---	---	---	---	
Sulfur, total	7704-34-9	E420/VA	0.50	mg/L	14.0	---	---	---	---	
Tellurium, total	13494-80-9	E420/VA	0.00020	mg/L	<0.00100 <sup>DLA</sup>	---	---	---	---	
Thallium, total	7440-28-0	E420/VA	0.000010	mg/L	0.00135	---	---	---	---	
Thorium, total	7440-29-1	E420/VA	0.00010	mg/L	0.0348	---	---	---	---	
Tin, total	7440-31-5	E420/VA	0.00010	mg/L	<0.00050 <sup>DLA</sup>	---	---	---	---	
Titanium, total	7440-32-6	E420/VA	0.00030	mg/L	0.107	---	---	---	---	
Tungsten, total	7440-33-7	E420/VA	0.00010	mg/L	<0.00050 <sup>DLA</sup>	---	---	---	---	
Uranium, total	7440-61-1	E420/VA	0.000010	mg/L	0.0107	---	---	---	---	
Vanadium, total	7440-62-2	E420/VA	0.00050	mg/L	0.233	---	---	---	---	
Zinc, total	7440-66-6	E420/VA	0.0030	mg/L	1.03	---	---	---	---	
Zirconium, total	7440-67-7	E420/VA	0.00020	mg/L	<0.00100 <sup>DLA</sup>	---	---	---	---	
<b>Dissolved Metals</b>										
Aluminum, dissolved	7429-90-5	E421/VA	0.0010	mg/L	0.136	---	---	---	---	
Antimony, dissolved	7440-36-0	E421/VA	0.00010	mg/L	0.00206	---	---	---	---	
Arsenic, dissolved	7440-38-2	E421/VA	0.00010	mg/L	0.00114	---	---	---	---	
Barium, dissolved	7440-39-3	E421/VA	0.00010	mg/L	0.352	---	---	---	---	
Beryllium, dissolved	7440-41-7	E421/VA	0.000100	mg/L	<0.000100	---	---	---	---	
Bismuth, dissolved	7440-69-9	E421/VA	0.000050	mg/L	<0.000050	---	---	---	---	
Boron, dissolved	7440-42-8	E421/VA	0.010	mg/L	0.240	---	---	---	---	
Cadmium, dissolved	7440-43-9	E421/VA	0.0000050	mg/L	0.0000186	---	---	---	---	
Calcium, dissolved	7440-70-2	E421/VA	0.050	mg/L	7.60	---	---	---	---	
Cesium, dissolved	7440-46-2	E421/VA	0.000010	mg/L	0.000057	---	---	---	---	
Chromium, dissolved	7440-47-3	E421/VA	0.00050	mg/L	<0.00050	---	---	---	---	
Cobalt, dissolved	7440-48-4	E421/VA	0.00010	mg/L	0.00042	---	---	---	---	
Copper, dissolved	7440-50-8	E421/VA	0.00020	mg/L	0.00053	---	---	---	---	
Iron, dissolved	7439-89-6	E421/VA	0.010	mg/L	0.174	---	---	---	---	
Lead, dissolved	7439-92-1	E421/VA	0.000050	mg/L	0.000073	---	---	---	---	
Lithium, dissolved	7439-93-2	E421/VA	0.0010	mg/L	0.0068	---	---	---	---	
Magnesium, dissolved	7439-95-4	E421/VA	0.0050	mg/L	5.39	---	---	---	---	





## Analytical Results

Sub-Matrix: Water					Client sample ID	Location 2	----	----	----	----
(Matrix: Water)					Client sampling date / time	20-Aug-2024 17:00	---	---	---	---
Analyte	CAS Number	Method/Lab	LOR	Unit	FJ2402491-001	-----	-----	-----	-----	
					Result	---	---	---	---	
<b>Dissolved Metals</b>										
Manganese, dissolved	7439-96-5	E421/VA	0.00010	mg/L	0.141	---	---	---	---	
Mercury, dissolved	7439-97-6	E509/VA	0.0000050	mg/L	<0.0000050	---	---	---	---	
Molybdenum, dissolved	7439-98-7	E421/VA	0.000050	mg/L	0.0192 <sup>DTMF</sup>	---	---	---	---	
Nickel, dissolved	7440-02-0	E421/VA	0.00050	mg/L	0.00347	---	---	---	---	
Phosphorus, dissolved	7723-14-0	E421/VA	0.050	mg/L	<0.050	---	---	---	---	
Potassium, dissolved	7440-09-7	E421/VA	0.050	mg/L	5.18	---	---	---	---	
Rubidium, dissolved	7440-17-7	E421/VA	0.00020	mg/L	0.00188	---	---	---	---	
Selenium, dissolved	7782-49-2	E421/VA	0.000050	mg/L	0.000941	---	---	---	---	
Silicon, dissolved	7440-21-3	E421/VA	0.050	mg/L	2.04	---	---	---	---	
Silver, dissolved	7440-22-4	E421/VA	0.000010	mg/L	<0.000010	---	---	---	---	
Sodium, dissolved	7440-23-5	E421/VA	0.050	mg/L	244	---	---	---	---	
Strontium, dissolved	7440-24-6	E421/VA	0.00020	mg/L	0.150	---	---	---	---	
Sulfur, dissolved	7704-34-9	E421/VA	0.50	mg/L	11.0	---	---	---	---	
Tellurium, dissolved	13494-80-9	E421/VA	0.00020	mg/L	<0.00020	---	---	---	---	
Thallium, dissolved	7440-28-0	E421/VA	0.000010	mg/L	<0.000010	---	---	---	---	
Thorium, dissolved	7440-29-1	E421/VA	0.00010	mg/L	<0.00010	---	---	---	---	
Tin, dissolved	7440-31-5	E421/VA	0.00010	mg/L	<0.00010	---	---	---	---	
Titanium, dissolved	7440-32-6	E421/VA	0.00030	mg/L	0.00527	---	---	---	---	
Tungsten, dissolved	7440-33-7	E421/VA	0.00010	mg/L	<0.00010	---	---	---	---	
Uranium, dissolved	7440-61-1	E421/VA	0.000010	mg/L	0.00263	---	---	---	---	
Vanadium, dissolved	7440-62-2	E421/VA	0.00050	mg/L	0.00059	---	---	---	---	
Zinc, dissolved	7440-66-6	E421/VA	0.0010	mg/L	0.0020	---	---	---	---	
Zirconium, dissolved	7440-67-7	E421/VA	0.00020	mg/L	<0.00020	---	---	---	---	
Dissolved mercury filtration location	----	EP509/VA	-	-	Field	---	---	---	---	
Dissolved metals filtration location	----	EP421/VA	-	-	Field	---	---	---	---	
<b>Dissolved Gases</b>										
Methane	74-82-8	EC614B/WT	5.0	µg/L	10.5	---	---	---	---	
Methane	74-82-8	E614B/WT	20.8	ppmv	43.6	---	---	---	---	

Page : 7 of 7  
Work Order : FJ2402491  
Client : Tetra Tech Canada Inc.  
Project : 704.ENV.GENV 03704-02

---



Please refer to the General Comments section for an explanation of any result qualifiers detected.

Please refer to the Accreditation section for an explanation of analyte accreditations.

---

## QUALITY CONTROL INTERPRETIVE REPORT

---

<p><b>Work Order</b> : <b>FJ2402491</b></p> <p><b>Client</b> : <b>Tetra Tech Canada Inc.</b></p> <p><b>Contact</b> : Andrea McMillan</p> <p><b>Address</b> : 110, 140 Quarry Park Blvd SE Calgary AB Canada T2C 3G3</p> <p><b>Telephone</b> : ----</p> <p><b>Project</b> : 704.ENV.GENV 03704-02</p> <p><b>PO</b> : ----</p> <p><b>C-O-C number</b> : 20-964332</p> <p><b>Sampler</b> : Fahim Nazari</p> <p><b>Site</b> : ----</p> <p><b>Quote number</b> : VA24-EBAE100-013</p> <p><b>No. of samples received</b> : 1</p> <p><b>No. of samples analysed</b> : 1</p>	<p><b>Page</b> : 1 of 12</p> <p><b>Laboratory</b> : ALS Environmental - Fort St. John</p> <p><b>Account Manager</b> : Wendy Sears</p> <p><b>Address</b> : 11007 Alaska Road Fort St. John, British Columbia Canada V1J 6P3</p> <p><b>Telephone</b> : +1 250 261 5517</p> <p><b>Date Samples Received</b> : 21-Aug-2024 09:00</p> <p><b>Issue Date</b> : 26-Aug-2024 18:23</p>
--	---

---

This report is automatically generated by the ALS LIMS (Laboratory Information Management System) through evaluation of Quality Control (QC) results and other QA parameters associated with this submission, and is intended to facilitate rapid data validation by auditors or reviewers. The report highlights any exceptions and outliers to ALS Data Quality Objectives, provides holding time details and exceptions, summarizes QC sample frequencies, and lists applicable methodology references and summaries.

**Key**

- Anonymous: Refers to samples which are not part of this work order, but which formed part of the QC process lot.
- CAS Number: Chemical Abstracts Service number is a unique identifier assigned to discrete substances.
- DQO: Data Quality Objective.
- LOR: Limit of Reporting (detection limit).
- RPD: Relative Percent Difference.

---

### ***Workorder Comments***

Holding times are displayed as "----" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

---

### ***Summary of Outliers***

#### ***Outliers : Quality Control Samples***

- No Method Blank value outliers occur.
- No Duplicate outliers occur.
- No Laboratory Control Sample (LCS) outliers occur
- No Matrix Spike outliers occur.
- No Test sample Surrogate recovery outliers exist.

#### ***Outliers: Reference Material (RM) Samples***

- No Reference Material (RM) Sample outliers occur.

***Outliers : Analysis Holding Time Compliance (Breaches)***

- Analysis Holding Time Outliers exist - please see following pages for full details.

***Outliers : Frequency of Quality Control Samples***

- Quality Control Sample Frequency Outliers occur - please see following pages for full details.



## Analysis Holding Time Compliance

This report summarizes extraction / preparation and analysis times and compares each with ALS recommended holding times, which are selected to meet known provincial and /or federal requirements. In the absence of regulatory hold times, ALS establishes recommendations based on guidelines published by organizations such as CCME, US EPA, APHA Standard Methods, ASTM, or Environment Canada (where available). Dates and holding times reported below represent the first dates of extraction or analysis. If subsequent tests or dilutions exceeded holding times, qualifiers are added (refer to COA).

If samples are identified below as having been analyzed or extracted outside of recommended holding times, measurement uncertainties may be increased, and this should be taken into consideration when interpreting results.

Where actual sampling date is not provided on the chain of custody, the date of receipt with time at 00:00 is used for calculation purposes.

Where only the sample date without time is provided on the chain of custody, the sampling date at 00:00 is used for calculation purposes.

Matrix: **Water** Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis				
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval	
				Rec	Actual			Rec	Actual		
<b>Anions and Nutrients : Bromide in Water by IC (Low Level)</b>											
HDPE Location 2	E235.Br-L	20-Aug-2024	22-Aug-2024	28 days	2 days	✔	22-Aug-2024	28 days	2 days	✔	
<b>Anions and Nutrients : Chloride in Water by IC</b>											
HDPE Location 2	E235.Cl	20-Aug-2024	22-Aug-2024	28 days	2 days	✔	22-Aug-2024	28 days	2 days	✔	
<b>Anions and Nutrients : Fluoride in Water by IC</b>											
HDPE Location 2	E235.F	20-Aug-2024	22-Aug-2024	28 days	2 days	✔	22-Aug-2024	28 days	2 days	✔	
<b>Anions and Nutrients : Nitrate in Water by IC (Low Level)</b>											
HDPE Location 2	E235.NO3-L	20-Aug-2024	22-Aug-2024	3 days	2 days	✔	22-Aug-2024	3 days	2 days	✔	
<b>Anions and Nutrients : Nitrite in Water by IC (Low Level)</b>											
HDPE Location 2	E235.NO2-L	20-Aug-2024	22-Aug-2024	3 days	2 days	✔	22-Aug-2024	3 days	2 days	✔	
<b>Anions and Nutrients : Sulfate in Water by IC</b>											
HDPE Location 2	E235.SO4	20-Aug-2024	22-Aug-2024	28 days	2 days	✔	22-Aug-2024	28 days	2 days	✔	
<b>Cyanides : Total Cyanide</b>											
UV-inhibited HDPE - total (sodium hydroxide) Location 2	E333	20-Aug-2024	22-Aug-2024	14 days	2 days	✔	22-Aug-2024	14 days	2 days	✔	



Matrix: **Water** Evaluation: \* = Holding time exceedance ; ✓ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis			
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval
				Rec	Actual			Rec	Actual	
<b>Dissolved Gases : Methane, Ethane, &amp; Ethene by Headspace GC-FID</b>										
Glass vial (sodium bisulfate) Location 2	E614B	20-Aug-2024	----	----	----		26-Aug-2024	14 days	6 days	✓
<b>Dissolved Metals : Dissolved Mercury in Water by CVAAS</b>										
Glass vial dissolved (hydrochloric acid) Location 2	E509	20-Aug-2024	22-Aug-2024	28 days	2 days	✓	22-Aug-2024	28 days	2 days	✓
<b>Dissolved Metals : Dissolved Metals in Water by CRC ICPMS</b>										
HDPE dissolved (nitric acid) Location 2	E421	20-Aug-2024	22-Aug-2024	180 days	2 days	✓	22-Aug-2024	180 days	2 days	✓
<b>Organic / Inorganic Carbon : Dissolved Organic Carbon by Combustion (Low Level)</b>										
Amber glass dissolved (sulfuric acid) Location 2	E358-L	20-Aug-2024	22-Aug-2024	28 days	2 days	✓	22-Aug-2024	28 days	2 days	✓
<b>Organic / Inorganic Carbon : Total Organic Carbon (Non-Purgeable) by Combustion (Low Level)</b>										
Amber glass total (sulfuric acid) Location 2	E355-L	20-Aug-2024	22-Aug-2024	28 days	2 days	✓	22-Aug-2024	28 days	2 days	✓
<b>Physical Tests : Alkalinity Species by Titration</b>										
HDPE Location 2	E290	20-Aug-2024	22-Aug-2024	14 days	2 days	✓	22-Aug-2024	14 days	2 days	✓
<b>Physical Tests : Colour (True) by Spectrometer (5 CU)</b>										
HDPE Location 2	E329	20-Aug-2024	22-Aug-2024	3 days	2 days	✓	22-Aug-2024	3 days	2 days	✓
<b>Physical Tests : Conductivity in Water</b>										
HDPE Location 2	E100	20-Aug-2024	22-Aug-2024	28 days	2 days	✓	22-Aug-2024	28 days	2 days	✓
<b>Physical Tests : pH by Meter</b>										
HDPE Location 2	E108	20-Aug-2024	22-Aug-2024	0.25 hrs	42 hrs	* EHTR-FM	22-Aug-2024	0.25 hrs	43 hrs	* EHTR-FM



Matrix: **Water** Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis			
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval
				Rec	Actual			Rec	Actual	
<b>Physical Tests : TDS by Gravimetry</b>										
HDPE Location 2	E162	20-Aug-2024	----	----	----		22-Aug-2024	7 days	2 days	✔
<b>Physical Tests : Turbidity by Nephelometry</b>										
HDPE Location 2	E121	20-Aug-2024	----	----	----		23-Aug-2024	3 days	3 days	✔
<b>Physical Tests : UV Absorbance and Transmittance by Spectrometry</b>										
HDPE Location 2	E404	20-Aug-2024	----	----	----		22-Aug-2024	3 days	2 days	✔
<b>Total Metals : Total Mercury in Water by CVAAS</b>										
Glass vial total (hydrochloric acid) Location 2	E508	20-Aug-2024	23-Aug-2024	28 days	2 days	✔	23-Aug-2024	28 days	2 days	✔
<b>Total Metals : Total Metals in Water by CRC ICPMS</b>										
HDPE total (nitric acid) Location 2	E420	20-Aug-2024	22-Aug-2024	180 days	2 days	✔	23-Aug-2024	180 days	3 days	✔
<b>Total Sulfides : Total Sulfide by Colourimetry (Automated Flow)</b>										
HDPE total (zinc acetate+sodium hydroxide) Location 2	E395-H	20-Aug-2024	----	----	----		22-Aug-2024	7 days	2 days	✔

**Legend & Qualifier Definitions**

EHTR-FM: Exceeded ALS recommended hold time prior to sample receipt. Field Measurement recommended  
 Rec. HT: ALS recommended hold time (see units).



## Quality Control Parameter Frequency Compliance

The following report summarizes the frequency of laboratory QC samples analyzed within the analytical batches (QC lots) in which the submitted samples were processed. The actual frequency should be greater than or equal to the expected frequency.

Matrix: **Water** Evaluation: \* = QC frequency outside specification; ✓ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		Evaluation
			QC	Regular	Actual	Expected	
<b>Analytical Methods</b>							
<b>Laboratory Duplicates (DUP)</b>							
Alkalinity Species by Titration	E290	1610252	1	6	16.6	5.0	✓
Bromide in Water by IC (Low Level)	E235.Br-L	1610256	1	1	100.0	5.0	✓
Chloride in Water by IC	E235.Cl	1610255	1	1	100.0	5.0	✓
Colour (True) by Spectrometer (5 CU)	E329	1610265	1	1	100.0	5.0	✓
Conductivity in Water	E100	1610253	1	6	16.6	5.0	✓
Dissolved Mercury in Water by CVAAS	E509	1610588	1	20	5.0	5.0	✓
Dissolved Metals in Water by CRC ICPMS	E421	1609547	1	11	9.0	5.0	✓
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1610145	1	13	7.6	5.0	✓
Fluoride in Water by IC	E235.F	1610254	1	1	100.0	5.0	✓
Methane, Ethane, & Ethene by Headspace GC-FID	E614B	1615772	1	16	6.2	4.5	✓
Nitrate in Water by IC (Low Level)	E235.NO3-L	1610257	1	1	100.0	5.0	✓
Nitrite in Water by IC (Low Level)	E235.NO2-L	1610258	1	6	16.6	5.0	✓
pH by Meter	E108	1610251	1	6	16.6	5.0	✓
Sulfate in Water by IC	E235.SO4	1610259	1	1	100.0	5.0	✓
TDS by Gravimetry	E162	1610230	1	20	5.0	5.0	✓
Total Cyanide	E333	1610563	1	1	100.0	5.0	✓
Total Mercury in Water by CVAAS	E508	1611944	1	20	5.0	5.0	✓
Total Metals in Water by CRC ICPMS	E420	1609548	1	17	5.8	5.0	✓
Total Organic Carbon (Non-Purgeable) by Combustion (Low Level)	E355-L	1610140	1	20	5.0	5.0	✓
Total Sulfide by Colourimetry (Automated Flow)	E395-H	1611320	1	19	5.2	5.0	✓
Turbidity by Nephelometry	E121	1612240	1	20	5.0	5.0	✓
UV Absorbance and Transmittance by Spectrometry	E404	1609793	1	4	25.0	5.0	✓
<b>Laboratory Control Samples (LCS)</b>							
Alkalinity Species by Titration	E290	1610252	1	6	16.6	5.0	✓
Bromide in Water by IC (Low Level)	E235.Br-L	1610256	1	1	100.0	5.0	✓
Chloride in Water by IC	E235.Cl	1610255	1	1	100.0	5.0	✓
Colour (True) by Spectrometer (5 CU)	E329	1610265	1	1	100.0	5.0	✓
Conductivity in Water	E100	1610253	1	6	16.6	5.0	✓
Dissolved Mercury in Water by CVAAS	E509	1610588	1	20	5.0	5.0	✓
Dissolved Metals in Water by CRC ICPMS	E421	1609547	1	11	9.0	5.0	✓
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1610145	1	13	7.6	5.0	✓
Fluoride in Water by IC	E235.F	1610254	1	1	100.0	5.0	✓
Methane, Ethane, & Ethene by Headspace GC-FID	E614B	1615772	1	16	6.2	4.5	✓
Nitrate in Water by IC (Low Level)	E235.NO3-L	1610257	1	1	100.0	5.0	✓
Nitrite in Water by IC (Low Level)	E235.NO2-L	1610258	1	6	16.6	5.0	✓
pH by Meter	E108	1610251	1	6	16.6	5.0	✓





Matrix: **Water**

Evaluation: ✖ = QC frequency outside specification; ✔ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		
			QC	Regular	Actual	Expected	Evaluation
<b>Analytical Methods</b>							
<b>Laboratory Control Samples (LCS) - Continued</b>							
Sulfate in Water by IC	E235.SO4	1610259	1	1	100.0	5.0	✔
TDS by Gravimetry	E162	1610230	1	20	5.0	5.0	✔
Total Cyanide	E333	1610563	1	1	100.0	5.0	✔
Total Mercury in Water by CVAAS	E508	1611944	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1609548	1	17	5.8	5.0	✔
Total Organic Carbon (Non-Purgeable) by Combustion (Low Level)	E355-L	1610140	1	20	5.0	5.0	✔
Total Sulfide by Colourimetry (Automated Flow)	E395-H	1611320	1	19	5.2	5.0	✔
Turbidity by Nephelometry	E121	1612240	1	20	5.0	5.0	✔
UV Absorbance and Transmittance by Spectrometry	E404	1609793	1	4	25.0	5.0	✔
<b>Method Blanks (MB)</b>							
Alkalinity Species by Titration	E290	1610252	1	6	16.6	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1610256	1	1	100.0	5.0	✔
Chloride in Water by IC	E235.Cl	1610255	1	1	100.0	5.0	✔
Colour (True) by Spectrometer (5 CU)	E329	1610265	1	1	100.0	5.0	✔
Conductivity in Water	E100	1610253	1	6	16.6	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1610588	1	20	5.0	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1609547	1	11	9.0	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1610145	1	13	7.6	5.0	✔
Fluoride in Water by IC	E235.F	1610254	1	1	100.0	5.0	✔
Methane, Ethane, & Ethene by Headspace GC-FID	E614B	1615772	1	16	6.2	4.5	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1610257	1	1	100.0	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1610258	1	6	16.6	5.0	✔
Sulfate in Water by IC	E235.SO4	1610259	1	1	100.0	5.0	✔
TDS by Gravimetry	E162	1610230	1	20	5.0	5.0	✔
Total Cyanide	E333	1610563	1	1	100.0	5.0	✔
Total Mercury in Water by CVAAS	E508	1611944	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1609548	1	17	5.8	5.0	✔
Total Organic Carbon (Non-Purgeable) by Combustion (Low Level)	E355-L	1610140	1	20	5.0	5.0	✔
Total Sulfide by Colourimetry (Automated Flow)	E395-H	1611320	1	19	5.2	5.0	✔
Turbidity by Nephelometry	E121	1612240	1	20	5.0	5.0	✔
UV Absorbance and Transmittance by Spectrometry	E404	1609793	1	4	25.0	5.0	✔
<b>Matrix Spikes (MS)</b>							
Bromide in Water by IC (Low Level)	E235.Br-L	1610256	0	1	0.0	5.0	✖
Chloride in Water by IC	E235.Cl	1610255	0	1	0.0	5.0	✖
Dissolved Mercury in Water by CVAAS	E509	1610588	1	20	5.0	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1609547	1	11	9.0	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1610145	1	13	7.6	5.0	✔
Fluoride in Water by IC	E235.F	1610254	0	1	0.0	5.0	✖
Nitrate in Water by IC (Low Level)	E235.NO3-L	1610257	0	1	0.0	5.0	✖



Matrix: **Water** Evaluation: ✘ = QC frequency outside specification; ✔ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		
			QC	Regular	Actual	Expected	Evaluation
<i>Analytical Methods</i>							
<b>Matrix Spikes (MS) - Continued</b>							
Nitrite in Water by IC (Low Level)	E235.NO2-L	1610258	1	6	16.6	5.0	✔
Sulfate in Water by IC	E235.SO4	1610259	0	1	0.0	5.0	✘
Total Cyanide	E333	1610563	0	1	0.0	5.0	✘
Total Mercury in Water by CVAAS	E508	1611944	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1609548	1	17	5.8	5.0	✔
Total Organic Carbon (Non-Purgeable) by Combustion (Low Level)	E355-L	1610140	1	20	5.0	5.0	✔
Total Sulfide by Colourimetry (Automated Flow)	E395-H	1611320	1	19	5.2	5.0	✔



## Methodology References and Summaries

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Reference methods may incorporate modifications to improve performance (indicated by "mod").

Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Conductivity in Water	E100 ALS Environmental - Vancouver	Water	APHA 2510 (mod)	Conductivity, also known as Electrical Conductivity (EC) or Specific Conductance, is measured by immersion of a conductivity cell with platinum electrodes into a water sample. Conductivity measurements are temperature-compensated to 25°C.
pH by Meter	E108 ALS Environmental - Vancouver	Water	APHA 4500-H (mod)	pH is determined by potentiometric measurement with a pH electrode, and is conducted at ambient laboratory temperature (normally 20 ± 5°C). For high accuracy test results, pH should be measured in the field within the recommended 15 minute hold time.
Turbidity by Nephelometry	E121 ALS Environmental - Vancouver	Water	APHA 2130 B (mod)	Turbidity is measured by the nephelometric method, by measuring the intensity of light scatter under defined conditions.
TDS by Gravimetry	E162 ALS Environmental - Vancouver	Water	APHA 2540 C (mod)	Total Dissolved Solids (TDS) are determined by filtering a sample through a glass fibre filter, with evaporation of the filtrate at 180 ± 2°C for 16 hours or to constant weight, with gravimetric measurement of the residue.
Bromide in Water by IC (Low Level)	E235.Br-L ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Chloride in Water by IC	E235.Cl ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Fluoride in Water by IC	E235.F ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Nitrite in Water by IC (Low Level)	E235.NO2-L ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Nitrate in Water by IC (Low Level)	E235.NO3-L ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Sulfate in Water by IC	E235.SO4 ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.



Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Alkalinity Species by Titration	E290 ALS Environmental - Vancouver	Water	APHA 2320 B (mod)	Total alkalinity is determined by potentiometric titration to a pH 4.5 endpoint. Bicarbonate, carbonate and hydroxide alkalinity are calculated from phenolphthalein alkalinity and total alkalinity values.
Colour (True) by Spectrometer (5 CU)	E329 ALS Environmental - Vancouver	Water	APHA 2120 C (mod)	Colour (True Colour) is determined by filtering a sample through a 0.45 micron membrane filter followed by analysis of the filtrate using the platinum-cobalt colourimetric method. Colour measurements can be highly pH dependent, and apply to the pH of the sample as received (at time of testing), without pH adjustment.
Total Cyanide	E333 ALS Environmental - Vancouver	Water	ISO 14403 (mod)	Total or Strong Acid Dissociable (SAD) Cyanide is determined by Continuous Flow Analyzer (CFA) with in-line UV digestion followed by colourimetric analysis.  Method Limitation: High levels of thiocyanate (SCN) may cause positive interference (up to 0.5% of SCN concentration).
Total Organic Carbon (Non-Purgeable) by Combustion (Low Level)	E355-L ALS Environmental - Vancouver	Water	APHA 5310 B (mod)	Total Organic Carbon (Non-Purgeable), also known as NPOC (total), is a direct measurement of TOC after an acidified sample has been purged to remove inorganic carbon (IC). Analysis is by high temperature combustion with infrared detection of CO <sub>2</sub> . NPOC does not include volatile organic species that are purged off with IC. For samples where the majority of total carbon (TC) is comprised of IC (which is common), this method is more accurate and more reliable than the TOC by subtraction method (i.e. TC minus TIC).
Dissolved Organic Carbon by Combustion (Low Level)	E358-L ALS Environmental - Vancouver	Water	APHA 5310 B (mod)	Dissolved Organic Carbon (Non-Purgeable), also known as NPOC (dissolved), is a direct measurement of DOC after a filtered (0.45 micron) sample has been acidified and purged to remove inorganic carbon (IC). Analysis is by high temperature combustion with infrared detection of CO <sub>2</sub> . NPOC does not include volatile organic species that are purged off with IC. For samples where the majority of DC (dissolved carbon) is comprised of IC (which is common), this method is more accurate and more reliable than the DOC by subtraction method (i.e. DC minus DIC).
Total Sulfide by Colourimetry (Automated Flow)	E395-H ALS Environmental - Vancouver	Water	APHA 4500 -S E-Auto-Colorimetry	Sulfide is determined using the gas dialysis automated methylene blue colourimetric method. Results expressed "as H <sub>2</sub> S" if reported represent the maximum possible H <sub>2</sub> S concentration based on the total sulfide concentration in the sample. The H <sub>2</sub> S calculation converts Total Sulphide as (S <sub>2</sub> -) and reports it as Total Sulphide as (H <sub>2</sub> S)
UV Absorbance and Transmittance by Spectrometry	E404 ALS Environmental - Vancouver	Water	APHA 5910 B (mod)	UV Absorbance is determined by first filtering a sample through a 0.45 micron filter, followed by UV absorbance measurement in a quartz cell at 254 nm. The analysis is carried out without pH adjustment.
Total Metals in Water by CRC ICPMS	E420 ALS Environmental - Vancouver	Water	EPA 200.2/6020B (mod)	Water samples are digested with nitric and hydrochloric acids, and analyzed by Collision/Reaction Cell ICPMS.  Method Limitation (re: Sulfur): Sulfide and volatile sulfur species may not be recovered by this method.



Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Dissolved Metals in Water by CRC ICPMS	E421 ALS Environmental - Vancouver	Water	APHA 3030B/EPA 6020B (mod)	Water samples are filtered (0.45 um), preserved with nitric acid, and analyzed by Collision/Reaction Cell ICPMS.  Method Limitation (re: Sulfur): Sulfide and volatile sulfur species may not be recovered by this method.
Total Mercury in Water by CVAAS	E508 ALS Environmental - Vancouver	Water	EPA 1631E (mod)	Water samples undergo a cold-oxidation using bromine monochloride prior to reduction with stannous chloride, and analyzed by CVAAS
Dissolved Mercury in Water by CVAAS	E509 ALS Environmental - Vancouver	Water	APHA 3030B/EPA 1631E (mod)	Water samples are filtered (0.45 um), preserved with HCl, then undergo a cold-oxidation using bromine monochloride prior to reduction with stannous chloride, and analyzed by CVAAS.
Methane, Ethane, & Ethene by Headspace GC-FID	E614B ALS Environmental - Waterloo	Water	EPA REGION 1, NATATTEN.WPD, REV. 1	Volatile hydrocarbons are analyzed by static headspace GC/FID. Samples are prepared in headspace vials and are heated and agitated on the headspace autosampler, causing the analyte(s) to partition between the aqueous phase and the headspace in accordance with Henry's law.
Dissolved Hardness (Calculated)	EC100 ALS Environmental - Vancouver	Water	APHA 2340B	"Hardness (as CaCO3), dissolved" is calculated from the sum of dissolved Calcium and Magnesium concentrations, expressed in CaCO3 equivalents. "Total Hardness" refers to the sum of Calcium and Magnesium Hardness. Hardness is normally or preferentially calculated from dissolved Calcium and Magnesium concentrations, because it is a property of water due to dissolved divalent cations.
Hardness (Calculated) from Total Ca/Mg	EC100A ALS Environmental - Vancouver	Water	APHA 2340B	"Hardness (as CaCO3), from total Ca/Mg" is calculated from the sum of total Calcium and Magnesium concentrations, expressed in CaCO3 equivalents. "Total Hardness" refers to the sum of Calcium and Magnesium Hardness. Hardness is normally or preferentially calculated from dissolved Calcium and Magnesium concentrations, because it is a property of water due to dissolved divalent cations. Hardness from total Ca/Mg is normally comparable to Dissolved Hardness in non-turbid waters.
Methane, Ethane, & Ethene by Headspace GC-FID	EC614B ALS Environmental - Waterloo	Water	Unit Conversion	Convert ppmV to ug/L

Preparation Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Preparation for Total Organic Carbon by Combustion	EP355 ALS Environmental - Vancouver	Water		Preparation for Total Organic Carbon by Combustion
Preparation for Dissolved Organic Carbon for Combustion	EP358 ALS Environmental - Vancouver	Water	APHA 5310 B (mod)	Preparation for Dissolved Organic Carbon
Dissolved Metals Water Filtration	EP421	Water	APHA 3030B	Water samples are filtered (0.45 um), and preserved with HNO3.

Page : 12 of 12  
Work Order : FJ2402491  
Client : Tetra Tech Canada Inc.  
Project : 704.ENV.GENV 03704-02



<i>Preparation Methods</i>	<i>Method / Lab</i>	<i>Matrix</i>	<i>Method Reference</i>	<i>Method Descriptions</i>
	ALS Environmental - Vancouver			
Dissolved Mercury Water Filtration	EP509	Water	APHA 3030B	Water samples are filtered (0.45 um), and preserved with HCl.
	ALS Environmental - Vancouver			

## QUALITY CONTROL REPORT

<b>Work Order</b>	<b>: FJ2402491</b>	<b>Page</b>	: 1 of 17
<b>Client</b>	: Tetra Tech Canada Inc.	<b>Laboratory</b>	: ALS Environmental - Fort St. John
<b>Contact</b>	: Andrea McMillan	<b>Account Manager</b>	: Wendy Sears
<b>Address</b>	: 110, 140 Quarry Park Blvd SE Calgary AB Canada T2C 3G3	<b>Address</b>	: 11007 Alaska Road Fort St. John, British Columbia Canada V1J 6P3
<b>Telephone</b>	: ----	<b>Telephone</b>	: +1 250 261 5517
<b>Project</b>	: 704.ENV.GENV 03704-02	<b>Date Samples Received</b>	: 21-Aug-2024 09:00
<b>PO</b>	: ----	<b>Date Analysis Commenced</b>	: 22-Aug-2024
<b>C-O-C number</b>	: 20-964332	<b>Issue Date</b>	: 26-Aug-2024 18:23
<b>Sampler</b>	: Fahim Nazari		
<b>Site</b>	: ----		
<b>Quote number</b>	: VA24-EBAE100-013		
<b>No. of samples received</b>	: 1		
<b>No. of samples analysed</b>	: 1		

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Quality Control Report contains the following information:

- Laboratory Duplicate (DUP) Report; Relative Percent Difference (RPD) and Data Quality Objectives
- Matrix Spike (MS) Report; Recovery and Data Quality Objectives
- Method Blank (MB) Report; Recovery and Data Quality Objectives
- Laboratory Control Sample (LCS) Report; Recovery and Data Quality Objectives

### Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

<i>Signatories</i>	<i>Position</i>	<i>Laboratory Department</i>
Andrea Armstrong	Department Manager - Air Quality and Volatiles	Waterloo Air Quality, Waterloo, Ontario
Angela Ren	Team Leader - Metals	Vancouver Metals, Burnaby, British Columbia
Ilnaz Badbezanchi	Supervisor - Metals Prep & Mercury	Vancouver Metals, Burnaby, British Columbia
Kate Dimitrova	Supervisor - Inorganic	Vancouver Inorganics, Burnaby, British Columbia
Manpreet Cheema	Lab Assistant	Vancouver Metals, Burnaby, British Columbia
Maya Urquhart	Lab Analyst	Vancouver Metals, Burnaby, British Columbia
Owen Cheng		Vancouver Metals, Burnaby, British Columbia

Page : 2 of 17  
Work Order : FJ2402491  
Client : Tetra Tech Canada Inc.  
Project : 704.ENV.GENV 03704-02



---

## General Comments

The ALS Quality Control (QC) report is optionally provided to ALS clients upon request. ALS test methods include comprehensive QC checks with every analysis to ensure our high standards of quality are met. Each QC result has a known or expected target value, which is compared against predetermined Data Quality Objectives (DQOs) to provide confidence in the accuracy of associated test results. This report contains detailed results for all QC results applicable to this sample submission. Please refer to the ALS Quality Control Interpretation report (QCI) for applicable method references and methodology summaries.

Key :

Anonymous = Refers to samples which are not part of this work order, but which formed part of the QC process lot.

CAS Number = Chemical Abstracts Service number is a unique identifier assigned to discrete substances.

DQO = Data Quality Objective.

LOR = Limit of Reporting (detection limit).

RPD = Relative Percent Difference

# = Indicates a QC result that did not meet the ALS DQO.

---

## Workorder Comments

Holding times are displayed as "---" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

---





### Laboratory Duplicate (DUP) Report

A Laboratory Duplicate (DUP) is a randomly selected intralaboratory replicate sample. Laboratory Duplicates provide information regarding method precision and sample heterogeneity. ALS DQOs for Laboratory Duplicates are expressed as test-specific limits for Relative Percent Difference (RPD), or as an absolute difference limit of 2 times the LOR for low concentration duplicates within ~ 4-10 times the LOR (cut-off is test-specific).

Sub-Matrix: <b>Water</b>					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
<b>Physical Tests (QC Lot: 1609793)</b>											
FJ2402491-001	Location 2	Absorbance, UV (@ 254nm)	----	E404	0.0050	AU/cm	0.141	0.141	0.00%	20%	----
<b>Physical Tests (QC Lot: 1610230)</b>											
KS2403260-001	Anonymous	Solids, total dissolved [TDS]	----	E162	13	mg/L	56	55	1	Diff <2x LOR	----
<b>Physical Tests (QC Lot: 1610251)</b>											
VA24C1137-003	Anonymous	pH	----	E108	0.10	pH units	5.53	5.48	0.908%	4%	----
<b>Physical Tests (QC Lot: 1610252)</b>											
VA24C1137-003	Anonymous	Alkalinity, bicarbonate (as CaCO3)	----	E290	1.0	mg/L	<1.0	<1.0	0.00%	200%	----
		Alkalinity, carbonate (as CaCO3)	----	E290	1.0	mg/L	<1.0	<1.0	0.00%	200%	----
		Alkalinity, hydroxide (as CaCO3)	----	E290	1.0	mg/L	<1.0	<1.0	0.00%	200%	----
		Alkalinity, phenolphthalein (as CaCO3)	----	E290	1.0	mg/L	<1.0	<1.0	0	Diff <2x LOR	----
		Alkalinity, total (as CaCO3)	----	E290	2.0	mg/L	<2.0	<2.0	0	Diff <2x LOR	----
<b>Physical Tests (QC Lot: 1610253)</b>											
VA24C1137-003	Anonymous	Conductivity	----	E100	1.0	µS/cm	1.0	<1.0	0.05	Diff <2x LOR	----
<b>Physical Tests (QC Lot: 1610265)</b>											
FJ2402491-001	Location 2	Colour, true	----	E329	5.0	CU	5.8	5.9	0.1	Diff <2x LOR	----
<b>Physical Tests (QC Lot: 1612240)</b>											
KS2403379-001	Anonymous	Turbidity	----	E121	0.10	NTU	0.90	1.01	0.11	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1610254)</b>											
FJ2402491-001	Location 2	Fluoride	16984-48-8	E235.F	0.100	mg/L	0.478	0.475	0.002	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1610255)</b>											
FJ2402491-001	Location 2	Chloride	16887-00-6	E235.Cl	2.50	mg/L	19.0	19.0	0.06	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1610256)</b>											
FJ2402491-001	Location 2	Bromide	24959-67-9	E235.Br-L	0.250	mg/L	<0.250	<0.250	0	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1610257)</b>											
FJ2402491-001	Location 2	Nitrate (as N)	14797-55-8	E235.NO3-L	0.0250	mg/L	0.0412	0.0415	0.0003	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1610258)</b>											
FJ2402491-001	Location 2	Nitrite (as N)	14797-65-0	E235.NO2-L	0.0050	mg/L	<0.0050	<0.0050	0	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1610259)</b>											
FJ2402491-001	Location 2	Sulfate (as SO4)	14808-79-8	E235.SO4	1.50	mg/L	12.7	12.5	0.16	Diff <2x LOR	----



Sub-Matrix: Water					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
<b>Cyanides (QC Lot: 1610563)</b>											
FJ2402491-001	Location 2	Cyanide, strong acid dissociable (Total)	----	E333	0.0050	mg/L	<0.0050	<0.0050	0	Diff <2x LOR	----
<b>Organic / Inorganic Carbon (QC Lot: 1610140)</b>											
FJ2402449-003	Anonymous	Carbon, total organic [TOC]	----	E355-L	0.50	mg/L	2.61	2.74	0.13	Diff <2x LOR	----
<b>Organic / Inorganic Carbon (QC Lot: 1610145)</b>											
FJ2402450-001	Anonymous	Carbon, dissolved organic [DOC]	----	E358-L	0.50	mg/L	2.84	2.99	0.15	Diff <2x LOR	----
<b>Total Sulfides (QC Lot: 1611320)</b>											
FJ2402451-001	Anonymous	Sulfide, total (as S)	18496-25-8	E395-H	0.010	mg/L	<0.010	<0.010	0	Diff <2x LOR	----
<b>Total Metals (QC Lot: 1609548)</b>											
FJ2402491-001	Location 2	Aluminum, total	7429-90-5	E420	0.0150	mg/L	72.3	74.5	3.08%	20%	----
		Antimony, total	7440-36-0	E420	0.00050	mg/L	0.00168	0.00176	0.00007	Diff <2x LOR	----
		Arsenic, total	7440-38-2	E420	0.00050	mg/L	0.0325	0.0354	8.46%	20%	----
		Barium, total	7440-39-3	E420	0.00050	mg/L	9.27	9.52	2.71%	20%	----
		Beryllium, total	7440-41-7	E420	0.000100	mg/L	0.00583	0.00606	3.80%	20%	----
		Bismuth, total	7440-69-9	E420	0.000250	mg/L	0.00136	0.00137	0.000016	Diff <2x LOR	----
		Boron, total	7440-42-8	E420	0.050	mg/L	0.284	0.294	0.010	Diff <2x LOR	----
		Cadmium, total	7440-43-9	E420	0.0000250	mg/L	0.0147	0.0147	0.0129%	20%	----
		Calcium, total	7440-70-2	E420	0.250	mg/L	32.5	33.2	2.17%	20%	----
		Cesium, total	7440-46-2	E420	0.000050	mg/L	0.0161	0.0158	1.33%	20%	----
		Chromium, total	7440-47-3	E420	0.00250	mg/L	0.194	0.198	2.37%	20%	----
		Cobalt, total	7440-48-4	E420	0.00050	mg/L	0.0891	0.0909	1.96%	20%	----
		Copper, total	7440-50-8	E420	0.00250	mg/L	0.295	0.299	1.33%	20%	----
		Iron, total	7439-89-6	E420	0.050	mg/L	274	287	4.42%	20%	----
		Lead, total	7439-92-1	E420	0.000250	mg/L	0.102	0.100	1.13%	20%	----
		Lithium, total	7439-93-2	E420	0.0050	mg/L	0.119	0.127	6.33%	20%	----
		Magnesium, total	7439-95-4	E420	0.0250	mg/L	35.5	35.7	0.636%	20%	----
		Manganese, total	7439-96-5	E420	0.00050	mg/L	4.59	4.70	2.39%	20%	----
		Molybdenum, total	7439-98-7	E420	0.000250	mg/L	0.00922	0.0106	13.9%	20%	----
		Nickel, total	7440-02-0	E420	0.00250	mg/L	0.328	0.332	1.07%	20%	----
Phosphorus, total	7723-14-0	E420	0.250	mg/L	4.07	3.86	5.44%	20%	----		
Potassium, total	7440-09-7	E420	0.250	mg/L	14.4	14.7	1.90%	20%	----		
Rubidium, total	7440-17-7	E420	0.00100	mg/L	0.0972	0.0986	1.42%	20%	----		
Selenium, total	7782-49-2	E420	0.000250	mg/L	0.00438	0.00529	18.9%	20%	----		
Silicon, total	7440-21-3	E420	0.50	mg/L	87.2	92.8	6.19%	20%	----		
Silver, total	7440-22-4	E420	0.000050	mg/L	0.00359	0.00347	3.58%	20%	----		



Sub-Matrix: **Water**

Laboratory Duplicate (DUP) Report

Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
<b>Total Metals (QC Lot: 1609548) - continued</b>											
FJ2402491-001	Location 2	Sodium, total	7440-23-5	E420	0.250	mg/L	232	233	0.703%	20%	---
		Strontium, total	7440-24-6	E420	0.00100	mg/L	0.528	0.505	4.33%	20%	---
		Sulfur, total	7704-34-9	E420	2.50	mg/L	14.0	13.7	0.29	Diff <2x LOR	---
		Tellurium, total	13494-80-9	E420	0.00100	mg/L	<0.00100	<0.00100	0	Diff <2x LOR	---
		Thallium, total	7440-28-0	E420	0.000050	mg/L	0.00135	0.00133	1.57%	20%	---
		Thorium, total	7440-29-1	E420	0.00050	mg/L	0.0348	0.0353	1.24%	20%	---
		Tin, total	7440-31-5	E420	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	---
		Titanium, total	7440-32-6	E420	0.00150	mg/L	0.107	0.115	6.95%	20%	---
		Tungsten, total	7440-33-7	E420	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	---
		Uranium, total	7440-61-1	E420	0.000050	mg/L	0.0107	0.0106	1.09%	20%	---
		Vanadium, total	7440-62-2	E420	0.00250	mg/L	0.233	0.242	3.68%	20%	---
		Zinc, total	7440-66-6	E420	0.0150	mg/L	1.03	1.04	0.726%	20%	---
		Zirconium, total	7440-67-7	E420	0.00100	mg/L	<0.00100	<0.00100	0	Diff <2x LOR	---
<b>Total Metals (QC Lot: 1611944)</b>											
FJ2402413-003	Anonymous	Mercury, total	7439-97-6	E508	0.0000050	mg/L	<0.0000050	<0.0000050	0	Diff <2x LOR	---
<b>Dissolved Metals (QC Lot: 1609547)</b>											
FJ2402491-001	Location 2	Aluminum, dissolved	7429-90-5	E421	0.0010	mg/L	0.136	0.145	6.22%	20%	---
		Antimony, dissolved	7440-36-0	E421	0.00010	mg/L	0.00206	0.00208	1.08%	20%	---
		Arsenic, dissolved	7440-38-2	E421	0.00010	mg/L	0.00114	0.00114	0.258%	20%	---
		Barium, dissolved	7440-39-3	E421	0.00010	mg/L	0.352	0.370	4.89%	20%	---
		Beryllium, dissolved	7440-41-7	E421	0.000100	mg/L	<0.000100	<0.000100	0	Diff <2x LOR	---
		Bismuth, dissolved	7440-69-9	E421	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	---
		Boron, dissolved	7440-42-8	E421	0.010	mg/L	0.240	0.234	2.50%	20%	---
		Cadmium, dissolved	7440-43-9	E421	0.0000050	mg/L	0.0000186	0.0000186	0.00000001	Diff <2x LOR	---
		Calcium, dissolved	7440-70-2	E421	0.050	mg/L	7.60	7.49	1.52%	20%	---
		Cesium, dissolved	7440-46-2	E421	0.000010	mg/L	0.000057	0.000062	0.000005	Diff <2x LOR	---
		Chromium, dissolved	7440-47-3	E421	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	---
		Cobalt, dissolved	7440-48-4	E421	0.00010	mg/L	0.00042	0.00042	0.000003	Diff <2x LOR	---
		Copper, dissolved	7440-50-8	E421	0.00020	mg/L	0.00053	0.00052	0.000009	Diff <2x LOR	---
		Iron, dissolved	7439-89-6	E421	0.010	mg/L	0.174	0.173	0.954%	20%	---
		Lead, dissolved	7439-92-1	E421	0.000050	mg/L	0.000073	0.000074	0.0000005	Diff <2x LOR	---
		Lithium, dissolved	7439-93-2	E421	0.0010	mg/L	0.0068	0.0068	0.00003	Diff <2x LOR	---
		Magnesium, dissolved	7439-95-4	E421	0.0050	mg/L	5.39	5.19	3.78%	20%	---
		Manganese, dissolved	7439-96-5	E421	0.00010	mg/L	0.141	0.139	1.58%	20%	---



Sub-Matrix: Water					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
<b>Dissolved Metals (QC Lot: 1609547) - continued</b>											
FJ2402491-001	Location 2	Molybdenum, dissolved	7439-98-7	E421	0.000050	mg/L	0.0192	0.0197	2.72%	20%	----
		Nickel, dissolved	7440-02-0	E421	0.000050	mg/L	0.00347	0.00354	0.00006	Diff <2x LOR	----
		Phosphorus, dissolved	7723-14-0	E421	0.050	mg/L	<0.050	<0.050	0	Diff <2x LOR	----
		Potassium, dissolved	7440-09-7	E421	0.050	mg/L	5.18	5.29	2.23%	20%	----
		Rubidium, dissolved	7440-17-7	E421	0.00020	mg/L	0.00188	0.00195	0.00007	Diff <2x LOR	----
		Selenium, dissolved	7782-49-2	E421	0.000050	mg/L	0.000941	0.000890	5.60%	20%	----
		Silicon, dissolved	7440-21-3	E421	0.050	mg/L	2.04	1.95	4.65%	20%	----
		Silver, dissolved	7440-22-4	E421	0.000010	mg/L	<0.000010	<0.000010	0	Diff <2x LOR	----
		Sodium, dissolved	7440-23-5	E421	0.050	mg/L	244	239	1.80%	20%	----
		Strontium, dissolved	7440-24-6	E421	0.00020	mg/L	0.150	0.149	0.394%	20%	----
		Sulfur, dissolved	7704-34-9	E421	0.50	mg/L	11.0	10.6	3.68%	20%	----
		Tellurium, dissolved	13494-80-9	E421	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	----
		Thallium, dissolved	7440-28-0	E421	0.000010	mg/L	<0.000010	<0.000010	0	Diff <2x LOR	----
		Thorium, dissolved	7440-29-1	E421	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Tin, dissolved	7440-31-5	E421	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Titanium, dissolved	7440-32-6	E421	0.00030	mg/L	0.00527	0.00468	11.7%	20%	----
		Tungsten, dissolved	7440-33-7	E421	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Uranium, dissolved	7440-61-1	E421	0.000010	mg/L	0.00263	0.00264	0.380%	20%	----
		Vanadium, dissolved	7440-62-2	E421	0.00050	mg/L	0.00059	0.00058	0.00001	Diff <2x LOR	----
		Zinc, dissolved	7440-66-6	E421	0.0010	mg/L	0.0020	0.0018	0.0001	Diff <2x LOR	----
		Zirconium, dissolved	7440-67-7	E421	0.00020	mg/L	<0.00020	0.00032	0.00012	Diff <2x LOR	----
<b>Dissolved Metals (QC Lot: 1610588)</b>											
FJ2402491-001	Location 2	Mercury, dissolved	7439-97-6	E509	0.0000050	mg/L	<0.0000050	<0.0000050	0	Diff <2x LOR	----
<b>Dissolved Gases (QC Lot: 1615772)</b>											
FJ2402491-001	Location 2	Methane	74-82-8	E614B	20.8	ppmv	43.6	43.6	0	Diff <2x LOR	----



## Method Blank (MB) Report

A Method Blank is an analyte-free matrix that undergoes sample processing identical to that carried out for test samples. Method Blank results are used to monitor and control for potential contamination from the laboratory environment and reagents. For most tests, the DQO for Method Blanks is for the result to be < LOR.

Sub-Matrix: Water

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
<b>Physical Tests (QCLot: 1609793)</b>						
Absorbance, UV (@ 254nm)	---	E404	0.005	AU/cm	<0.0050	---
<b>Physical Tests (QCLot: 1610230)</b>						
Solids, total dissolved [TDS]	---	E162	10	mg/L	<10	---
<b>Physical Tests (QCLot: 1610252)</b>						
Alkalinity, bicarbonate (as CaCO3)	---	E290	1	mg/L	<1.0	---
Alkalinity, carbonate (as CaCO3)	---	E290	1	mg/L	<1.0	---
Alkalinity, hydroxide (as CaCO3)	---	E290	1	mg/L	<1.0	---
Alkalinity, phenolphthalein (as CaCO3)	---	E290	1	mg/L	<1.0	---
Alkalinity, total (as CaCO3)	---	E290	1	mg/L	<1.0	---
<b>Physical Tests (QCLot: 1610253)</b>						
Conductivity	---	E100	1	µS/cm	1.1	---
<b>Physical Tests (QCLot: 1610265)</b>						
Colour, true	---	E329	5	CU	<5.0	---
<b>Physical Tests (QCLot: 1612240)</b>						
Turbidity	---	E121	0.1	NTU	<0.10	---
<b>Anions and Nutrients (QCLot: 1610254)</b>						
Fluoride	16984-48-8	E235.F	0.02	mg/L	<0.020	---
<b>Anions and Nutrients (QCLot: 1610255)</b>						
Chloride	16887-00-6	E235.Cl	0.5	mg/L	<0.50	---
<b>Anions and Nutrients (QCLot: 1610256)</b>						
Bromide	24959-67-9	E235.Br-L	0.05	mg/L	<0.050	---
<b>Anions and Nutrients (QCLot: 1610257)</b>						
Nitrate (as N)	14797-55-8	E235.NO3-L	0.005	mg/L	<0.0050	---
<b>Anions and Nutrients (QCLot: 1610258)</b>						
Nitrite (as N)	14797-65-0	E235.NO2-L	0.001	mg/L	<0.0010	---
<b>Anions and Nutrients (QCLot: 1610259)</b>						
Sulfate (as SO4)	14808-79-8	E235.SO4	0.3	mg/L	<0.30	---
<b>Cyanides (QCLot: 1610563)</b>						
Cyanide, strong acid dissociable (Total)	---	E333	0.002	mg/L	<0.0020	---
<b>Organic / Inorganic Carbon (QCLot: 1610140)</b>						
Carbon, total organic [TOC]	---	E355-L	0.5	mg/L	<0.50	---
<b>Organic / Inorganic Carbon (QCLot: 1610145)</b>						



Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
<b>Organic / Inorganic Carbon (QCLot: 1610145) - continued</b>						
Carbon, dissolved organic [DOC]	---	E358-L	0.5	mg/L	<0.50	---
<b>Total Sulfides (QCLot: 1611320)</b>						
Sulfide, total (as S)	18496-25-8	E395-H	0.01	mg/L	<0.010	---
<b>Total Metals (QCLot: 1609548)</b>						
Aluminum, total	7429-90-5	E420	0.003	mg/L	<0.0030	---
Antimony, total	7440-36-0	E420	0.0001	mg/L	<0.00010	---
Arsenic, total	7440-38-2	E420	0.0001	mg/L	<0.00010	---
Barium, total	7440-39-3	E420	0.0001	mg/L	<0.00010	---
Beryllium, total	7440-41-7	E420	0.00002	mg/L	<0.000020	---
Bismuth, total	7440-69-9	E420	0.00005	mg/L	<0.000050	---
Boron, total	7440-42-8	E420	0.01	mg/L	<0.010	---
Cadmium, total	7440-43-9	E420	0.000005	mg/L	<0.0000050	---
Calcium, total	7440-70-2	E420	0.05	mg/L	<0.050	---
Cesium, total	7440-46-2	E420	0.00001	mg/L	<0.000010	---
Chromium, total	7440-47-3	E420	0.0005	mg/L	<0.00050	---
Cobalt, total	7440-48-4	E420	0.0001	mg/L	<0.00010	---
Copper, total	7440-50-8	E420	0.0005	mg/L	<0.00050	---
Iron, total	7439-89-6	E420	0.01	mg/L	<0.010	---
Lead, total	7439-92-1	E420	0.00005	mg/L	<0.000050	---
Lithium, total	7439-93-2	E420	0.001	mg/L	<0.0010	---
Magnesium, total	7439-95-4	E420	0.005	mg/L	<0.0050	---
Manganese, total	7439-96-5	E420	0.0001	mg/L	<0.00010	---
Molybdenum, total	7439-98-7	E420	0.00005	mg/L	<0.000050	---
Nickel, total	7440-02-0	E420	0.0005	mg/L	<0.00050	---
Phosphorus, total	7723-14-0	E420	0.05	mg/L	<0.050	---
Potassium, total	7440-09-7	E420	0.05	mg/L	<0.050	---
Rubidium, total	7440-17-7	E420	0.0002	mg/L	<0.00020	---
Selenium, total	7782-49-2	E420	0.00005	mg/L	<0.000050	---
Silicon, total	7440-21-3	E420	0.1	mg/L	<0.10	---
Silver, total	7440-22-4	E420	0.00001	mg/L	<0.000010	---
Sodium, total	7440-23-5	E420	0.05	mg/L	<0.050	---
Strontium, total	7440-24-6	E420	0.0002	mg/L	<0.00020	---
Sulfur, total	7704-34-9	E420	0.5	mg/L	<0.50	---
Tellurium, total	13494-80-9	E420	0.0002	mg/L	<0.00020	---
Thallium, total	7440-28-0	E420	0.00001	mg/L	<0.000010	---



Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
<b>Total Metals (QCLot: 1609548) - continued</b>						
Thorium, total	7440-29-1	E420	0.0001	mg/L	<0.00010	----
Tin, total	7440-31-5	E420	0.0001	mg/L	<0.00010	----
Titanium, total	7440-32-6	E420	0.0003	mg/L	<0.00030	----
Tungsten, total	7440-33-7	E420	0.0001	mg/L	<0.00010	----
Uranium, total	7440-61-1	E420	0.00001	mg/L	<0.000010	----
Vanadium, total	7440-62-2	E420	0.0005	mg/L	<0.00050	----
Zinc, total	7440-66-6	E420	0.003	mg/L	<0.0030	----
Zirconium, total	7440-67-7	E420	0.0002	mg/L	<0.00020	----
<b>Total Metals (QCLot: 1611944)</b>						
Mercury, total	7439-97-6	E508	0.000005	mg/L	<0.0000050	----
<b>Dissolved Metals (QCLot: 1609547)</b>						
Aluminum, dissolved	7429-90-5	E421	0.001	mg/L	<0.0010	----
Antimony, dissolved	7440-36-0	E421	0.0001	mg/L	<0.00010	----
Arsenic, dissolved	7440-38-2	E421	0.0001	mg/L	<0.00010	----
Barium, dissolved	7440-39-3	E421	0.0001	mg/L	<0.00010	----
Beryllium, dissolved	7440-41-7	E421	0.00002	mg/L	<0.000020	----
Bismuth, dissolved	7440-69-9	E421	0.00005	mg/L	<0.000050	----
Boron, dissolved	7440-42-8	E421	0.01	mg/L	<0.010	----
Cadmium, dissolved	7440-43-9	E421	0.000005	mg/L	<0.0000050	----
Calcium, dissolved	7440-70-2	E421	0.05	mg/L	<0.050	----
Cesium, dissolved	7440-46-2	E421	0.00001	mg/L	<0.000010	----
Chromium, dissolved	7440-47-3	E421	0.0005	mg/L	<0.00050	----
Cobalt, dissolved	7440-48-4	E421	0.0001	mg/L	<0.00010	----
Copper, dissolved	7440-50-8	E421	0.0002	mg/L	<0.00020	----
Iron, dissolved	7439-89-6	E421	0.01	mg/L	<0.010	----
Lead, dissolved	7439-92-1	E421	0.00005	mg/L	<0.000050	----
Lithium, dissolved	7439-93-2	E421	0.001	mg/L	<0.0010	----
Magnesium, dissolved	7439-95-4	E421	0.005	mg/L	<0.0050	----
Manganese, dissolved	7439-96-5	E421	0.0001	mg/L	<0.00010	----
Molybdenum, dissolved	7439-98-7	E421	0.00005	mg/L	<0.000050	----
Nickel, dissolved	7440-02-0	E421	0.0005	mg/L	<0.00050	----
Phosphorus, dissolved	7723-14-0	E421	0.05	mg/L	<0.050	----
Potassium, dissolved	7440-09-7	E421	0.05	mg/L	<0.050	----
Rubidium, dissolved	7440-17-7	E421	0.0002	mg/L	<0.00020	----
Selenium, dissolved	7782-49-2	E421	0.00005	mg/L	<0.000050	----



Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
<b>Dissolved Metals (QCLot: 1609547) - continued</b>						
Silicon, dissolved	7440-21-3	E421	0.05	mg/L	<0.050	----
Silver, dissolved	7440-22-4	E421	0.00001	mg/L	<0.000010	----
Sodium, dissolved	7440-23-5	E421	0.05	mg/L	<0.050	----
Strontium, dissolved	7440-24-6	E421	0.0002	mg/L	<0.00020	----
Sulfur, dissolved	7704-34-9	E421	0.5	mg/L	<0.50	----
Tellurium, dissolved	13494-80-9	E421	0.0002	mg/L	<0.00020	----
Thallium, dissolved	7440-28-0	E421	0.00001	mg/L	<0.000010	----
Thorium, dissolved	7440-29-1	E421	0.0001	mg/L	<0.00010	----
Tin, dissolved	7440-31-5	E421	0.0001	mg/L	<0.00010	----
Titanium, dissolved	7440-32-6	E421	0.0003	mg/L	<0.00030	----
Tungsten, dissolved	7440-33-7	E421	0.0001	mg/L	<0.00010	----
Uranium, dissolved	7440-61-1	E421	0.00001	mg/L	<0.000010	----
Vanadium, dissolved	7440-62-2	E421	0.0005	mg/L	<0.00050	----
Zinc, dissolved	7440-66-6	E421	0.001	mg/L	<0.0010	----
Zirconium, dissolved	7440-67-7	E421	0.0002	mg/L	<0.00020	----
<b>Dissolved Metals (QCLot: 1610588)</b>						
Mercury, dissolved	7439-97-6	E509	0.000005	mg/L	<0.0000050	----
<b>Dissolved Gases (QCLot: 1615772)</b>						
Methane	74-82-8	E614B	20.77	ppmv	<20.8	----





## Laboratory Control Sample (LCS) Report

A Laboratory Control Sample (LCS) is an analyte-free matrix that has been fortified (spiked) with test analytes at known concentration and processed in an identical manner to test samples. LCS results are expressed as percent recovery, and are used to monitor and control test method accuracy and precision, independent of test sample matrix.

Sub-Matrix: Water

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
<b>Physical Tests (QCLot: 1609793)</b>									
Absorbance, UV (@ 254nm)	---	E404	0.005	AU/cm	0.693 AU/cm	93.9	85.0	115	---
Transmittance, UV (@ 254nm)	---	E404	---	% T/cm	20.3 % T/cm	110	85.0	115	---
<b>Physical Tests (QCLot: 1610230)</b>									
Solids, total dissolved [TDS]	---	E162	10	mg/L	1000 mg/L	102	85.0	115	---
<b>Physical Tests (QCLot: 1610251)</b>									
pH	---	E108	---	pH units	7 pH units	100	98.0	102	---
<b>Physical Tests (QCLot: 1610252)</b>									
Alkalinity, phenolphthalein (as CaCO <sub>3</sub> )	---	E290	1	mg/L	229 mg/L	94.9	75.0	125	---
Alkalinity, total (as CaCO <sub>3</sub> )	---	E290	1	mg/L	500 mg/L	104	85.0	115	---
<b>Physical Tests (QCLot: 1610253)</b>									
Conductivity	---	E100	1	µS/cm	147 µS/cm	97.6	90.0	110	---
<b>Physical Tests (QCLot: 1610265)</b>									
Colour, true	---	E329	5	CU	100 CU	105	85.0	115	---
<b>Physical Tests (QCLot: 1612240)</b>									
Turbidity	---	E121	0.1	NTU	200 NTU	96.5	85.0	115	---
<b>Anions and Nutrients (QCLot: 1610254)</b>									
Fluoride	16984-48-8	E235.F	0.02	mg/L	1 mg/L	101	90.0	110	---
<b>Anions and Nutrients (QCLot: 1610255)</b>									
Chloride	16887-00-6	E235.Cl	0.5	mg/L	100 mg/L	102	90.0	110	---
<b>Anions and Nutrients (QCLot: 1610256)</b>									
Bromide	24959-67-9	E235.Br-L	0.05	mg/L	0.5 mg/L	103	85.0	115	---
<b>Anions and Nutrients (QCLot: 1610257)</b>									
Nitrate (as N)	14797-55-8	E235.NO3-L	0.005	mg/L	2.5 mg/L	102	90.0	110	---
<b>Anions and Nutrients (QCLot: 1610258)</b>									
Nitrite (as N)	14797-65-0	E235.NO2-L	0.001	mg/L	0.5 mg/L	102	90.0	110	---
<b>Anions and Nutrients (QCLot: 1610259)</b>									
Sulfate (as SO <sub>4</sub> )	14808-79-8	E235.SO4	0.3	mg/L	100 mg/L	103	90.0	110	---
<b>Cyanides (QCLot: 1610563)</b>									
Cyanide, strong acid dissociable (Total)	---	E333	0.002	mg/L	0.25 mg/L	96.7	80.0	120	---



Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
<b>Organic / Inorganic Carbon (QCLot: 1610140)</b>									
Carbon, total organic [TOC]	---	E355-L	0.5	mg/L	8.57 mg/L	99.6	80.0	120	---
<b>Organic / Inorganic Carbon (QCLot: 1610145)</b>									
Carbon, dissolved organic [DOC]	---	E358-L	0.5	mg/L	8.57 mg/L	96.2	80.0	120	---
<b>Total Sulfides (QCLot: 1611320)</b>									
Sulfide, total (as H2S)	7783-06-4	E395-H	---	mg/L	0.085 mg/L	106	80.0	120	---
Sulfide, total (as S)	18496-25-8	E395-H	0.01	mg/L	0.08 mg/L	107	80.0	120	---
<b>Total Metals (QCLot: 1609548)</b>									
Aluminum, total	7429-90-5	E420	0.003	mg/L	2 mg/L	99.2	80.0	120	---
Antimony, total	7440-36-0	E420	0.0001	mg/L	1 mg/L	107	80.0	120	---
Arsenic, total	7440-38-2	E420	0.0001	mg/L	1 mg/L	106	80.0	120	---
Barium, total	7440-39-3	E420	0.0001	mg/L	0.25 mg/L	108	80.0	120	---
Beryllium, total	7440-41-7	E420	0.00002	mg/L	0.1 mg/L	98.9	80.0	120	---
Bismuth, total	7440-69-9	E420	0.00005	mg/L	1 mg/L	97.9	80.0	120	---
Boron, total	7440-42-8	E420	0.01	mg/L	1 mg/L	94.4	80.0	120	---
Cadmium, total	7440-43-9	E420	0.000005	mg/L	0.1 mg/L	99.8	80.0	120	---
Calcium, total	7440-70-2	E420	0.05	mg/L	50 mg/L	99.1	80.0	120	---
Cesium, total	7440-46-2	E420	0.00001	mg/L	0.05 mg/L	99.5	80.0	120	---
Chromium, total	7440-47-3	E420	0.0005	mg/L	0.25 mg/L	99.6	80.0	120	---
Cobalt, total	7440-48-4	E420	0.0001	mg/L	0.25 mg/L	98.7	80.0	120	---
Copper, total	7440-50-8	E420	0.0005	mg/L	0.25 mg/L	97.4	80.0	120	---
Iron, total	7439-89-6	E420	0.01	mg/L	1 mg/L	95.6	80.0	120	---
Lead, total	7439-92-1	E420	0.00005	mg/L	0.5 mg/L	97.0	80.0	120	---
Lithium, total	7439-93-2	E420	0.001	mg/L	0.25 mg/L	95.0	80.0	120	---
Magnesium, total	7439-95-4	E420	0.005	mg/L	50 mg/L	96.3	80.0	120	---
Manganese, total	7439-96-5	E420	0.0001	mg/L	0.25 mg/L	100	80.0	120	---
Molybdenum, total	7439-98-7	E420	0.00005	mg/L	0.25 mg/L	106	80.0	120	---
Nickel, total	7440-02-0	E420	0.0005	mg/L	0.5 mg/L	99.0	80.0	120	---
Phosphorus, total	7723-14-0	E420	0.05	mg/L	10 mg/L	102	80.0	120	---
Potassium, total	7440-09-7	E420	0.05	mg/L	50 mg/L	100	80.0	120	---
Rubidium, total	7440-17-7	E420	0.0002	mg/L	0.1 mg/L	99.7	80.0	120	---
Selenium, total	7782-49-2	E420	0.00005	mg/L	1 mg/L	105	80.0	120	---
Silicon, total	7440-21-3	E420	0.1	mg/L	10 mg/L	115	80.0	120	---
Silver, total	7440-22-4	E420	0.00001	mg/L	0.1 mg/L	95.4	80.0	120	---
Sodium, total	7440-23-5	E420	0.05	mg/L	50 mg/L	106	80.0	120	---



Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
<b>Total Metals (QCLot: 1609548) - continued</b>									
Strontium, total	7440-24-6	E420	0.0002	mg/L	0.25 mg/L	107	80.0	120	----
Sulfur, total	7704-34-9	E420	0.5	mg/L	50 mg/L	92.1	80.0	120	----
Tellurium, total	13494-80-9	E420	0.0002	mg/L	0.1 mg/L	102	80.0	120	----
Thallium, total	7440-28-0	E420	0.00001	mg/L	1 mg/L	99.8	80.0	120	----
Thorium, total	7440-29-1	E420	0.0001	mg/L	0.1 mg/L	92.6	80.0	120	----
Tin, total	7440-31-5	E420	0.0001	mg/L	0.5 mg/L	100	80.0	120	----
Titanium, total	7440-32-6	E420	0.0003	mg/L	0.25 mg/L	93.4	80.0	120	----
Tungsten, total	7440-33-7	E420	0.0001	mg/L	0.1 mg/L	97.0	80.0	120	----
Uranium, total	7440-61-1	E420	0.00001	mg/L	0.005 mg/L	91.8	80.0	120	----
Vanadium, total	7440-62-2	E420	0.0005	mg/L	0.5 mg/L	101	80.0	120	----
Zinc, total	7440-66-6	E420	0.003	mg/L	0.5 mg/L	99.4	80.0	120	----
Zirconium, total	7440-67-7	E420	0.0002	mg/L	0.1 mg/L	102	80.0	120	----
<b>Total Metals (QCLot: 1611944)</b>									
Mercury, total	7439-97-6	E508	0.000005	mg/L	0 mg/L	99.3	80.0	120	----
<b>Dissolved Metals (QCLot: 1609547)</b>									
Aluminum, dissolved	7429-90-5	E421	0.001	mg/L	2 mg/L	95.4	80.0	120	----
Antimony, dissolved	7440-36-0	E421	0.0001	mg/L	1 mg/L	98.3	80.0	120	----
Arsenic, dissolved	7440-38-2	E421	0.0001	mg/L	1 mg/L	102	80.0	120	----
Barium, dissolved	7440-39-3	E421	0.0001	mg/L	0.25 mg/L	105	80.0	120	----
Beryllium, dissolved	7440-41-7	E421	0.00002	mg/L	0.1 mg/L	96.3	80.0	120	----
Bismuth, dissolved	7440-69-9	E421	0.00005	mg/L	1 mg/L	95.1	80.0	120	----
Boron, dissolved	7440-42-8	E421	0.01	mg/L	1 mg/L	91.7	80.0	120	----
Cadmium, dissolved	7440-43-9	E421	0.000005	mg/L	0.1 mg/L	98.0	80.0	120	----
Calcium, dissolved	7440-70-2	E421	0.05	mg/L	50 mg/L	100	80.0	120	----
Cesium, dissolved	7440-46-2	E421	0.00001	mg/L	0.05 mg/L	95.8	80.0	120	----
Chromium, dissolved	7440-47-3	E421	0.0005	mg/L	0.25 mg/L	98.8	80.0	120	----
Cobalt, dissolved	7440-48-4	E421	0.0001	mg/L	0.25 mg/L	95.3	80.0	120	----
Copper, dissolved	7440-50-8	E421	0.0002	mg/L	0.25 mg/L	95.4	80.0	120	----
Iron, dissolved	7439-89-6	E421	0.01	mg/L	1 mg/L	88.9	80.0	120	----
Lead, dissolved	7439-92-1	E421	0.00005	mg/L	0.5 mg/L	97.8	80.0	120	----
Lithium, dissolved	7439-93-2	E421	0.001	mg/L	0.25 mg/L	92.2	80.0	120	----
Magnesium, dissolved	7439-95-4	E421	0.005	mg/L	50 mg/L	94.6	80.0	120	----
Manganese, dissolved	7439-96-5	E421	0.0001	mg/L	0.25 mg/L	97.4	80.0	120	----
Molybdenum, dissolved	7439-98-7	E421	0.00005	mg/L	0.25 mg/L	104	80.0	120	----
Nickel, dissolved	7440-02-0	E421	0.0005	mg/L	0.5 mg/L	98.4	80.0	120	----



Sub-Matrix: **Water**

Laboratory Control Sample (LCS) Report

Analyte	CAS Number	Method	LOR	Unit	Spike		Recovery (%)		Recovery Limits (%)		Qualifier
					Target Concentration	LCS	Low	High			
<b>Dissolved Metals (QCLot: 1609547) - continued</b>											
Phosphorus, dissolved	7723-14-0	E421	0.05	mg/L	10 mg/L	108	80.0	120	----		
Potassium, dissolved	7440-09-7	E421	0.05	mg/L	50 mg/L	98.2	80.0	120	----		
Rubidium, dissolved	7440-17-7	E421	0.0002	mg/L	0.1 mg/L	100	80.0	120	----		
Selenium, dissolved	7782-49-2	E421	0.00005	mg/L	1 mg/L	96.7	80.0	120	----		
Silicon, dissolved	7440-21-3	E421	0.05	mg/L	10 mg/L	104	80.0	120	----		
Silver, dissolved	7440-22-4	E421	0.00001	mg/L	0.1 mg/L	93.6	80.0	120	----		
Sodium, dissolved	7440-23-5	E421	0.05	mg/L	50 mg/L	98.9	80.0	120	----		
Strontium, dissolved	7440-24-6	E421	0.0002	mg/L	0.25 mg/L	106	80.0	120	----		
Sulfur, dissolved	7704-34-9	E421	0.5	mg/L	50 mg/L	97.4	80.0	120	----		
Tellurium, dissolved	13494-80-9	E421	0.0002	mg/L	0.1 mg/L	99.7	80.0	120	----		
Thallium, dissolved	7440-28-0	E421	0.00001	mg/L	1 mg/L	100	80.0	120	----		
Thorium, dissolved	7440-29-1	E421	0.0001	mg/L	0.1 mg/L	94.5	80.0	120	----		
Tin, dissolved	7440-31-5	E421	0.0001	mg/L	0.5 mg/L	97.6	80.0	120	----		
Titanium, dissolved	7440-32-6	E421	0.0003	mg/L	0.25 mg/L	92.5	80.0	120	----		
Tungsten, dissolved	7440-33-7	E421	0.0001	mg/L	0.1 mg/L	99.5	80.0	120	----		
Uranium, dissolved	7440-61-1	E421	0.00001	mg/L	0.005 mg/L	92.9	80.0	120	----		
Vanadium, dissolved	7440-62-2	E421	0.0005	mg/L	0.5 mg/L	99.5	80.0	120	----		
Zinc, dissolved	7440-66-6	E421	0.001	mg/L	0.5 mg/L	93.1	80.0	120	----		
Zirconium, dissolved	7440-67-7	E421	0.0002	mg/L	0.1 mg/L	97.9	80.0	120	----		
Mercury, dissolved	7439-97-6	E509	0.000005	mg/L	0 mg/L	96.9	80.0	120	----		
<b>Dissolved Gases (QCLot: 1615772)</b>											
Methane	74-82-8	E614B	20.77	ppmv	432 ppmv	95.2	80.0	120	----		



### Matrix Spike (MS) Report

A Matrix Spike (MS) is a randomly selected intra-laboratory replicate sample that has been fortified (spiked) with test analytes at known concentration, and processed in an identical manner to test samples. Matrix Spikes provide information regarding analyte recovery and potential matrix effects. MS DQO exceedances due to sample matrix may sometimes be unavoidable; in such cases, test results for the associated sample (or similar samples) may be subject to bias. ND – Recovery not determined, background level >= 1x spike level.

Sub-Matrix: **Water**

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
<b>Anions and Nutrients (QCLot: 1610258)</b>										
VA24C1137-002	Anonymous	Nitrite (as N)	14797-65-0	E235.NO2-L	0.510 mg/L	0.5 mg/L	102	75.0	125	----
<b>Organic / Inorganic Carbon (QCLot: 1610140)</b>										
FJ2402449-004	Anonymous	Carbon, total organic [TOC]	----	E355-L	4.74 mg/L	5 mg/L	94.8	70.0	130	----
<b>Organic / Inorganic Carbon (QCLot: 1610145)</b>										
FJ2402450-002	Anonymous	Carbon, dissolved organic [DOC]	----	E358-L	4.66 mg/L	5 mg/L	93.2	70.0	130	----
<b>Total Sulfides (QCLot: 1611320)</b>										
FJ2402451-002	Anonymous	Sulfide, total (as S)	18496-25-8	E395-H	0.956 mg/L	1 mg/L	95.6	75.0	125	----
<b>Total Metals (QCLot: 1609548)</b>										
VA24C0978-001	Anonymous	Aluminum, total	7429-90-5	E420	0.186 mg/L	0.2 mg/L	92.8	70.0	130	----
		Antimony, total	7440-36-0	E420	0.0192 mg/L	0.02 mg/L	96.2	70.0	130	----
		Arsenic, total	7440-38-2	E420	0.0194 mg/L	0.02 mg/L	96.9	70.0	130	----
		Barium, total	7440-39-3	E420	ND mg/L	----	ND	70.0	130	----
		Beryllium, total	7440-41-7	E420	0.0390 mg/L	0.04 mg/L	97.6	70.0	130	----
		Bismuth, total	7440-69-9	E420	0.00927 mg/L	0.01 mg/L	92.7	70.0	130	----
		Boron, total	7440-42-8	E420	0.093 mg/L	0.1 mg/L	93.4	70.0	130	----
		Cadmium, total	7440-43-9	E420	0.00385 mg/L	0.004 mg/L	96.2	70.0	130	----
		Calcium, total	7440-70-2	E420	ND mg/L	----	ND	70.0	130	----
		Cesium, total	7440-46-2	E420	0.00990 mg/L	0.01 mg/L	99.0	70.0	130	----
		Chromium, total	7440-47-3	E420	0.0381 mg/L	0.04 mg/L	95.3	70.0	130	----
		Cobalt, total	7440-48-4	E420	0.0186 mg/L	0.02 mg/L	92.8	70.0	130	----
		Copper, total	7440-50-8	E420	0.0188 mg/L	0.02 mg/L	93.9	70.0	130	----
		Iron, total	7439-89-6	E420	1.89 mg/L	2 mg/L	94.6	70.0	130	----
		Lead, total	7439-92-1	E420	0.0189 mg/L	0.02 mg/L	94.5	70.0	130	----
		Lithium, total	7439-93-2	E420	0.0919 mg/L	0.1 mg/L	91.9	70.0	130	----
		Magnesium, total	7439-95-4	E420	ND mg/L	----	ND	70.0	130	----
		Manganese, total	7439-96-5	E420	ND mg/L	----	ND	70.0	130	----
		Molybdenum, total	7439-98-7	E420	0.0209 mg/L	0.02 mg/L	104	70.0	130	----
		Nickel, total	7440-02-0	E420	0.0375 mg/L	0.04 mg/L	93.8	70.0	130	----
		Phosphorus, total	7723-14-0	E420	9.37 mg/L	10 mg/L	93.7	70.0	130	----
		Potassium, total	7440-09-7	E420	3.65 mg/L	4 mg/L	91.2	70.0	130	----
		Rubidium, total	7440-17-7	E420	0.0188 mg/L	0.02 mg/L	94.1	70.0	130	----
		Selenium, total	7782-49-2	E420	0.0417 mg/L	0.04 mg/L	104	70.0	130	----
		Silicon, total	7440-21-3	E420	9.12 mg/L	10 mg/L	91.2	70.0	130	----
		Silver, total	7440-22-4	E420	0.00416 mg/L	0.004 mg/L	104	70.0	130	----
		Sodium, total	7440-23-5	E420	ND mg/L	----	ND	70.0	130	----
		Strontium, total	7440-24-6	E420	ND mg/L	----	ND	70.0	130	----
		Sulfur, total	7704-34-9	E420	ND mg/L	----	ND	70.0	130	----



Sub-Matrix: Water

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
<b>Total Metals (QCLot: 1609548) - continued</b>										
VA24C0978-001	Anonymous	Tellurium, total	13494-80-9	E420	0.0415 mg/L	0.04 mg/L	104	70.0	130	----
		Thallium, total	7440-28-0	E420	0.00378 mg/L	0.004 mg/L	94.5	70.0	130	----
		Thorium, total	7440-29-1	E420	0.0155 mg/L	0.02 mg/L	77.3	70.0	130	----
		Tin, total	7440-31-5	E420	0.0193 mg/L	0.02 mg/L	96.4	70.0	130	----
		Titanium, total	7440-32-6	E420	0.0345 mg/L	0.04 mg/L	86.2	70.0	130	----
		Tungsten, total	7440-33-7	E420	0.0197 mg/L	0.02 mg/L	98.6	70.0	130	----
		Uranium, total	7440-61-1	E420	0.00376 mg/L	0.004 mg/L	93.9	70.0	130	----
		Vanadium, total	7440-62-2	E420	0.0962 mg/L	0.1 mg/L	96.2	70.0	130	----
		Zinc, total	7440-66-6	E420	0.361 mg/L	0.4 mg/L	90.3	70.0	130	----
		Zirconium, total	7440-67-7	E420	0.0426 mg/L	0.04 mg/L	106	70.0	130	----
<b>Total Metals (QCLot: 1611944)</b>										
FJ2402413-004	Anonymous	Mercury, total	7439-97-6	E508	0.000101 mg/L	0 mg/L	101	70.0	130	----
<b>Dissolved Metals (QCLot: 1609547)</b>										
VA24C1257-001	Anonymous	Aluminum, dissolved	7429-90-5	E421	0.192 mg/L	0.2 mg/L	95.8	70.0	130	----
		Antimony, dissolved	7440-36-0	E421	0.0194 mg/L	0.02 mg/L	97.2	70.0	130	----
		Arsenic, dissolved	7440-38-2	E421	0.0201 mg/L	0.02 mg/L	100	70.0	130	----
		Barium, dissolved	7440-39-3	E421	ND mg/L	----	ND	70.0	130	----
		Beryllium, dissolved	7440-41-7	E421	0.0384 mg/L	0.04 mg/L	96.1	70.0	130	----
		Bismuth, dissolved	7440-69-9	E421	0.00891 mg/L	0.01 mg/L	89.1	70.0	130	----
		Boron, dissolved	7440-42-8	E421	0.099 mg/L	0.1 mg/L	99.4	70.0	130	----
		Cadmium, dissolved	7440-43-9	E421	0.00389 mg/L	0.004 mg/L	97.2	70.0	130	----
		Calcium, dissolved	7440-70-2	E421	ND mg/L	----	ND	70.0	130	----
		Cesium, dissolved	7440-46-2	E421	0.0100 mg/L	0.01 mg/L	100	70.0	130	----
		Chromium, dissolved	7440-47-3	E421	0.0381 mg/L	0.04 mg/L	95.3	70.0	130	----
		Cobalt, dissolved	7440-48-4	E421	0.0181 mg/L	0.02 mg/L	90.6	70.0	130	----
		Copper, dissolved	7440-50-8	E421	0.0180 mg/L	0.02 mg/L	89.9	70.0	130	----
		Iron, dissolved	7439-89-6	E421	1.91 mg/L	2 mg/L	95.4	70.0	130	----
		Lead, dissolved	7439-92-1	E421	0.0182 mg/L	0.02 mg/L	91.1	70.0	130	----
		Lithium, dissolved	7439-93-2	E421	0.0925 mg/L	0.1 mg/L	92.5	70.0	130	----
		Magnesium, dissolved	7439-95-4	E421	ND mg/L	----	ND	70.0	130	----
		Manganese, dissolved	7439-96-5	E421	0.0188 mg/L	0.02 mg/L	93.9	70.0	130	----
		Molybdenum, dissolved	7439-98-7	E421	0.0209 mg/L	0.02 mg/L	105	70.0	130	----
		Nickel, dissolved	7440-02-0	E421	0.0371 mg/L	0.04 mg/L	92.7	70.0	130	----
		Phosphorus, dissolved	7723-14-0	E421	9.64 mg/L	10 mg/L	96.4	70.0	130	----
		Potassium, dissolved	7440-09-7	E421	4.00 mg/L	4 mg/L	100	70.0	130	----
		Rubidium, dissolved	7440-17-7	E421	0.0189 mg/L	0.02 mg/L	94.7	70.0	130	----
		Selenium, dissolved	7782-49-2	E421	0.0408 mg/L	0.04 mg/L	102	70.0	130	----
		Silicon, dissolved	7440-21-3	E421	ND mg/L	----	ND	70.0	130	----
		Silver, dissolved	7440-22-4	E421	0.00402 mg/L	0.004 mg/L	100	70.0	130	----
		Sodium, dissolved	7440-23-5	E421	ND mg/L	----	ND	70.0	130	----
		Strontium, dissolved	7440-24-6	E421	ND mg/L	----	ND	70.0	130	----
		Sulfur, dissolved	7704-34-9	E421	ND mg/L	----	ND	70.0	130	----
		Tellurium, dissolved	13494-80-9	E421	0.0413 mg/L	0.04 mg/L	103	70.0	130	----



Sub-Matrix: **Water**

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
<b>Dissolved Metals (QCLot: 1609547) - continued</b>										
VA24C1257-001	Anonymous	Thallium, dissolved	7440-28-0	E421	0.00364 mg/L	0.004 mg/L	91.0	70.0	130	----
		Thorium, dissolved	7440-29-1	E421	0.0168 mg/L	0.02 mg/L	83.9	70.0	130	----
		Tin, dissolved	7440-31-5	E421	0.0195 mg/L	0.02 mg/L	97.4	70.0	130	----
		Titanium, dissolved	7440-32-6	E421	0.0358 mg/L	0.04 mg/L	89.6	70.0	130	----
		Tungsten, dissolved	7440-33-7	E421	0.0191 mg/L	0.02 mg/L	95.5	70.0	130	----
		Uranium, dissolved	7440-61-1	E421	0.00352 mg/L	0.004 mg/L	88.0	70.0	130	----
		Vanadium, dissolved	7440-62-2	E421	0.0964 mg/L	0.1 mg/L	96.4	70.0	130	----
		Zinc, dissolved	7440-66-6	E421	0.365 mg/L	0.4 mg/L	91.2	70.0	130	----
		Zirconium, dissolved	7440-67-7	E421	0.0411 mg/L	0.04 mg/L	103	70.0	130	----
<b>Dissolved Metals (QCLot: 1610588)</b>										
KS2403294-001	Anonymous	Mercury, dissolved	7439-97-6	E509	0.0000974 mg/L	0 mg/L	97.4	70.0	130	----



Chain of Custody (COC) / Analytical Request Form

COC Number: 20 - 964332

Canada Toll Free: 1 800 668 9878

Page 1

Environmental Division  
Fort St. John  
Work Order Reference  
**FJ2402491**



Telephone: +1 250 261 5517

Report To		Contact and company name below will appear on the final report		Reports / Recipients		Turnaround Time (TAT) Requested	
Company:	Tetra Tech	Select Report Format:	<input checked="" type="checkbox"/> PDF <input checked="" type="checkbox"/> EXCEL <input type="checkbox"/> EDD (DIGITAL)			<input type="checkbox"/> Routine (R) if received by 3pm M-F - no surcharges apply <input type="checkbox"/> 4 day (P4) if received by 3pm M-F - 20% rush surcharge min/m <input type="checkbox"/> 3 day (P3) if received by 3pm M-F - 25% rush surcharge min/m <input type="checkbox"/> 2 day (P2) if received by 3pm M-F - 50% rush surcharge min/m <input checked="" type="checkbox"/> 1 day (E) if received by 3pm M-F - 100% rush surcharge min/m <input type="checkbox"/> Same day (E2) if received by 10am M-S - 200% rush surcharge. Adj may apply to rush requests on weekends, statutory holidays and non-	
Contact:	Andrea McMillan	Merge QC/QCI Reports with COA	<input type="checkbox"/> YES <input type="checkbox"/> NO <input type="checkbox"/> N/A			<input type="checkbox"/> Compare Results to Criteria on Report - provide details below if box checked Select Distribution: <input type="checkbox"/> EMAIL <input type="checkbox"/> MAIL <input type="checkbox"/> FAX	
Phone:	403-203-3855	Select Distribution:	<input type="checkbox"/> EMAIL <input type="checkbox"/> MAIL <input type="checkbox"/> FAX			<input type="checkbox"/> Email 1 or Fax: Andrea.McMillan@TetraTech.com <input type="checkbox"/> Email 2: Eba.labadeta@TetraTech.com <input type="checkbox"/> Email 3: Azita.Shaikh@TetraTech.com	
Company address below will appear on the final report						<b>Date and Time Required for all E&amp;P TATs:</b> For all tests with rush TATs requested, please	
Street:	140 Quarry Park Blvd					<b>Analysis R</b> Indicate Filtered (F), Preserved (P) or Filtered ar.	
City/Province:	Calgary AB					<b>NUMBER OF CONTAINERS</b> Disolved gas (Styrene) 12 ✓ Routine 12 ✓ Arsenic 12 ✓ physical test 12 ✓ H <sub>2</sub> S 12 ✓ Dissolved metals 12 ✓ Total metalstthg 12 ✓ Cyanide 12 ✓ DOC 12 ✓ Total organic Carbon 12 ✓	
Postal Code:	T2C 8G3					<b>SAMPLES ON HOLD</b> <b>EXTENDED STORAGE REQUIRED</b> <b>SUSPECTED HAZARD (see notes)</b>	
Invoice To	Same as Report To <input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	Select Invoice Distribution: <input type="checkbox"/> EMAIL <input type="checkbox"/> MAIL <input type="checkbox"/> FAX					
Copy of Invoice with Report <input type="checkbox"/> YES <input type="checkbox"/> NO							
Company:		Email 1 or Fax					
Contact:		Email 2					
<b>Project Information</b>		<b>Oil and Gas Required Fields (client use)</b>					
ALS Account # / Quote #:		AFE/Cost Center:	PO#				
Job #:	704-FNW.Gew 03704-02	Major/Minor Code:	Routing Code:				
PO / AFE:		Requisitioner:					
LSD:		Location:					
ALS Lab Work Order # (ALS use only):		ALS Contact:	Sampler:				
ALS Sample # (ALS use only)	Sample Identification and/or Coordinates (This description will appear on the report)	Date (dd-mmm-yy)	Time (hh:mm)	Sample Type			
	Location 2	20-Aug-24	16:00	GW	12	✓	✓
<div style="border: 1px solid black; background-color: #fce4ec; padding: 10px; display: inline-block;"> <p>Rush Samples</p> </div>							
Drinking Water (DW) Samples <sup>1</sup> (client use)		Notes / Specify Limits for result evaluation by selecting from drop-down below (Excel COC only)		SAMPLE RECEIPT DETAILS (ALS use only)			
Are samples taken from a Regulated DW System? <input type="checkbox"/> YES <input type="checkbox"/> NO Are samples for human consumption/ use? <input type="checkbox"/> YES <input type="checkbox"/> NO		- Confirm Analysis with Andrea McMillan - ES DAT format		Cooling Method: <input type="checkbox"/> NONE <input type="checkbox"/> ICE <input type="checkbox"/> ICE PACKS <input type="checkbox"/> FROZEN <input type="checkbox"/> COOLING INITIATED Submission Comments identified on Sample Receipt Notification: <input type="checkbox"/> YES <input type="checkbox"/> NO Cooler Custody Seals Intact: <input type="checkbox"/> YES <input type="checkbox"/> N/A Sample Custody Seals Intact: <input type="checkbox"/> YES <input type="checkbox"/> N/A INITIAL COOLER TEMPERATURES °C: 13.4 FINAL COOLER TEMPERATURES °C:			
SHIPMENT RELEASE (client use)		INITIAL SHIPMENT RECEPTION (ALS use only)		FINAL SHIPMENT RECEPTION (ALS use only)			
Released	Date: Aug-20-2024 Time: 17:45	Date: Aug 21/24 Time: 8:00	Received by:	Date:	Time:	Date:	Time:





## CERTIFICATE OF ANALYSIS

<p><b>Work Order</b> : <b>FJ2402552</b></p> <p><b>Client</b> : <b>Tetra Tech Canada Inc.</b></p> <p><b>Contact</b> : Andrea McMillan</p> <p><b>Address</b> : 110, 140 Quarry Park Blvd SE Calgary AB Canada T2C 3G3</p> <p><b>Telephone</b> : ----</p> <p><b>Project</b> : 704-ENW.GENV03704-02</p> <p><b>PO</b> : ----</p> <p><b>C-O-C number</b> : ----</p> <p><b>Sampler</b> : Fahim Nazari</p> <p><b>Site</b> : ----</p> <p><b>Quote number</b> : VA24-EBAE100-013</p> <p><b>No. of samples received</b> : 1</p> <p><b>No. of samples analysed</b> : 1</p>	<p><b>Page</b> : 1 of 4</p> <p><b>Laboratory</b> : ALS Environmental - Fort St. John</p> <p><b>Account Manager</b> : Brent Mack</p> <p><b>Address</b> : 11007 Alaska Road Fort St. John BC Canada V1J 6P3</p> <p><b>Telephone</b> : 778-370-3279</p> <p><b>Date Samples Received</b> : 23-Aug-2024 13:00</p> <p><b>Date Analysis Commenced</b> : 03-Sep-2024</p> <p><b>Issue Date</b> : 05-Sep-2024 09:46</p>
--	---

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Certificate of Analysis contains the following information:

- General Comments
- Analytical Results

Additional information pertinent to this report will be found in the following separate attachments: Quality Control Report, QC Interpretive report to assist with Quality Review and Sample Receipt Notification (SRN).

### Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

<i>Signatories</i>	<i>Position</i>	<i>Laboratory Department</i>
David Tremblett	VOC Section Supervisor	Air Quality, Waterloo, Ontario
Sarah Birch	VOC Section Supervisor	Air Quality, Waterloo, Ontario



## General Comments

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Refer to the ALS Quality Control Interpretive report (QCI) for applicable references and methodology summaries. Reference methods may incorporate modifications to improve performance.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis.

Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

Please refer to Quality Control Interpretive report (QCI) for information regarding Holding Time compliance.

Key : CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances  
LOR: Limit of Reporting (detection limit).

<i>Unit</i>	<i>Description</i>
-	no units
%	percent
µg/m <sup>3</sup>	micrograms per cubic metre
Inches Hg	inches of mercury
ppbv	parts per billion (volume/volume)

<: less than.

>: greater than.

Surrogate: An analyte that is similar in behavior to target analyte(s), but that does not occur naturally in environmental samples. For applicable tests, surrogates are added to samples prior to analysis as a check on recovery.

Test results reported relate only to the samples as received by the laboratory.

UNLESS OTHERWISE STATED on SRN or QCI Report, ALL SAMPLES WERE RECEIVED IN ACCEPTABLE CONDITION.

## Qualifiers

<i>Qualifier</i>	<i>Description</i>
HTA	Analytical holding time was exceeded.



## Analytical Results

Sub-Matrix: Canister

Client sample ID

(Matrix: Air)

					LOCATION 2 AIR	---	---	---	---
Client sampling date / time					23-Aug-2024 11:48	---	---	---	---
Analyte	CAS Number	Method/Lab	LOR	Unit	FJ2402552-001	-----	-----	-----	-----
					Result	---	---	---	---
<b>Field Tests</b>									
ID, batch proof	----	EF001/WT	-	-	240702.225	---	---	---	---
ID, canister	----	EF001/WT	-	-	01400-0339	---	---	---	---
ID, regulator	----	EF001/WT	-	-	G165	---	---	---	---
Pressure on receipt	----	EF001/WT	0.10	Inches Hg	-8.17	---	---	---	---
<b>Sulfur Compounds</b>									
Carbon disulfide	75-15-0	EC630/WT	6.2	µg/m <sup>3</sup>	142	---	---	---	---
Carbon disulfide	75-15-0	E630/WT	2.0	ppbv	45.7 <sup>HTA</sup>	---	---	---	---
Carbonyl sulfide	463-58-1	EC630/WT	10	µg/m <sup>3</sup>	607	---	---	---	---
Carbonyl sulfide	463-58-1	E630/WT	4.0	ppbv	247 <sup>HTA</sup>	---	---	---	---
Diethyl disulfide	110-81-6	EC630/WT	10	µg/m <sup>3</sup>	<10	---	---	---	---
Diethyl disulfide	110-81-6	E630/WT	2.0	ppbv	<2.0 <sup>HTA</sup>	---	---	---	---
Diethyl sulfide	352-93-2	EC630/WT	15	µg/m <sup>3</sup>	<15	---	---	---	---
Diethyl sulfide	352-93-2	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---
Dimethyl disulfide	624-92-0	EC630/WT	7.7	µg/m <sup>3</sup>	<7.7	---	---	---	---
Dimethyl disulfide	624-92-0	E630/WT	2.0	ppbv	<2.0 <sup>HTA</sup>	---	---	---	---
Dimethyl sulfide	75-18-3	EC630/WT	10	µg/m <sup>3</sup>	<10	---	---	---	---
Dimethyl sulfide	75-18-3	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---
Dimethylthiophene, 2,5-	638-02-8	EC630/WT	18	µg/m <sup>3</sup>	<18	---	---	---	---
Dimethylthiophene, 2,5-	638-02-8	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---
Ethyl mercaptan	75-08-1	EC630/WT	10	µg/m <sup>3</sup>	<10	---	---	---	---
Ethyl mercaptan	75-08-1	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---
Ethyl methyl sulfide	624-89-5	EC630/WT	12	µg/m <sup>3</sup>	<12	---	---	---	---
Ethyl methyl sulfide	624-89-5	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---
Ethylthiophene, 2-	872-55-9	EC630/WT	18	µg/m <sup>3</sup>	<18	---	---	---	---
Ethylthiophene, 2-	872-55-9	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---
Hydrogen sulfide	7783-06-4	EC630/WT	5.6	µg/m <sup>3</sup>	18.8	---	---	---	---
Hydrogen sulfide	7783-06-4	E630/WT	4.0	ppbv	13.5 <sup>HTA</sup>	---	---	---	---
Isobutyl mercaptan	513-44-0	EC630/WT	15	µg/m <sup>3</sup>	<15	---	---	---	---
Isobutyl mercaptan	513-44-0	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---



## Analytical Results

Sub-Matrix: Canister

Client sample ID

(Matrix: Air)

					LOCATION 2	----	----	----	----	
					AIR					
					Client sampling date / time	23-Aug-2024 11:48	---	---	---	---
Analyte	CAS Number	Method/Lab	LOR	Unit	FJ2402552-001	-----	-----	-----	-----	
					Result	---	---	---	---	
<b>Sulfur Compounds</b>										
Isopropyl mercaptan	75-33-2	EC630/WT	12	µg/m <sup>3</sup>	<12	---	---	---	---	
Isopropyl mercaptan	75-33-2	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---	
Methyl mercaptan	74-93-1	EC630/WT	7.9	µg/m <sup>3</sup>	<7.9	---	---	---	---	
Methyl mercaptan	74-93-1	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---	
Methylthiophene, 2-	554-14-3	EC630/WT	16	µg/m <sup>3</sup>	<16	---	---	---	---	
Methylthiophene, 2-	554-14-3	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---	
Methylthiophene, 3-	616-44-4	EC630/WT	16	µg/m <sup>3</sup>	<16	---	---	---	---	
Methylthiophene, 3-	616-44-4	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---	
n-Butyl mercaptan	109-79-5	EC630/WT	15	µg/m <sup>3</sup>	<15	---	---	---	---	
n-Butyl mercaptan	109-79-5	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---	
Propyl mercaptan	107-03-9	EC630/WT	12	µg/m <sup>3</sup>	<12	---	---	---	---	
Propyl mercaptan	107-03-9	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---	
sec-butyl mercaptan + thiophene	----	EC630/WT	14	µg/m <sup>3</sup>	<21	---	---	---	---	
sec-butyl mercaptan + thiophene	----	E630/WT	6.0	ppbv	<6.0 <sup>HTA</sup>	---	---	---	---	
t-Butyl mercaptan	75-66-1	EC630/WT	15	µg/m <sup>3</sup>	<15	---	---	---	---	
t-Butyl mercaptan	75-66-1	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---	
Tetrahydrothiophene	110-01-0	EC630/WT	14	µg/m <sup>3</sup>	<14	---	---	---	---	
Tetrahydrothiophene	110-01-0	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---	
<b>Sulfur, total reduced (as H2S), 10 compounds</b>	----	EC630/WT	16	µg/m <sup>3</sup>	427	---	---	---	---	
<b>Sulfur, total reduced (as H2S), 22 compounds</b>	----	EC630/WT	25	µg/m <sup>3</sup>	427	---	---	---	---	
<b>Sulfur, total reduced (as H2S), NPRI 6</b>	----	EC630/WT	12	µg/m <sup>3</sup>	427	---	---	---	---	
<b>Sulfur, total reduced (as H2S), Ontario 4</b>	----	EC630/WT	11	µg/m <sup>3</sup>	19	---	---	---	---	
<b>Permanent Gases</b>										
Methane	74-82-8	E629B-H/WT	0.050	%	<0.050	---	---	---	---	

Please refer to the General Comments section for an explanation of any result qualifiers detected.

Please refer to the Accreditation section for an explanation of analyte accreditations.

## QUALITY CONTROL INTERPRETIVE REPORT

<p><b>Work Order</b> : <b>FJ2402552</b></p> <p><b>Client</b> : <b>Tetra Tech Canada Inc.</b></p> <p><b>Contact</b> : Andrea McMillan</p> <p><b>Address</b> : 110, 140 Quarry Park Blvd SE Calgary AB Canada T2C 3G3</p> <p><b>Telephone</b> : ----</p> <p><b>Project</b> : 704-ENW.GENV03704-02</p> <p><b>PO</b> : ----</p> <p><b>C-O-C number</b> : ----</p> <p><b>Sampler</b> : Fahim Nazari</p> <p><b>Site</b> : ----</p> <p><b>Quote number</b> : VA24-EBAE100-013</p> <p><b>No. of samples received</b> : 1</p> <p><b>No. of samples analysed</b> : 1</p>	<p><b>Page</b> : 1 of 5</p> <p><b>Laboratory</b> : ALS Environmental - Fort St. John</p> <p><b>Account Manager</b> : Brent Mack</p> <p><b>Address</b> : 11007 Alaska Road Fort St. John, British Columbia Canada V1J 6P3</p> <p><b>Telephone</b> : 778-370-3279</p> <p><b>Date Samples Received</b> : 23-Aug-2024 13:00</p> <p><b>Issue Date</b> : 05-Sep-2024 09:46</p>
--	--

This report is automatically generated by the ALS LIMS (Laboratory Information Management System) through evaluation of Quality Control (QC) results and other QA parameters associated with this submission, and is intended to facilitate rapid data validation by auditors or reviewers. The report highlights any exceptions and outliers to ALS Data Quality Objectives, provides holding time details and exceptions, summarizes QC sample frequencies, and lists applicable methodology references and summaries.

**Key**

- Anonymous: Refers to samples which are not part of this work order, but which formed part of the QC process lot.
- CAS Number: Chemical Abstracts Service number is a unique identifier assigned to discrete substances.
- DQO: Data Quality Objective.
- LOR: Limit of Reporting (detection limit).
- RPD: Relative Percent Difference.

### ***Workorder Comments***

Holding times are displayed as "----" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

### ***Summary of Outliers***

#### ***Outliers : Quality Control Samples***

- No Method Blank value outliers occur.
- No Duplicate outliers occur.
- No Laboratory Control Sample (LCS) outliers occur
- No Test sample Surrogate recovery outliers exist.

#### ***Outliers: Reference Material (RM) Samples***

- No Reference Material (RM) Sample outliers occur.

#### ***Outliers : Analysis Holding Time Compliance (Breaches)***

- Analysis Holding Time Outliers exist - please see following pages for full details.

## ***Outliers : Frequency of Quality Control Samples***

- No Quality Control Sample Frequency Outliers occur.



## Analysis Holding Time Compliance

This report summarizes extraction / preparation and analysis times and compares each with ALS recommended holding times, which are selected to meet known provincial and /or federal requirements. In the absence of regulatory hold times, ALS establishes recommendations based on guidelines published by organizations such as CCME, US EPA, APHA Standard Methods, ASTM, or Environment Canada (where available). Dates and holding times reported below represent the first dates of extraction or analysis. If subsequent tests or dilutions exceeded holding times, qualifiers are added (refer to COA).

If samples are identified below as having been analyzed or extracted outside of recommended holding times, measurement uncertainties may be increased, and this should be taken into consideration when interpreting results.

Where actual sampling date is not provided on the chain of custody, the date of receipt with time at 00:00 is used for calculation purposes.

Where only the sample date without time is provided on the chain of custody, the sampling date at 00:00 is used for calculation purposes.

Matrix: Air

Evaluation: \* = Holding time exceedance ; ✓ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis			
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval
				Rec	Actual			Rec	Actual	
<b>Field Tests : Air Canister Information</b>										
<b>Canister</b> LOCATION 2 AIR	EF001	23-Aug-2024	----	----	----		03-Sep-2024	----	11 days	
<b>Permanent Gases : Permanent Gases (Methane, CO2, CO, N2, and O2) in Air (Routine Level, %)</b>										
<b>Canister</b> LOCATION 2 AIR	E629B-H	23-Aug-2024	----	----	----		04-Sep-2024	30 days	12 days	✓
<b>Sulfur Compounds : Reduced Sulfur Compounds in Passivated Canisters by GC-SCD (All List) (ppbV)</b>										
<b>Canister</b> LOCATION 2 AIR	E630	23-Aug-2024	----	----	----		04-Sep-2024	7 days	11 days	* EHT

### Legend & Qualifier Definitions

EHT: Exceeded ALS recommended hold time prior to analysis.

Rec. HT: ALS recommended hold time (see units).



## Quality Control Parameter Frequency Compliance

The following report summarizes the frequency of laboratory QC samples analyzed within the analytical batches (QC lots) in which the submitted samples were processed. The actual frequency should be greater than or equal to the expected frequency.

Matrix: Air

Evaluation: ✖ = QC frequency outside specification; ✔ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		
			QC	Regular	Actual	Expected	Evaluation
<b>Analytical Methods</b>							
<b>Laboratory Duplicates (DUP)</b>							
Permanent Gases (Methane, CO <sub>2</sub> , CO, N <sub>2</sub> , and O <sub>2</sub> ) in Air (Routine Level, %)	E629B-H	1631955	1	1	100.0	5.0	✔
Reduced Sulfur Compounds in Passivated Canisters by GC-SCD (All List) (ppbV)	E630	1631263	1	1	100.0	5.0	✔
<b>Laboratory Control Samples (LCS)</b>							
Permanent Gases (Methane, CO <sub>2</sub> , CO, N <sub>2</sub> , and O <sub>2</sub> ) in Air (Routine Level, %)	E629B-H	1631955	1	1	100.0	5.0	✔
Reduced Sulfur Compounds in Passivated Canisters by GC-SCD (All List) (ppbV)	E630	1631263	1	1	100.0	5.0	✔
<b>Method Blanks (MB)</b>							
Air Canister Information	EF001	1629916	1	9	11.1	5.0	✔
Permanent Gases (Methane, CO <sub>2</sub> , CO, N <sub>2</sub> , and O <sub>2</sub> ) in Air (Routine Level, %)	E629B-H	1631955	1	1	100.0	5.0	✔
Reduced Sulfur Compounds in Passivated Canisters by GC-SCD (All List) (ppbV)	E630	1631263	1	1	100.0	5.0	✔





## Methodology References and Summaries

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Reference methods may incorporate modifications to improve performance (indicated by "mod").

Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Permanent Gases (Methane, CO <sub>2</sub> , CO, N <sub>2</sub> , and O <sub>2</sub> ) in Air (Routine Level, %)	E629B-H  ALS Environmental - Waterloo	Air	EPA Method 3C & ASTM D1946	This analysis is performed using procedures adapted from EPA Method 3C & ASTM D1946. Air samples are collected into cleaned evacuated canisters. A volume of air is removed from the canister and injected by means of a gas-sampling/backflush valve onto a series of packed GC columns and measured using a thermal conductivity detector (TCD).  Oxygen is not separated from Argon.  Canister samples will be retained for 7 calendar days after final report. If you require a longer canister storage time, please contact your account manager.
Reduced Sulfur Compounds in Passivated Canisters by GC-SCD (All List) (ppbV)	E630  ALS Environmental - Waterloo	Air	ASTM D5504	This analysis is performed using procedures adapted from ASTM D5504. Air samples are collected into cleaned evacuated silica-coated canisters. By means of a loop system, a volume of air is transferred from the canister and cryofocused before determining the sulfur compounds by GC-SCD. Silica coated passivated canisters may allow for reliable sample analysis after 24 hours. In such cases, analysis is recommended within 7 days of collection.  Canister samples will be retained for 7 calendar days after final report. If you require a longer canister storage time, please contact your Project Manager.
Reduced Sulfur Compounds in Passivated Canisters by GC-SCD (All List) (ug/m <sup>3</sup> )	EC630  ALS Environmental - Waterloo	Air	ASTM D5504	convert ppbv to ug/m <sup>3</sup>
Air Canister Information	EF001  ALS Environmental - Waterloo	Air	In-house	Air canister information provided by client and recorded on ALS report may affect the validity of results.

## QUALITY CONTROL REPORT

<b>Work Order</b>	<b>: FJ2402552</b>	<b>Page</b>	: 1 of 5
<b>Client</b>	: Tetra Tech Canada Inc.	<b>Laboratory</b>	: ALS Environmental - Fort St. John
<b>Contact</b>	: Andrea McMillan	<b>Account Manager</b>	: Brent Mack
<b>Address</b>	: 110, 140 Quarry Park Blvd SE Calgary AB Canada T2C 3G3	<b>Address</b>	: 11007 Alaska Road Fort St. John, British Columbia Canada V1J 6P3
<b>Telephone</b>	: ----	<b>Telephone</b>	: 778-370-3279
<b>Project</b>	: 704-ENW.GENV03704-02	<b>Date Samples Received</b>	: 23-Aug-2024 13:00
<b>PO</b>	: ----	<b>Date Analysis Commenced</b>	: 03-Sep-2024
<b>C-O-C number</b>	: ----	<b>Issue Date</b>	: 05-Sep-2024 09:46
<b>Sampler</b>	: Fahim Nazari		
<b>Site</b>	: ----		
<b>Quote number</b>	: VA24-EBAE100-013		
<b>No. of samples received</b>	: 1		
<b>No. of samples analysed</b>	: 1		

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Quality Control Report contains the following information:

- Laboratory Duplicate (DUP) Report; Relative Percent Difference (RPD) and Data Quality Objectives
- Method Blank (MB) Report; Recovery and Data Quality Objectives
- Laboratory Control Sample (LCS) Report; Recovery and Data Quality Objectives

### Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

<i>Signatories</i>	<i>Position</i>	<i>Laboratory Department</i>
David Tremblett	VOC Section Supervisor	Waterloo Air Quality, Waterloo, Ontario
Sarah Birch	VOC Section Supervisor	Waterloo Air Quality, Waterloo, Ontario

Page : 2 of 5  
Work Order : FJ2402552  
Client : Tetra Tech Canada Inc.  
Project : 704-ENW.GENV03704-02



---

## General Comments

The ALS Quality Control (QC) report is optionally provided to ALS clients upon request. ALS test methods include comprehensive QC checks with every analysis to ensure our high standards of quality are met. Each QC result has a known or expected target value, which is compared against predetermined Data Quality Objectives (DQOs) to provide confidence in the accuracy of associated test results. This report contains detailed results for all QC results applicable to this sample submission. Please refer to the ALS Quality Control Interpretation report (QCI) for applicable method references and methodology summaries.

### Key :

Anonymous = Refers to samples which are not part of this work order, but which formed part of the QC process lot.

CAS Number = Chemical Abstracts Service number is a unique identifier assigned to discrete substances.

DQO = Data Quality Objective.

LOR = Limit of Reporting (detection limit).

RPD = Relative Percent Difference

# = Indicates a QC result that did not meet the ALS DQO.

---

## Workorder Comments

Holding times are displayed as "---" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

---



### Laboratory Duplicate (DUP) Report

A Laboratory Duplicate (DUP) is a randomly selected intralaboratory replicate sample. Laboratory Duplicates provide information regarding method precision and sample heterogeneity. ALS DQOs for Laboratory Duplicates are expressed as test-specific limits for Relative Percent Difference (RPD), or as an absolute difference limit of 2 times the LOR for low concentration duplicates within ~ 4-10 times the LOR (cut-off is test-specific).

Sub-Matrix: Air

					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
<b>Sulfur Compounds (QC Lot: 1631263)</b>											
FJ2402552-001	LOCATION 2 AIR	Carbon disulfide	75-15-0	E630	2.0	ppbv	45.7	45.9	0.389%	30%	----
		Carbonyl sulfide	463-58-1	E630	4.0	ppbv	247	248	0.451%	30%	----
		Diethyl disulfide	110-81-6	E630	2.0	ppbv	<2.0	<2.0	0	Diff <2x LOR	----
		Diethyl sulfide	352-93-2	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Dimethyl disulfide	624-92-0	E630	2.0	ppbv	<2.0	<2.0	0	Diff <2x LOR	----
		Dimethyl sulfide	75-18-3	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Dimethylthiophene, 2,5-	638-02-8	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Ethyl mercaptan	75-08-1	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Ethyl methyl sulfide	624-89-5	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Ethylthiophene, 2-	872-55-9	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Hydrogen sulfide	7783-06-4	E630	4.0	ppbv	13.5	12.3	1.2	Diff <2x LOR	----
		Isobutyl mercaptan	513-44-0	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Isopropyl mercaptan	75-33-2	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Methyl mercaptan	74-93-1	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Methylthiophene, 2-	554-14-3	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Methylthiophene, 3-	616-44-4	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		n-Butyl mercaptan	109-79-5	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Propyl mercaptan	107-03-9	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		sec-butyl mercaptan + thiophene	----	E630	6.0	ppbv	<6.0	<6.0	0	Diff <2x LOR	----
		t-Butyl mercaptan	75-66-1	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Tetrahydrothiophene	110-01-0	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
<b>Permanent Gases (QC Lot: 1631955)</b>											
FJ2402552-001	LOCATION 2 AIR	Methane	74-82-8	E629B-H	0.050	%	<0.050	<0.050	0	Diff <2x LOR	----



## Method Blank (MB) Report

A Method Blank is an analyte-free matrix that undergoes sample processing identical to that carried out for test samples. Method Blank results are used to monitor and control for potential contamination from the laboratory environment and reagents. For most tests, the DQO for Method Blanks is for the result to be < LOR.

Sub-Matrix: Air

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
<b>Field Tests (QCLot: 1629916)</b>						
Pressure on receipt	---	EF001	0.1	Inches Hg	-30.0	---
<b>Sulfur Compounds (QCLot: 1631263)</b>						
Carbon disulfide	75-15-0	E630	2	ppbv	<2.0	---
Carbonyl sulfide	463-58-1	E630	4	ppbv	<4.0	---
Diethyl disulfide	110-81-6	E630	2	ppbv	<2.0	---
Diethyl sulfide	352-93-2	E630	4	ppbv	<4.0	---
Dimethyl disulfide	624-92-0	E630	2	ppbv	<2.0	---
Dimethyl sulfide	75-18-3	E630	4	ppbv	<4.0	---
Dimethylthiophene, 2,5-	638-02-8	E630	4	ppbv	<4.0	---
Ethyl mercaptan	75-08-1	E630	4	ppbv	<4.0	---
Ethyl methyl sulfide	624-89-5	E630	4	ppbv	<4.0	---
Ethylthiophene, 2-	872-55-9	E630	4	ppbv	<4.0	---
Hydrogen sulfide	7783-06-4	E630	4	ppbv	<4.0	---
Isobutyl mercaptan	513-44-0	E630	4	ppbv	<4.0	---
Isopropyl mercaptan	75-33-2	E630	4	ppbv	<4.0	---
Methyl mercaptan	74-93-1	E630	4	ppbv	<4.0	---
Methylthiophene, 2-	554-14-3	E630	4	ppbv	<4.0	---
Methylthiophene, 3-	616-44-4	E630	4	ppbv	<4.0	---
n-Butyl mercaptan	109-79-5	E630	4	ppbv	<4.0	---
Propyl mercaptan	107-03-9	E630	4	ppbv	<4.0	---
sec-butyl mercaptan + thiophene	---	E630	6	ppbv	<6.0	---
t-Butyl mercaptan	75-66-1	E630	4	ppbv	<4.0	---
Tetrahydrothiophene	110-01-0	E630	4	ppbv	<4.0	---
<b>Permanent Gases (QCLot: 1631955)</b>						
Methane	74-82-8	E629B-H	0.05	%	<0.050	---



## Laboratory Control Sample (LCS) Report

A Laboratory Control Sample (LCS) is an analyte-free matrix that has been fortified (spiked) with test analytes at known concentration and processed in an identical manner to test samples. LCS results are expressed as percent recovery, and are used to monitor and control test method accuracy and precision, independent of test sample matrix.

Sub-Matrix: Air

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
<b>Sulfur Compounds (QCLot: 1631263)</b>									
Carbonyl sulfide	463-58-1	E630	4	ppbv	104 ppbv	110	60.0	140	----
Hydrogen sulfide	7783-06-4	E630	4	ppbv	112 ppbv	77.9	60.0	140	----
Methyl mercaptan	74-93-1	E630	4	ppbv	101 ppbv	103	60.0	140	----
<b>Permanent Gases (QCLot: 1631955)</b>									
Methane	74-82-8	E629B-H	0.05	%	15 %	104	70.0	130	----

60 NORTHLAND ROAD, UNIT 1  
WATERLOO, ON N2V 2B8

Phone: (519) 886-6910

Fax: (519) 886-9047

Toll Free: 1-800-668-9878



AIR QUALITY CHAIN OF CUSTODY FORM - Canister/Tube/Gas Bag

**Note:** All TAT Quoted is in business days which exclude statutory holidays and weekends. TAT of samples received past 3:00 pm on Saturday / Sunday begin the next day.

DATE REQUIRED	SERVICE REQUESTED		Rush 3 day (100%)	<input type="checkbox"/>
	10 day (regular)	<input type="checkbox"/>	Rush 2 day (200%)	<input type="checkbox"/>
	Rush 5 day (50%)	<input type="checkbox"/>	Rush 1 day (300%) - Enquire	<input type="checkbox"/>

COMPANY NAME: Tetra Tech  
OFFICE: 140 Quarry Park Blvd, Calgary  
PROJECT MANAGER: Andrea McMillan  
PROJECT #: 704-ENW.Genv03704-02  
PHONE: 403-203-3355 FAX: [blank]

REGULATION: [blank]  
CRITERIA: [blank]  
OTHER INFORMATION: [blank]

ANALYSIS REQUEST

TUBE AIR VOLUME - L  or m<sup>3</sup>

Undissolved methene  
Undissolved H<sub>2</sub>S

STARTING PRESSURE - Pre-Sampling ("Hg) [blank]  
ENDING PRESSURE - Post Sampling ("Hg) [blank]

COLLECTION TIME (HRS) [blank]

All rush work requires lab approval before sample submission

SUBMISSION #: [blank]  
ENTERED BY: [blank]  
DATE/TIME ENTERED: [blank]  
BIN #: [blank]

Field Conditions (Rain/Wind/Dust/Odour)  
Field PID Reading [blank]

LAB ID [blank]

ACCOUNT #: [blank]  
QUOTATION #: [blank] PO #: 704-ENW.Genv03704-02

REPORT FORMAT/DISTRIBUTION

EMAIL  FAX  BOTH   
SELECT: PDF  DIGITAL  BOTH   
EMAIL 1 [blank]  
EMAIL 2 [blank]

SAMPLING INFORMATION

Sample Date/Time	Canister or Tube ID#	Regulator Serial #	Matrix Type	SAMPLE DESCRIPTION TO APPEAR ON REPORT
23-Aug-24 10:48	01400-0339	277	Air	Location 2 Air

DATE (dd-mmm-yy)	TIME (24hr) (hh:mm)	Canister or Tube ID# (e.g. 060000-XXXX or G0XXXXXXSVI)	Regulator Serial # (CSI 200-XXXX or GXX)	Matrix Type	SAMPLE DESCRIPTION TO APPEAR ON REPORT	TUBE AIR VOLUME	STARTING PRESSURE	ENDING PRESSURE	COLLECTION TIME (HRS)	Field Conditions (Rain/Wind/Dust/Odour)	Field PID Reading	LAB ID
23-Aug-24	10:48	01400-0339	277	Air	Location 2 Air	*	28	7	4min	normal		

FJAE Shipping & Receiving

Call Out  Expedite   
Priority   
# of Coolers  Air   
# of Carboys  Ground

Environmental Division  
Fort St. John  
Work Order Reference  
**FJ2402552**



Telephone : +1 250 281 5517

SPECIAL INSTRUCTIONS/COMMENTS:  
\* -> filled to 7Hg pressure  
stent pressure 28 Hg  
-> Filled for 4 min.

This Chain of Custody Form is only to be used for Air Quality Samples

Matrix Type: Soil Gas Vapour = SG Indoor Air = IA  
Ambient Air = AA Industrial Hygiene = IH

COLD   
COOLING INITIATED   
AMBIENT

SAMPLED BY: Fahim Nazari  
RELINQUISHED BY: [Redacted]

DATE & TIME: Aug 23-2024  
RECEIVED BY: [Redacted]  
RECEIVED AT LAB BY: [Redacted]

OBSERVATIONS: Yes  No   
If yes add SIF

Notes

1. Quote number must be pro...  
2. TAT may vary dependent on complexity of analysis and lab workload at time of submission. Please contact the lab to confirm TATs.  
3. Any known or suspected hazards relating to a sample must be noted on the chain of custody in comments section.

22°C  
Aug 23/24 - 12:00pm

60 NORTHLAND ROAD, UNIT 1  
WATERLOO, ON N2V 2B8

Phone: (519) 886-6910  
Fax: (519) 886-9047  
Toll Free: 1-800-668-9878



AIR QUALITY CHAIN OF CUSTODY FORM - Canister/Tube/Gas Bag

<b>Note:</b> All TAT Quoted is in business days which exclude statutory holidays and weekends. TAT of samples received past 3:00 pm on Saturday / Sunday begin the next day.	DATE REQUIRED	SERVICE REQUESTED	Rush 3 day (100%)	<input type="checkbox"/>
		10 day (regular)	Rush 2 day (200%)	<input type="checkbox"/>
		Rush 5 day (50%)	Rush 1 day (300%) - Enquire	<input type="checkbox"/>

COMPANY NAME: Tetra Tech  
OFFICE: 140 Quarry Park Blvd, Calgary  
PROJECT MANAGER: Andrea McMillan  
PROJECT #: 704-ENW.Genv03704-02  
PHONE: 403-203-3355 FAX: [blank]  
ACCOUNT #: [blank]  
QUOTATION #: [blank] PO #: 704-ENW.Genv03704-02

REGULATION: [blank]  
CRITERIA: [blank]  
OTHER INFORMATION: [blank]  
REPORT FORMAT/DISTRIBUTION: EMAIL  FAX [blank] BOTH [blank]  
SELECT: PDF [blank] DIGITAL [blank] BOTH [blank]  
EMAIL 1: [blank]  
EMAIL 2: [blank]

All rush work requires lab approval before sample submission

SUBMISSION #: [blank]  
ENTERED BY: [blank]  
DATE/TIME ENTERED: [blank]  
BIN #: [blank]

Field Conditions (Rain/Wind/Dust/Odour): [blank]  
Field PID Reading: [blank]  
LAB ID: [blank]

SAMPLING INFORMATION				
Sample Date/Time		Canister or Tube ID#	Regulator Serial #	Matrix Type
Date (dd-mmm-yy)	Time (hh:mm)	(e.g. 060000-XXXX or G0XXXXXXSVI)	CS1200-XXXX or GXX	
23-Aug-24	10:48	01400-0339	277	Air

TUBE AIR VOLUME - L	or	m <sup>3</sup>	STARTING PRESSURE - Pre-Sampling ("Hg)	ENDING PRESSURE - Post Sampling ("Hg)	COLLECTION TIME (HRS)
*	✓	✓	28	7	4min

Matrix Type: Undissolved methane, Undissolved H<sub>2</sub>S

FJAE Shipping & Receiving  
Call Out Expedite  
Priority  
# of Coolers Air  
# of Carboys Ground

Environmental Division  
Fort St. John  
Work Order Reference  
**FJ2402552**



Telephone: +1 250 261 5617

SPECIAL INSTRUCTIONS/COMMENTS: \* -> filled to 7Hg pressure start pressure 28Hg -> filled for 4min.

SAMPLED BY: Fahim Nazari  
RELINQUISHED BY: [Redacted]

Matrix Type: Soil Gas Vapour = SG, Indoor Air = IA, Ambient Air = AA, Industrial Hygiene = IH

DATE & TIME: Aug 23-2024  
RECEIVED BY: [Redacted]  
RECEIVED AT LAB BY: [Redacted]

COOLING INITIATED: COLD , AMBIENT   
OBSERVATIONS: Yes  No  If yes add SIF

1. Quote number must be provided... 2. TAT may vary dependent on complexity of analysis and lab workload at time of submission. Please contact the lab to confirm TATs. 3. Any known or suspected hazards relating to a sample must be noted on the chain of custody in comments section.

22°C  
Aug 23/24 - 12:00pm



**1) TO SORENT TUBE & CAPS - \$180.00 2) TO DIFFUSION CAP - \$30.00 3) CAPLOCK TOOL SET - \$85.00 4) VACUUM GAUGE - \$240.00 5) BOTTLEVAC CANISTER - \$135.00 6) PROTECTIVE CAP - \$25.00 7) CANISTER - 6L: \$850.00 1.4L: \$450.00 8) CONTROLLER - TWA: \$1000.00 GRAV: \$850.00 9) CANISTER STAND - \$75.00 10) DUPLICATE SAMPLER - \$550.00**

**MEDIA REPLACEMENT COSTS: (Media lost or damaged will be charged to the client)**

**RENTAL COSTS: Canister Rental is 2 WEEKS only. After this time additional rental fees apply.**

SEE COMMENTS

Include sampling supplies from other ALS location (yes/no)

Rush Order Prep Charge (<48 hour notice, not including shipping) \$50

Siloxane Kit - \$100 each (KIT: \$50, 1D tube prep/rental: \$50)

Field Bags (contact the lab before SUBMITTING) -\$28 unpurged -\$45 purged

Nut & Ferrule Sets - \$8 per set

Teflon Tubing - \$3 per foot -Total length (ft)

Valve Adaptor for Soil Vapour \$5

Duplicate Sampler - \$45 canister

Valve Adaptor for Soil Vapour

Canister Stands

Caplock Tool

Pressure Gauge

PG28

Quantity

Chargeable Supplies

Valve Adaptor for Soil Vapour

Canister Stands

Caplock Tool

Pressure Gauge

PG28

Quantity

Other Sampling Supplies

Calibration Tube for SVI (yes/no)

Active SVI Tubes

Diffusive Caps

Passive CarboPak X Tubes

Number of Canisters

Tip Blank

No Restricor

3 mins

7 mins

14 mins

40 mins

1.4L Canister

Number of Canisters

Tip Blank

No Restricor

4 mins

10 mins

20 mins

60 mins

Regulator Times

Regulator Quantity

Parameters/ Product Codes

Canister/Tube Identification #

Initial Pressure/Flow (mmHg/mL per min)

Controller # Identification #

Methane, S629M, Full Sulfur Scan S630

01400-0339

-28.7

G165

Canister Size/Tube	Regulator Times	Regulator Quantity	Parameters/ Product Codes	Canister/Tube Identification #	Initial Pressure/Flow (mmHg/mL per min)	Controller # Identification #
6L Canister	24 hr		Methane, S629M, Full Sulfur Scan S630	01400-0339	-28.7	G165
	12 hr					
	8 hr					
	4 hr					
	1 hr					
	0.5 hr					
	Tip Blank					
	Number of Canisters					
	Tip Blank					
	No Restricor					
1.4L Canister	40 mins		Methane, S629M, Full Sulfur Scan S630	01400-0339	-28.7	G165
	14 mins					
	7 mins					
	3 mins					
	No Restricor					
	Tip Blank					
Bottle Vacs	40 mins		Methane, S629M, Full Sulfur Scan S630	01400-0339	-28.7	G165
	14 mins					
	7 mins					
	3 mins					
	No Restricor					
	Tip Blank					
	Number of Canisters					
	Tip Blank					
	No Restricor					
	Tip Blank					

**1. What type of air is being sampled? Check all appropriate types in the Additional Information Box below**

**2. Please provide a list of compounds and reporting limits that are required. Include regulation & target list (attach to email)**

**3. What is your planned canister sampling time? Options listed under Regulator Times**

**4. Trip blanks will be shipped pre-filled unless specifically requested below**

**Note: If analysis required is DIFFERENT than what is LISTED on this form, email nawtr.airmedia@tetratech.com ASAP to confirm the media was adequately proofed.**

Completion of all Sections is Mandatory

**Shipping Method:**  Regular (ALS will cover shipping cost)  Rush (Client will be billed for shipping costs, please confirm with Account Manager)  External Courier  Pickup at ALS  ALS Drivers

**Shipping Company:**  FedEx  Purator  DHL  UPS  Other  N/A

**Tracking Number:** \_\_\_\_\_

**Location:** \_\_\_\_\_

**Client Contact:** TetraTech  
Andrea McMillan  
Gas and GW sampling  
TetraTech MSA  
ALS Fort St John BC, 11007 Alaska Road, Fort St John, BC, V1J 6P3 for client P/U  
687-830-1121  
andrea.mcmillan@tetratech.com

**Client Project/PO:** \_\_\_\_\_

**Quote #:** (mandatory) \_\_\_\_\_

**Delivery To:** \_\_\_\_\_

**Telephone Number:** \_\_\_\_\_

**SHIP TO (include email):** \_\_\_\_\_

**Client:** Wendy Sears  
ORDER TAKEN BY: \_\_\_\_\_  
ORDER DATE: 21-Aug-24  
AM REVIEWER: DSTASTNY  
CLIENT EXPECT DATE: 23-Aug-24  
ORDER FILLED BY: YB  
PEER REVIEWER: \_\_\_\_\_  
DATE COMPLETED: 21-Aug-24

**SHIPPING INFO:**  ship PURATOR EXPRESS TODAY 21AUG for delivery 23AUG to ALS P34

Form MUST be reviewed & initialed by an ALS Account Manager prior to submission to NAWTR AIRMEDIA REQUEST (nawtr.airmedia@tetratech.com)

COMPLETE Blue sections. Grey sections are for INTERNAL USE ONLY



AIR SAMPLING MEDIA REQUEST FORM

ALS Environmental  
60 Northland Drive, Unit 1  
Waterloo, ON  
N2V 2S8



## CERTIFICATE OF ANALYSIS

<p><b>Work Order</b> : <b>FJ2402712</b></p> <p><b>Client</b> : <b>Tetra Tech Canada Inc.</b></p> <p><b>Contact</b> : Andrea McMillan</p> <p><b>Address</b> : 110, 140 Quarry Park Blvd SE Calgary AB Canada T2C 3G3</p> <p><b>Telephone</b> : ----</p> <p><b>Project</b> : 704-ENW.GENV03704-02- Rose Prairie</p> <p><b>PO</b> : ----</p> <p><b>C-O-C number</b> : ----</p> <p><b>Sampler</b> : Thomas Kolb</p> <p><b>Site</b> : ----</p> <p><b>Quote number</b> : VA24-EBAE100-013</p> <p><b>No. of samples received</b> : 1</p> <p><b>No. of samples analysed</b> : 1</p>	<p><b>Page</b> : 1 of 9</p> <p><b>Laboratory</b> : ALS Environmental - Fort St. John</p> <p><b>Account Manager</b> : Brent Mack</p> <p><b>Address</b> : 11007 Alaska Road Fort St. John BC Canada V1J 6P3</p> <p><b>Telephone</b> : 778-370-3279</p> <p><b>Date Samples Received</b> : 09-Sep-2024 13:10</p> <p><b>Date Analysis Commenced</b> : 11-Sep-2024</p> <p><b>Issue Date</b> : 17-Sep-2024 16:02</p>
---	---

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Certificate of Analysis contains the following information:

- General Comments
- Analytical Results
- Surrogate Control Limits

Additional information pertinent to this report will be found in the following separate attachments: Quality Control Report, QC Interpretive report to assist with Quality Review and Sample Receipt Notification (SRN).

### Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

<i>Signatories</i>	<i>Position</i>	<i>Laboratory Department</i>
Daniel Shabestani	Lab Assistant	Metals, Burnaby, British Columbia
David Tremblett	VOC Section Supervisor	Air Quality, Waterloo, Ontario
Elke Tabora	Lab Analyst	Inorganics, Calgary, Alberta
Janice Leung	Supervisor - Organics Instrumentation	Organics, Burnaby, British Columbia
Kate Dimitrova	Supervisor - Inorganic	Inorganics, Burnaby, British Columbia
Kevin Duarte	Supervisor - Metals ICP Instrumentation	Metals, Burnaby, British Columbia
Kim Jensen	Department Manager - Metals	Inorganics, Burnaby, British Columbia
Kim Jensen	Department Manager - Metals	Metals, Burnaby, British Columbia
Leon Yang	Analyst	Inorganics, Burnaby, British Columbia
Maya Urquhart	Lab Analyst	Metals, Burnaby, British Columbia
Monica Ko	Lab Assistant	Inorganics, Burnaby, British Columbia
Owen Cheng		Metals, Burnaby, British Columbia
Walt Kippenhuck	Supervisor - Inorganic	Inorganics, Waterloo, Ontario



## General Comments

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Refer to the ALS Quality Control Interpretive report (QCI) for applicable references and methodology summaries. Reference methods may incorporate modifications to improve performance.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis.

Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

Please refer to Quality Control Interpretive report (QCI) for information regarding Holding Time compliance.

Key : CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances  
LOR: Limit of Reporting (detection limit).

<i>Unit</i>	<i>Description</i>
-	no units
% T/cm	% transmittance per centimetre
µg/L	micrograms per litre
µS/cm	microsiemens per centimetre
AU/cm	absorbance units per centimetre
CU	colour units (1 cu = 1 mg/l pt)
mg/L	milligrams per litre
NTU	nephelometric turbidity units
pH units	pH units
ppmv	parts per million (volume/volume)

<: less than.

>: greater than.

Surrogate: An analyte that is similar in behavior to target analyte(s), but that does not occur naturally in environmental samples. For applicable tests, surrogates are added to samples prior to analysis as a check on recovery.

Test results reported relate only to the samples as received by the laboratory.

UNLESS OTHERWISE STATED on SRN or QCI Report, ALL SAMPLES WERE RECEIVED IN ACCEPTABLE CONDITION.

## Workorder Comments

No container received for F2 analysis, but requested on Chain of Custody / analytical request form; subsample cannot be obtained from other containers to meet request. The requested analysis cannot be performed.

## Qualifiers

<i>Qualifier</i>	<i>Description</i>
DLA	Detection Limit adjusted for required dilution.



Page : 4 of 9  
Work Order : FJ2402712  
Client : Tetra Tech Canada Inc.  
Project : 704-ENW.GENV03704-02- Rose Prairie

---

*DLDS*                      *Detection Limit Raised: Dilution required due to high Dissolved Solids / Electrical Conductivity.*

---



## Analytical Results

Sub-Matrix: Water					Client sample ID	LOCATION 3	---	---	---	---
(Matrix: Water)					Client sampling date / time	09-Sep-2024 11:07	---	---	---	---
Analyte	CAS Number	Method/Lab	LOR	Unit	FJ2402712-001	-----	-----	-----	-----	
					Result	---	---	---	---	
<b>Physical Tests</b>										
Absorbance, UV (@ 254nm)	---	E404/VA	0.0050	AU/cm	0.0620	---	---	---	---	
Alkalinity, bicarbonate (as CaCO3)	---	E290/VA	1.0	mg/L	861	---	---	---	---	
Alkalinity, carbonate (as CaCO3)	---	E290/VA	1.0	mg/L	20.8	---	---	---	---	
Alkalinity, hydroxide (as CaCO3)	---	E290/VA	1.0	mg/L	<1.0	---	---	---	---	
Alkalinity, phenolphthalein (as CaCO3)	---	E290/VA	1.0	mg/L	10.4	---	---	---	---	
Alkalinity, total (as CaCO3)	---	E290/VA	1.0	mg/L	882	---	---	---	---	
Colour, true	---	E329/VA	5.0	CU	<5.0	---	---	---	---	
Conductivity	---	E100/VA	2.0	µS/cm	1800	---	---	---	---	
Hardness (as CaCO3), dissolved	---	EC100/VA	0.60	mg/L	353	---	---	---	---	
Hardness (as CaCO3), from total Ca/Mg	---	EC100A/VA	0.60	mg/L	350	---	---	---	---	
pH	---	E108/VA	0.10	pH units	8.39	---	---	---	---	
Solids, total dissolved [TDS]	---	E162/VA	10	mg/L	1340	---	---	---	---	
Turbidity	---	E121/VA	0.10	NTU	316	---	---	---	---	
Transmittance, UV (@ 254nm)	---	E404/VA	1.0	% T/cm	86.7	---	---	---	---	
<b>Anions and Nutrients</b>										
Bromide	24959-67-9	E235.Br-L/VA	0.050	mg/L	<0.500 <sup>DLDS</sup>	---	---	---	---	
Chloride	16887-00-6	E235.Cl/VA	0.50	mg/L	38.8	---	---	---	---	
Fluoride	16984-48-8	E235.F/VA	0.020	mg/L	<0.200 <sup>DLDS</sup>	---	---	---	---	
Nitrate (as N)	14797-55-8	E235.NO3-L/V A	0.0050	mg/L	<0.0500 <sup>DLDS</sup>	---	---	---	---	
Nitrite (as N)	14797-65-0	E235.NO2-L/V A	0.0010	mg/L	<0.0100 <sup>DLDS</sup>	---	---	---	---	
Sulfate (as SO4)	14808-79-8	E235.SO4/VA	0.30	mg/L	136	---	---	---	---	
<b>Cyanides</b>										
Cyanide, strong acid dissociable (Total)	---	E333/WT	0.0050	mg/L	<0.0050	---	---	---	---	
<b>Organic / Inorganic Carbon</b>										
Carbon, dissolved organic [DOC]	---	E358-L/CG	0.50	mg/L	3.37	---	---	---	---	
Carbon, total organic [TOC]	---	E355-L/CG	0.50	mg/L	7.25	---	---	---	---	
<b>Total Sulfides</b>										
Sulfide, total (as H2S)	7783-06-4	E395-H/VA	0.011	mg/L	<0.011	---	---	---	---	



## Analytical Results

Sub-Matrix: Water					Client sample ID	LOCATION 3	----	----	----	----
(Matrix: Water)					Client sampling date / time	09-Sep-2024 11:07	----	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	FJ2402712-001	-----	-----	-----	-----	
						Result	---	---	---	---
<b>Total Sulfides</b>										
Sulfide, total (as S)	18496-25-8	E395-H/VA	0.010	mg/L	<0.010	---	---	---	---	
<b>Total Metals</b>										
Aluminum, total	7429-90-5	E420/VA	0.0030	mg/L	3.14	---	---	---	---	
Antimony, total	7440-36-0	E420/VA	0.00010	mg/L	0.00099	---	---	---	---	
Arsenic, total	7440-38-2	E420/VA	0.00010	mg/L	0.00362	---	---	---	---	
Barium, total	7440-39-3	E420/VA	0.00010	mg/L	0.206	---	---	---	---	
Beryllium, total	7440-41-7	E420/VA	0.000100	mg/L	0.000213	---	---	---	---	
Bismuth, total	7440-69-9	E420/VA	0.000050	mg/L	<0.000100 <sup>DLA</sup>	---	---	---	---	
Boron, total	7440-42-8	E420/VA	0.010	mg/L	0.319	---	---	---	---	
Cadmium, total	7440-43-9	E420/VA	0.0000050	mg/L	0.000318	---	---	---	---	
Calcium, total	7440-70-2	E420/VA	0.050	mg/L	55.3	---	---	---	---	
Cesium, total	7440-46-2	E420/VA	0.000010	mg/L	0.00153	---	---	---	---	
Chromium, total	7440-47-3	E420/VA	0.000050	mg/L	0.00817	---	---	---	---	
Cobalt, total	7440-48-4	E420/VA	0.00010	mg/L	0.00341	---	---	---	---	
Copper, total	7440-50-8	E420/VA	0.000050	mg/L	0.0134	---	---	---	---	
Iron, total	7439-89-6	E420/VA	0.010	mg/L	18.8	---	---	---	---	
Lead, total	7439-92-1	E420/VA	0.000050	mg/L	0.00562	---	---	---	---	
Lithium, total	7439-93-2	E420/VA	0.0010	mg/L	0.0228	---	---	---	---	
Magnesium, total	7439-95-4	E420/VA	0.0050	mg/L	51.4	---	---	---	---	
Manganese, total	7439-96-5	E420/VA	0.00010	mg/L	0.251	---	---	---	---	
Mercury, total	7439-97-6	E508/VA	0.0000050	mg/L	0.0000608	---	---	---	---	
Molybdenum, total	7439-98-7	E420/VA	0.000050	mg/L	0.00397	---	---	---	---	
Nickel, total	7440-02-0	E420/VA	0.000050	mg/L	0.0120	---	---	---	---	
Phosphorus, total	7723-14-0	E420/VA	0.050	mg/L	0.140	---	---	---	---	
Potassium, total	7440-09-7	E420/VA	0.050	mg/L	4.60	---	---	---	---	
Rubidium, total	7440-17-7	E420/VA	0.00020	mg/L	0.00991	---	---	---	---	
Selenium, total	7782-49-2	E420/VA	0.000050	mg/L	0.00190	---	---	---	---	
Silicon, total	7440-21-3	E420/VA	0.10	mg/L	10.0	---	---	---	---	
Silver, total	7440-22-4	E420/VA	0.000010	mg/L	0.000122	---	---	---	---	
Sodium, total	7440-23-5	E420/VA	0.050	mg/L	362	---	---	---	---	



## Analytical Results

Sub-Matrix: Water					Client sample ID	LOCATION 3	----	----	----	----
(Matrix: Water)					Client sampling date / time	09-Sep-2024 11:07	----	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	FJ2402712-001	-----	-----	-----	-----	
					Result	---	---	---	---	
<b>Total Metals</b>										
Strontium, total	7440-24-6	E420/VA	0.00020	mg/L	1.04	---	---	---	---	
Sulfur, total	7704-34-9	E420/VA	0.50	mg/L	57.8	---	---	---	---	
Tellurium, total	13494-80-9	E420/VA	0.00020	mg/L	<0.00040 <sup>DLA</sup>	---	---	---	---	
Thallium, total	7440-28-0	E420/VA	0.000010	mg/L	0.000088	---	---	---	---	
Thorium, total	7440-29-1	E420/VA	0.00010	mg/L	0.00150	---	---	---	---	
Tin, total	7440-31-5	E420/VA	0.00010	mg/L	<0.00020 <sup>DLA</sup>	---	---	---	---	
Titanium, total	7440-32-6	E420/VA	0.00030	mg/L	0.0187	---	---	---	---	
Tungsten, total	7440-33-7	E420/VA	0.00010	mg/L	<0.00020 <sup>DLA</sup>	---	---	---	---	
Uranium, total	7440-61-1	E420/VA	0.000010	mg/L	0.00179	---	---	---	---	
Vanadium, total	7440-62-2	E420/VA	0.00050	mg/L	0.0118	---	---	---	---	
Zinc, total	7440-66-6	E420/VA	0.0030	mg/L	0.0767	---	---	---	---	
Zirconium, total	7440-67-7	E420/VA	0.00020	mg/L	<0.00040 <sup>DLA</sup>	---	---	---	---	
<b>Dissolved Metals</b>										
Aluminum, dissolved	7429-90-5	E421/VA	0.0010	mg/L	0.0078	---	---	---	---	
Antimony, dissolved	7440-36-0	E421/VA	0.00010	mg/L	0.00091	---	---	---	---	
Arsenic, dissolved	7440-38-2	E421/VA	0.00010	mg/L	0.00090	---	---	---	---	
Barium, dissolved	7440-39-3	E421/VA	0.00010	mg/L	0.0483	---	---	---	---	
Beryllium, dissolved	7440-41-7	E421/VA	0.000100	mg/L	<0.000100	---	---	---	---	
Bismuth, dissolved	7440-69-9	E421/VA	0.000050	mg/L	<0.000050	---	---	---	---	
Boron, dissolved	7440-42-8	E421/VA	0.010	mg/L	0.371	---	---	---	---	
Cadmium, dissolved	7440-43-9	E421/VA	0.0000050	mg/L	0.0000304	---	---	---	---	
Calcium, dissolved	7440-70-2	E421/VA	0.050	mg/L	62.6	---	---	---	---	
Cesium, dissolved	7440-46-2	E421/VA	0.000010	mg/L	0.000053	---	---	---	---	
Chromium, dissolved	7440-47-3	E421/VA	0.00050	mg/L	<0.00050	---	---	---	---	
Cobalt, dissolved	7440-48-4	E421/VA	0.00010	mg/L	0.00048	---	---	---	---	
Copper, dissolved	7440-50-8	E421/VA	0.00020	mg/L	<0.00020	---	---	---	---	
Iron, dissolved	7439-89-6	E421/VA	0.010	mg/L	0.178	---	---	---	---	
Lead, dissolved	7439-92-1	E421/VA	0.000050	mg/L	<0.000050	---	---	---	---	
Lithium, dissolved	7439-93-2	E421/VA	0.0010	mg/L	0.0206	---	---	---	---	
Magnesium, dissolved	7439-95-4	E421/VA	0.0050	mg/L	47.7	---	---	---	---	



## Analytical Results

Sub-Matrix: Water					Client sample ID	LOCATION 3	----	----	----	----
(Matrix: Water)					Client sampling date / time	09-Sep-2024 11:07	---	---	---	---
Analyte	CAS Number	Method/Lab	LOR	Unit	FJ2402712-001	-----	-----	-----	-----	
					Result	---	---	---	---	
<b>Dissolved Metals</b>										
Manganese, dissolved	7439-96-5	E421/VA	0.00010	mg/L	0.110	---	---	---	---	
Mercury, dissolved	7439-97-6	E509/VA	0.0000050	mg/L	<0.0000050	---	---	---	---	
Molybdenum, dissolved	7439-98-7	E421/VA	0.000050	mg/L	0.00392	---	---	---	---	
Nickel, dissolved	7440-02-0	E421/VA	0.00050	mg/L	0.00152	---	---	---	---	
Phosphorus, dissolved	7723-14-0	E421/VA	0.050	mg/L	<0.050	---	---	---	---	
Potassium, dissolved	7440-09-7	E421/VA	0.050	mg/L	4.40	---	---	---	---	
Rubidium, dissolved	7440-17-7	E421/VA	0.00020	mg/L	0.00240	---	---	---	---	
Selenium, dissolved	7782-49-2	E421/VA	0.000050	mg/L	0.00176	---	---	---	---	
Silicon, dissolved	7440-21-3	E421/VA	0.050	mg/L	4.86	---	---	---	---	
Silver, dissolved	7440-22-4	E421/VA	0.000010	mg/L	<0.000010	---	---	---	---	
Sodium, dissolved	7440-23-5	E421/VA	0.050	mg/L	360	---	---	---	---	
Strontium, dissolved	7440-24-6	E421/VA	0.00020	mg/L	0.994	---	---	---	---	
Sulfur, dissolved	7704-34-9	E421/VA	0.50	mg/L	51.0	---	---	---	---	
Tellurium, dissolved	13494-80-9	E421/VA	0.00020	mg/L	<0.00020	---	---	---	---	
Thallium, dissolved	7440-28-0	E421/VA	0.000010	mg/L	<0.000010	---	---	---	---	
Thorium, dissolved	7440-29-1	E421/VA	0.00010	mg/L	<0.00010	---	---	---	---	
Tin, dissolved	7440-31-5	E421/VA	0.00010	mg/L	<0.00010	---	---	---	---	
Titanium, dissolved	7440-32-6	E421/VA	0.00030	mg/L	<0.00030	---	---	---	---	
Tungsten, dissolved	7440-33-7	E421/VA	0.00010	mg/L	<0.00010	---	---	---	---	
Uranium, dissolved	7440-61-1	E421/VA	0.000010	mg/L	0.00141	---	---	---	---	
Vanadium, dissolved	7440-62-2	E421/VA	0.00050	mg/L	<0.00050	---	---	---	---	
Zinc, dissolved	7440-66-6	E421/VA	0.0010	mg/L	0.0022	---	---	---	---	
Zirconium, dissolved	7440-67-7	E421/VA	0.00020	mg/L	0.00035	---	---	---	---	
Dissolved mercury filtration location	----	EP509/VA	-	-	Field	---	---	---	---	
Dissolved metals filtration location	----	EP421/VA	-	-	Field	---	---	---	---	
<b>Dissolved Gases</b>										
Methane	74-82-8	EC614B/WT	5.0	µg/L	<5.0	---	---	---	---	
Methane	74-82-8	E614B/WT	20.8	ppmv	<20.8	---	---	---	---	
<b>Volatile Organic Compounds [Fuels]</b>										
Benzene	71-43-2	E611A/VA	0.50	µg/L	<0.50	---	---	---	---	





## Analytical Results

Sub-Matrix: Water					Client sample ID	LOCATION 3	----	----	----	----
(Matrix: Water)					Client sampling date / time	09-Sep-2024 11:07	----	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	FJ2402712-001	-----	-----	-----	-----	
						Result	---	---	---	---
<b>Volatile Organic Compounds [Fuels]</b>										
Ethylbenzene	100-41-4	E611A/VA	0.50	µg/L	<0.50	---	---	---	---	
Methyl-tert-butyl ether [MTBE]	1634-04-4	E611A/VA	0.50	µg/L	<0.50	---	---	---	---	
Styrene	100-42-5	E611A/VA	0.50	µg/L	<0.50	---	---	---	---	
Toluene	108-88-3	E611A/VA	0.50	µg/L	<0.50	---	---	---	---	
Xylene, m+p-	179601-23-1	E611A/VA	0.40	µg/L	<0.40	---	---	---	---	
Xylene, o-	95-47-6	E611A/VA	0.30	µg/L	<0.30	---	---	---	---	
Xylenes, total	1330-20-7	E611A/VA	0.50	µg/L	<0.50	---	---	---	---	
<b>Hydrocarbons</b>										
VHw (C6-C10)	----	E581.VH+F1/ VA	100	µg/L	<100	---	---	---	---	
F1-BTEX	----	EC580/VA	100	µg/L	<100	---	---	---	---	
VPHw	----	EC580A/VA	100	µg/L	<100	---	---	---	---	
F1 (C6-C10)	----	E581.VH+F1/ VA	100	µg/L	<100	---	---	---	---	
<b>Hydrocarbons Surrogates</b>										
Dichlorotoluene, 3,4-	95-75-0	E581.VH+F1/ VA	1.0	%	73.2	---	---	---	---	
<b>Volatile Organic Compounds Surrogates</b>										
Bromofluorobenzene, 4-	460-00-4	E611A/VA	1.0	%	83.7	---	---	---	---	
Difluorobenzene, 1,4-	540-36-3	E611A/VA	1.0	%	116	---	---	---	---	

Please refer to the General Comments section for an explanation of any result qualifiers detected.

Please refer to the Accreditation section for an explanation of analyte accreditations.

## QUALITY CONTROL INTERPRETIVE REPORT

<p><b>Work Order</b> : <b>FJ2402712</b></p> <p><b>Client</b> : <b>Tetra Tech Canada Inc.</b></p> <p><b>Contact</b> : Andrea McMillan</p> <p><b>Address</b> : 110, 140 Quarry Park Blvd SE Calgary AB Canada T2C 3G3</p> <p><b>Telephone</b> : ----</p> <p><b>Project</b> : 704-ENW.GENV03704-02- Rose Prairie</p> <p><b>PO</b> : ----</p> <p><b>C-O-C number</b> : ----</p> <p><b>Sampler</b> : Thomas Kolb</p> <p><b>Site</b> : ----</p> <p><b>Quote number</b> : VA24-EBAE100-013</p> <p><b>No. of samples received</b> : 1</p> <p><b>No. of samples analysed</b> : 1</p>	<p><b>Page</b> : 1 of 13</p> <p><b>Laboratory</b> : ALS Environmental - Fort St. John</p> <p><b>Account Manager</b> : Brent Mack</p> <p><b>Address</b> : 11007 Alaska Road Fort St. John, British Columbia Canada V1J 6P3</p> <p><b>Telephone</b> : 778-370-3279</p> <p><b>Date Samples Received</b> : 09-Sep-2024 13:10</p> <p><b>Issue Date</b> : 17-Sep-2024 16:02</p>
---	---

This report is automatically generated by the ALS LIMS (Laboratory Information Management System) through evaluation of Quality Control (QC) results and other QA parameters associated with this submission, and is intended to facilitate rapid data validation by auditors or reviewers. The report highlights any exceptions and outliers to ALS Data Quality Objectives, provides holding time details and exceptions, summarizes QC sample frequencies, and lists applicable methodology references and summaries.

**Key**

- Anonymous: Refers to samples which are not part of this work order, but which formed part of the QC process lot.
- CAS Number: Chemical Abstracts Service number is a unique identifier assigned to discrete substances.
- DQO: Data Quality Objective.
- LOR: Limit of Reporting (detection limit).
- RPD: Relative Percent Difference.

### ***Workorder Comments***

Holding times are displayed as "----" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

### ***Summary of Outliers***

#### ***Outliers : Quality Control Samples***

- No Method Blank value outliers occur.
- No Duplicate outliers occur.
- No Laboratory Control Sample (LCS) outliers occur
- Matrix Spike outliers occur - please see following pages for full details.
- No Test sample Surrogate recovery outliers exist.

#### ***Outliers: Reference Material (RM) Samples***

- No Reference Material (RM) Sample outliers occur.

### ***Outliers : Analysis Holding Time Compliance (Breaches)***

- Analysis Holding Time Outliers exist - please see following pages for full details.

### ***Outliers : Frequency of Quality Control Samples***

- No Quality Control Sample Frequency Outliers occur.



**Outliers : Quality Control Samples**

*Duplicates, Method Blanks, Laboratory Control Samples and Matrix Spikes*

Matrix: **Water**

Analyte Group	Laboratory sample ID	Client/Ref Sample ID	Analyte	CAS Number	Method	Result	Limits	Comment
<b>Matrix Spike (MS) Recoveries</b>								
Dissolved Metals	FJ2402712-001	LOCATION 3	Silver, dissolved	7440-22-4	E421	62.2 % <sup>MES</sup>	70.0-130%	Recovery less than lower data quality objective

**Result Qualifiers**

Qualifier	Description
MES	Data Quality Objective was marginally exceeded (by < 10% absolute) for < 10% of analytes in a Multi-Element Scan / Multi-Parameter Scan (considered acceptable as per OMOE & CCME).



## Analysis Holding Time Compliance

This report summarizes extraction / preparation and analysis times and compares each with ALS recommended holding times, which are selected to meet known provincial and /or federal requirements. In the absence of regulatory hold times, ALS establishes recommendations based on guidelines published by organizations such as CCME, US EPA, APHA Standard Methods, ASTM, or Environment Canada (where available). Dates and holding times reported below represent the first dates of extraction or analysis. If subsequent tests or dilutions exceeded holding times, qualifiers are added (refer to COA).

If samples are identified below as having been analyzed or extracted outside of recommended holding times, measurement uncertainties may be increased, and this should be taken into consideration when interpreting results.

Where actual sampling date is not provided on the chain of custody, the date of receipt with time at 00:00 is used for calculation purposes.

Where only the sample date without time is provided on the chain of custody, the sampling date at 00:00 is used for calculation purposes.

Matrix: **Water** Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis				
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval	
				Rec	Actual			Rec	Actual		
<b>Anions and Nutrients : Bromide in Water by IC (Low Level)</b>											
HDPE LOCATION 3	E235.Br-L	09-Sep-2024	11-Sep-2024	28 days	2 days	✔	11-Sep-2024	28 days	2 days	✔	
<b>Anions and Nutrients : Chloride in Water by IC</b>											
HDPE LOCATION 3	E235.Cl	09-Sep-2024	11-Sep-2024	28 days	2 days	✔	11-Sep-2024	28 days	2 days	✔	
<b>Anions and Nutrients : Fluoride in Water by IC</b>											
HDPE LOCATION 3	E235.F	09-Sep-2024	11-Sep-2024	28 days	2 days	✔	11-Sep-2024	28 days	2 days	✔	
<b>Anions and Nutrients : Nitrate in Water by IC (Low Level)</b>											
HDPE LOCATION 3	E235.NO3-L	09-Sep-2024	11-Sep-2024	3 days	2 days	✔	11-Sep-2024	3 days	2 days	✔	
<b>Anions and Nutrients : Nitrite in Water by IC (Low Level)</b>											
HDPE LOCATION 3	E235.NO2-L	09-Sep-2024	11-Sep-2024	3 days	2 days	✔	11-Sep-2024	3 days	2 days	✔	
<b>Anions and Nutrients : Sulfate in Water by IC</b>											
HDPE LOCATION 3	E235.SO4	09-Sep-2024	11-Sep-2024	28 days	2 days	✔	11-Sep-2024	28 days	2 days	✔	
<b>Cyanides : Total Cyanide</b>											
UV-inhibited HDPE - total (sodium hydroxide) LOCATION 3	E333	09-Sep-2024	12-Sep-2024	14 days	3 days	✔	12-Sep-2024	14 days	3 days	✔	



Matrix: **Water** Evaluation: \* = Holding time exceedance ; ✓ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis			
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval
				Rec	Actual			Rec	Actual	
<b>Dissolved Gases : Methane, Ethane, &amp; Ethene by Headspace GC-FID</b>										
Glass vial (sodium bisulfate) LOCATION 3	E614B	09-Sep-2024	----	----	----		13-Sep-2024	14 days	4 days	✓
<b>Dissolved Metals : Dissolved Mercury in Water by CVAAS</b>										
Glass vial dissolved (hydrochloric acid) LOCATION 3	E509	09-Sep-2024	16-Sep-2024	28 days	8 days	✓	16-Sep-2024	28 days	8 days	✓
<b>Dissolved Metals : Dissolved Metals in Water by CRC ICPMS</b>										
HDPE dissolved (nitric acid) LOCATION 3	E421	09-Sep-2024	14-Sep-2024	180 days	5 days	✓	16-Sep-2024	180 days	7 days	✓
<b>Hydrocarbons : VH and F1 by Headspace GC-FID</b>										
Glass vial (sodium bisulfate) LOCATION 3	E581.VH+F1	09-Sep-2024	13-Sep-2024	14 days	4 days	✓	13-Sep-2024	14 days	4 days	✓
<b>Organic / Inorganic Carbon : Dissolved Organic Carbon by Combustion (Low Level)</b>										
Amber glass dissolved (sulfuric acid) LOCATION 3	E358-L	09-Sep-2024	15-Sep-2024	28 days	6 days	✓	16-Sep-2024	28 days	7 days	✓
<b>Organic / Inorganic Carbon : Total Organic Carbon (Non-Purgeable) by Combustion (Low Level)</b>										
Amber glass total (sulfuric acid) LOCATION 3	E355-L	09-Sep-2024	15-Sep-2024	28 days	6 days	✓	16-Sep-2024	28 days	7 days	✓
<b>Physical Tests : Alkalinity Species by Titration</b>										
HDPE LOCATION 3	E290	09-Sep-2024	11-Sep-2024	14 days	2 days	✓	13-Sep-2024	14 days	4 days	✓
<b>Physical Tests : Colour (True) by Spectrometer (5 CU)</b>										
HDPE LOCATION 3	E329	09-Sep-2024	11-Sep-2024	3 days	2 days	✓	11-Sep-2024	3 days	2 days	✓
<b>Physical Tests : Conductivity in Water</b>										
HDPE LOCATION 3	E100	09-Sep-2024	11-Sep-2024	28 days	2 days	✓	13-Sep-2024	28 days	4 days	✓



Matrix: **Water** Evaluation: \* = Holding time exceedance ; ✓ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis					
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval		
				Rec	Actual			Rec	Actual			
<b>Physical Tests : pH by Meter</b>												
HDPE LOCATION 3	E108	09-Sep-2024	11-Sep-2024	0.25 hrs	42 hrs	*	EHTR-FM	13-Sep-2024	0.25 hrs	98 hrs	*	EHTR-FM
<b>Physical Tests : TDS by Gravimetry</b>												
HDPE LOCATION 3	E162	09-Sep-2024	----	----	----			15-Sep-2024	7 days	6 days	✓	
<b>Physical Tests : Turbidity by Nephelometry</b>												
HDPE LOCATION 3	E121	09-Sep-2024	----	----	----			12-Sep-2024	3 days	3 days	✓	
<b>Physical Tests : UV Absorbance and Transmittance by Spectrometry</b>												
HDPE LOCATION 3	E404	09-Sep-2024	----	----	----			12-Sep-2024	3 days	3 days	✓	
<b>Total Metals : Total Mercury in Water by CVAAS</b>												
Glass vial total (hydrochloric acid) LOCATION 3	E508	09-Sep-2024	16-Sep-2024	28 days	7 days	✓		16-Sep-2024	28 days	7 days	✓	
<b>Total Metals : Total Metals in Water by CRC ICPMS</b>												
HDPE total (nitric acid) LOCATION 3	E420	09-Sep-2024	13-Sep-2024	180 days	4 days	✓		15-Sep-2024	180 days	6 days	✓	
<b>Total Sulfides : Total Sulfide by Colourimetry (Automated Flow)</b>												
HDPE total (zinc acetate+sodium hydroxide) LOCATION 3	E395-H	09-Sep-2024	----	----	----			12-Sep-2024	7 days	3 days	✓	
<b>Volatile Organic Compounds : BTEX by Headspace GC-MS</b>												
Glass vial (sodium bisulfate) LOCATION 3	E611A	09-Sep-2024	13-Sep-2024	14 days	4 days	✓		13-Sep-2024	14 days	4 days	✓	

**Legend & Qualifier Definitions**

EHTR-FM: Exceeded ALS recommended hold time prior to sample receipt. Field Measurement recommended  
 Rec. HT: ALS recommended hold time (see units).



## Quality Control Parameter Frequency Compliance

The following report summarizes the frequency of laboratory QC samples analyzed within the analytical batches (QC lots) in which the submitted samples were processed. The actual frequency should be greater than or equal to the expected frequency.

Matrix: **Water** Evaluation: ✖ = QC frequency outside specification; ✔ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		Evaluation
			QC	Regular	Actual	Expected	
<b>Analytical Methods</b>							
<b>Laboratory Duplicates (DUP)</b>							
Alkalinity Species by Titration	E290	1644011	1	18	5.5	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1644017	1	13	7.6	5.0	✔
BTEX by Headspace GC-MS	E611A	1648980	1	14	7.1	5.0	✔
Chloride in Water by IC	E235.Cl	1644016	1	15	6.6	5.0	✔
Colour (True) by Spectrometer (5 CU)	E329	1644020	1	1	100.0	5.0	✔
Conductivity in Water	E100	1644009	1	20	5.0	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1654684	1	20	5.0	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1645007	1	20	5.0	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1652740	1	15	6.6	5.0	✔
Fluoride in Water by IC	E235.F	1644015	1	13	7.6	5.0	✔
Methane, Ethane, & Ethene by Headspace GC-FID	E614B	1649070	1	11	9.0	4.5	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1644013	1	18	5.5	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1644014	1	15	6.6	5.0	✔
pH by Meter	E108	1644010	1	20	5.0	5.0	✔
Sulfate in Water by IC	E235.SO4	1644012	1	15	6.6	5.0	✔
TDS by Gravimetry	E162	1652612	1	19	5.2	5.0	✔
Total Cyanide	E333	1648080	1	20	5.0	5.0	✔
Total Mercury in Water by CVAAS	E508	1654017	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1647732	1	20	5.0	5.0	✔
Total Organic Carbon (Non-Purgeable) by Combustion (Low Level)	E355-L	1652739	1	15	6.6	5.0	✔
Total Sulfide by Colourimetry (Automated Flow)	E395-H	1647389	1	8	12.5	5.0	✔
Turbidity by Nephelometry	E121	1646854	1	20	5.0	5.0	✔
UV Absorbance and Transmittance by Spectrometry	E404	1646857	1	2	50.0	5.0	✔
VH and F1 by Headspace GC-FID	E581.VH+F1	1648981	1	11	9.0	5.0	✔
<b>Laboratory Control Samples (LCS)</b>							
Alkalinity Species by Titration	E290	1644011	1	18	5.5	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1644017	1	13	7.6	5.0	✔
BTEX by Headspace GC-MS	E611A	1648980	1	14	7.1	5.0	✔
Chloride in Water by IC	E235.Cl	1644016	1	15	6.6	5.0	✔
Colour (True) by Spectrometer (5 CU)	E329	1644020	1	1	100.0	5.0	✔
Conductivity in Water	E100	1644009	1	20	5.0	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1654684	1	20	5.0	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1645007	1	20	5.0	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1652740	1	15	6.6	5.0	✔
Fluoride in Water by IC	E235.F	1644015	1	13	7.6	5.0	✔
Methane, Ethane, & Ethene by Headspace GC-FID	E614B	1649070	1	11	9.0	4.5	✔





Matrix: **Water** Evaluation: ✖ = QC frequency outside specification; ✔ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		
			QC	Regular	Actual	Expected	Evaluation
<b>Analytical Methods</b>							
<b>Laboratory Control Samples (LCS) - Continued</b>							
Nitrate in Water by IC (Low Level)	E235.NO3-L	1644013	1	18	5.5	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1644014	1	15	6.6	5.0	✔
pH by Meter	E108	1644010	1	20	5.0	5.0	✔
Sulfate in Water by IC	E235.SO4	1644012	1	15	6.6	5.0	✔
TDS by Gravimetry	E162	1652612	1	19	5.2	5.0	✔
Total Cyanide	E333	1648080	1	20	5.0	5.0	✔
Total Mercury in Water by CVAAS	E508	1654017	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1647732	1	20	5.0	5.0	✔
Total Organic Carbon (Non-Purgeable) by Combustion (Low Level)	E355-L	1652739	1	15	6.6	5.0	✔
Total Sulfide by Colourimetry (Automated Flow)	E395-H	1647389	1	8	12.5	5.0	✔
Turbidity by Nephelometry	E121	1646854	1	20	5.0	5.0	✔
UV Absorbance and Transmittance by Spectrometry	E404	1646857	1	2	50.0	5.0	✔
VH and F1 by Headspace GC-FID	E581.VH+F1	1648981	1	11	9.0	5.0	✔
<b>Method Blanks (MB)</b>							
Alkalinity Species by Titration	E290	1644011	1	18	5.5	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1644017	1	13	7.6	5.0	✔
BTEX by Headspace GC-MS	E611A	1648980	1	14	7.1	5.0	✔
Chloride in Water by IC	E235.Cl	1644016	1	15	6.6	5.0	✔
Colour (True) by Spectrometer (5 CU)	E329	1644020	1	1	100.0	5.0	✔
Conductivity in Water	E100	1644009	1	20	5.0	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1654684	1	20	5.0	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1645007	1	20	5.0	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1652740	1	15	6.6	5.0	✔
Fluoride in Water by IC	E235.F	1644015	1	13	7.6	5.0	✔
Methane, Ethane, & Ethene by Headspace GC-FID	E614B	1649070	1	11	9.0	4.5	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1644013	1	18	5.5	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1644014	1	15	6.6	5.0	✔
Sulfate in Water by IC	E235.SO4	1644012	1	15	6.6	5.0	✔
TDS by Gravimetry	E162	1652612	1	19	5.2	5.0	✔
Total Cyanide	E333	1648080	1	20	5.0	5.0	✔
Total Mercury in Water by CVAAS	E508	1654017	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1647732	1	20	5.0	5.0	✔
Total Organic Carbon (Non-Purgeable) by Combustion (Low Level)	E355-L	1652739	1	15	6.6	5.0	✔
Total Sulfide by Colourimetry (Automated Flow)	E395-H	1647389	1	8	12.5	5.0	✔
Turbidity by Nephelometry	E121	1646854	1	20	5.0	5.0	✔
UV Absorbance and Transmittance by Spectrometry	E404	1646857	1	2	50.0	5.0	✔
VH and F1 by Headspace GC-FID	E581.VH+F1	1648981	1	11	9.0	5.0	✔
<b>Matrix Spikes (MS)</b>							
Bromide in Water by IC (Low Level)	E235.Br-L	1644017	1	13	7.6	5.0	✔



Matrix: **Water** Evaluation: ✖ = QC frequency outside specification; ✔ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		
			QC	Regular	Actual	Expected	Evaluation
<i>Analytical Methods</i>							
<b>Matrix Spikes (MS) - Continued</b>							
BTEX by Headspace GC-MS	E611A	1648980	1	14	7.1	5.0	✔
Chloride in Water by IC	E235.Cl	1644016	1	15	6.6	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1654684	1	20	5.0	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1645007	1	20	5.0	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1652740	1	15	6.6	5.0	✔
Fluoride in Water by IC	E235.F	1644015	1	13	7.6	5.0	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1644013	1	18	5.5	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1644014	1	15	6.6	5.0	✔
Sulfate in Water by IC	E235.SO4	1644012	1	15	6.6	5.0	✔
Total Cyanide	E333	1648080	1	20	5.0	5.0	✔
Total Mercury in Water by CVAAS	E508	1654017	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1647732	1	20	5.0	5.0	✔
Total Organic Carbon (Non-Purgeable) by Combustion (Low Level)	E355-L	1652739	1	15	6.6	5.0	✔
Total Sulfide by Colourimetry (Automated Flow)	E395-H	1647389	1	8	12.5	5.0	✔
VH and F1 by Headspace GC-FID	E581.VH+F1	1648981	1	11	9.0	5.0	✔



## Methodology References and Summaries

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Reference methods may incorporate modifications to improve performance (indicated by "mod").

Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Conductivity in Water	E100 ALS Environmental - Vancouver	Water	APHA 2510 (mod)	Conductivity, also known as Electrical Conductivity (EC) or Specific Conductance, is measured by immersion of a conductivity cell with platinum electrodes into a water sample. Conductivity measurements are temperature-compensated to 25°C.
pH by Meter	E108 ALS Environmental - Vancouver	Water	APHA 4500-H (mod)	pH is determined by potentiometric measurement with a pH electrode, and is conducted at ambient laboratory temperature (normally 20 ± 5°C). For high accuracy test results, pH should be measured in the field within the recommended 15 minute hold time.
Turbidity by Nephelometry	E121 ALS Environmental - Vancouver	Water	APHA 2130 B (mod)	Turbidity is measured by the nephelometric method, by measuring the intensity of light scatter under defined conditions.
TDS by Gravimetry	E162 ALS Environmental - Vancouver	Water	APHA 2540 C (mod)	Total Dissolved Solids (TDS) are determined by filtering a sample through a glass fibre filter, with evaporation of the filtrate at 180 ± 2°C for 16 hours or to constant weight, with gravimetric measurement of the residue.
Bromide in Water by IC (Low Level)	E235.Br-L ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Chloride in Water by IC	E235.Cl ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Fluoride in Water by IC	E235.F ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Nitrite in Water by IC (Low Level)	E235.NO2-L ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Nitrate in Water by IC (Low Level)	E235.NO3-L ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Sulfate in Water by IC	E235.SO4 ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.



Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Alkalinity Species by Titration	E290 ALS Environmental - Vancouver	Water	APHA 2320 B (mod)	Total alkalinity is determined by potentiometric titration to a pH 4.5 endpoint. Bicarbonate, carbonate and hydroxide alkalinity are calculated from phenolphthalein alkalinity and total alkalinity values.
Colour (True) by Spectrometer (5 CU)	E329 ALS Environmental - Vancouver	Water	APHA 2120 C (mod)	Colour (True Colour) is determined by filtering a sample through a 0.45 micron membrane filter followed by analysis of the filtrate using the platinum-cobalt colourimetric method. Colour measurements can be highly pH dependent, and apply to the pH of the sample as received (at time of testing), without pH adjustment.
Total Cyanide	E333 ALS Environmental - Waterloo	Water	ISO 14403 (mod)	Total or Strong Acid Dissociable (SAD) Cyanide is determined by Continuous Flow Analyzer (CFA) with in-line UV digestion followed by colourimetric analysis.  Method Limitation: High levels of thiocyanate (SCN) may cause positive interference (up to 0.5% of SCN concentration).
Total Organic Carbon (Non-Purgeable) by Combustion (Low Level)	E355-L ALS Environmental - Calgary	Water	APHA 5310 B (mod)	Total Organic Carbon (Non-Purgeable), also known as NPOC (total), is a direct measurement of TOC after an acidified sample has been purged to remove inorganic carbon (IC). Analysis is by high temperature combustion with infrared detection of CO <sub>2</sub> . NPOC does not include volatile organic species that are purged off with IC. For samples where the majority of total carbon (TC) is comprised of IC (which is common), this method is more accurate and more reliable than the TOC by subtraction method (i.e. TC minus TIC).
Dissolved Organic Carbon by Combustion (Low Level)	E358-L ALS Environmental - Calgary	Water	APHA 5310 B (mod)	Dissolved Organic Carbon (Non-Purgeable), also known as NPOC (dissolved), is a direct measurement of DOC after a filtered (0.45 micron) sample has been acidified and purged to remove inorganic carbon (IC). Analysis is by high temperature combustion with infrared detection of CO <sub>2</sub> . NPOC does not include volatile organic species that are purged off with IC. For samples where the majority of DC (dissolved carbon) is comprised of IC (which is common), this method is more accurate and more reliable than the DOC by subtraction method (i.e. DC minus DIC).
Total Sulfide by Colourimetry (Automated Flow)	E395-H ALS Environmental - Vancouver	Water	APHA 4500 -S E-Auto-Colorimetry	Sulfide is determined using the gas dialysis automated methylene blue colourimetric method. Results expressed "as H <sub>2</sub> S" if reported represent the maximum possible H <sub>2</sub> S concentration based on the total sulfide concentration in the sample. The H <sub>2</sub> S calculation converts Total Sulphide as (S <sub>2</sub> -) and reports it as Total Sulphide as (H <sub>2</sub> S)
UV Absorbance and Transmittance by Spectrometry	E404 ALS Environmental - Vancouver	Water	APHA 5910 B (mod)	UV Absorbance is determined by first filtering a sample through a 0.45 micron filter, followed by UV absorbance measurement in a quartz cell at 254 nm. The analysis is carried out without pH adjustment.
Total Metals in Water by CRC ICPMS	E420 ALS Environmental - Vancouver	Water	EPA 200.2/6020B (mod)	Water samples are digested with nitric and hydrochloric acids, and analyzed by Collision/Reaction Cell ICPMS.  Method Limitation (re: Sulfur): Sulfide and volatile sulfur species may not be recovered by this method.



Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Dissolved Metals in Water by CRC ICPMS	E421 ALS Environmental - Vancouver	Water	APHA 3030B/EPA 6020B (mod)	Water samples are filtered (0.45 um), preserved with nitric acid, and analyzed by Collision/Reaction Cell ICPMS.  Method Limitation (re: Sulfur): Sulfide and volatile sulfur species may not be recovered by this method.
Total Mercury in Water by CVAAS	E508 ALS Environmental - Vancouver	Water	EPA 1631E (mod)	Water samples undergo a cold-oxidation using bromine monochloride prior to reduction with stannous chloride, and analyzed by CVAAS
Dissolved Mercury in Water by CVAAS	E509 ALS Environmental - Vancouver	Water	APHA 3030B/EPA 1631E (mod)	Water samples are filtered (0.45 um), preserved with HCl, then undergo a cold-oxidation using bromine monochloride prior to reduction with stannous chloride, and analyzed by CVAAS.
VH and F1 by Headspace GC-FID	E581.VH+F1 ALS Environmental - Vancouver	Water	BC MOE Lab Manual / CCME PHC in Soil - Tier 1 (mod)	Volatile Hydrocarbons (VH and F1) is analyzed by static headspace GC-FID. Samples are prepared in headspace vials and are heated and agitated on the headspace autosampler, causing VOCs to partition between the aqueous phase and the headspace in accordance with Henry's law.  Analytical methods for CCME Petroleum Hydrocarbons (PHCs) are validated to comply fully with the Reference Method for the Canada-Wide Standard for PHC. Unless qualified, all required quality control criteria of the CCME PHC method have been met, including response factor and linearity requirements.
BTEX by Headspace GC-MS	E611A ALS Environmental - Vancouver	Water	EPA 8260D (mod)	Volatile Organic Compounds (VOCs) are analyzed by static headspace GC-MS. Samples are prepared in headspace vials and are heated and agitated on the headspace autosampler, causing VOCs to partition between the aqueous phase and the headspace in accordance with Henry's law.
Methane, Ethane, & Ethene by Headspace GC-FID	E614B ALS Environmental - Waterloo	Water	EPA REGION 1, NATATTEN.WPD, REV. 1	Volatile hydrocarbons are analyzed by static headspace GC/FID. Samples are prepared in headspace vials and are heated and agitated on the headspace autosampler, causing the analyte(s) to partition between the aqueous phase and the headspace in accordance with Henry's law.
Dissolved Hardness (Calculated)	EC100 ALS Environmental - Vancouver	Water	APHA 2340B	"Hardness (as CaCO <sub>3</sub> ), dissolved" is calculated from the sum of dissolved Calcium and Magnesium concentrations, expressed in CaCO <sub>3</sub> equivalents. "Total Hardness" refers to the sum of Calcium and Magnesium Hardness. Hardness is normally or preferentially calculated from dissolved Calcium and Magnesium concentrations, because it is a property of water due to dissolved divalent cations.
Hardness (Calculated) from Total Ca/Mg	EC100A ALS Environmental - Vancouver	Water	APHA 2340B	"Hardness (as CaCO <sub>3</sub> ), from total Ca/Mg" is calculated from the sum of total Calcium and Magnesium concentrations, expressed in CaCO <sub>3</sub> equivalents. "Total Hardness" refers to the sum of Calcium and Magnesium Hardness. Hardness is normally or preferentially calculated from dissolved Calcium and Magnesium concentrations, because it is a property of water due to dissolved divalent cations. Hardness from total Ca/Mg is normally comparable to Dissolved Hardness in non-turbid waters.



Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
F1-BTEX	EC580 ALS Environmental - Vancouver	Water	CCME PHC in Soil - Tier 1	F1-BTEX is calculated as follows: F1-BTEX = F1 (C6-C10) minus benzene, toluene, ethylbenzene and xylenes (BTEX).
VPH: VH-BTEX-Styrene	EC580A ALS Environmental - Vancouver	Water	BC MOE Lab Manual (VPH in Water and Solids) (mod)	Volatile Petroleum Hydrocarbons (VPH) is calculated as follows: VPHw = Volatile Hydrocarbons (VH C6-C10) minus benzene, toluene, ethylbenzene, xylenes (BTEX) and styrene.
Methane, Ethane, & Ethene by Headspace GC-FID	EC614B ALS Environmental - Waterloo	Water	Unit Conversion	Convert ppmV to ug/L

Preparation Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Preparation for Total Organic Carbon by Combustion	EP355 ALS Environmental - Calgary	Water		Preparation for Total Organic Carbon by Combustion
Preparation for Dissolved Organic Carbon for Combustion	EP358 ALS Environmental - Calgary	Water	APHA 5310 B (mod)	Preparation for Dissolved Organic Carbon
Dissolved Metals Water Filtration	EP421 ALS Environmental - Vancouver	Water	APHA 3030B	Water samples are filtered (0.45 um), and preserved with HNO3.
Dissolved Mercury Water Filtration	EP509 ALS Environmental - Vancouver	Water	APHA 3030B	Water samples are filtered (0.45 um), and preserved with HCl.
VOCs Preparation for Headspace Analysis	EP581 ALS Environmental - Vancouver	Water	EPA 5021A (mod)	Samples are prepared in headspace vials and are heated and agitated on the headspace autosampler. An aliquot of the headspace is then injected into a GC-MS-FID.

## QUALITY CONTROL REPORT

<p><b>Work Order</b> : <b>FJ2402712</b></p> <p>Client : Tetra Tech Canada Inc.</p> <p>Contact : Andrea McMillan</p> <p>Address : 110, 140 Quarry Park Blvd SE Calgary AB Canada T2C 3G3</p> <p>Telephone : ----</p> <p>Project : 704-ENW.GENV03704-02- Rose Prairie</p> <p>PO : ----</p> <p>C-O-C number : ----</p> <p>Sampler : Thomas Kolb</p> <p>Site : ----</p> <p>Quote number : VA24-EBAE100-013</p> <p>No. of samples received : 1</p> <p>No. of samples analysed : 1</p>	<p>Page : 1 of 20</p> <p>Laboratory : ALS Environmental - Fort St. John</p> <p>Account Manager : Brent Mack</p> <p>Address : 11007 Alaska Road Fort St. John, British Columbia Canada V1J 6P3</p> <p>Telephone : 778-370-3279</p> <p>Date Samples Received : 09-Sep-2024 13:10</p> <p>Date Analysis Commenced : 11-Sep-2024</p> <p>Issue Date : 17-Sep-2024 16:02</p>
--	---

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Quality Control Report contains the following information:

- Laboratory Duplicate (DUP) Report; Relative Percent Difference (RPD) and Data Quality Objectives
- Matrix Spike (MS) Report; Recovery and Data Quality Objectives
- Method Blank (MB) Report; Recovery and Data Quality Objectives
- Laboratory Control Sample (LCS) Report; Recovery and Data Quality Objectives

### Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

Signatories	Position	Laboratory Department
Daniel Shabestani	Lab Assistant	Vancouver Metals, Burnaby, British Columbia
David Tremblett	VOC Section Supervisor	Waterloo Air Quality, Waterloo, Ontario
Elke Tabora	Lab Analyst	Calgary Inorganics, Calgary, Alberta
Janice Leung	Supervisor - Organics Instrumentation	Vancouver Organics, Burnaby, British Columbia
Kate Dimitrova	Supervisor - Inorganic	Vancouver Inorganics, Burnaby, British Columbia
Kevin Duarte	Supervisor - Metals ICP Instrumentation	Vancouver Metals, Burnaby, British Columbia
Kim Jensen	Department Manager - Metals	Vancouver Inorganics, Burnaby, British Columbia
Kim Jensen	Department Manager - Metals	Vancouver Metals, Burnaby, British Columbia
Leon Yang	Analyst	Vancouver Inorganics, Burnaby, British Columbia
Maya Urquhart	Lab Analyst	Vancouver Metals, Burnaby, British Columbia
Monica Ko	Lab Assistant	Vancouver Inorganics, Burnaby, British Columbia
Owen Cheng		Vancouver Metals, Burnaby, British Columbia
Walt Kippenhuck	Supervisor - Inorganic	Waterloo Inorganics, Waterloo, Ontario

Page : 2 of 20  
Work Order : FJ2402712  
Client : Tetra Tech Canada Inc.  
Project : 704-ENW.GENV03704-02- Rose Prairie



---

## General Comments

The ALS Quality Control (QC) report is optionally provided to ALS clients upon request. ALS test methods include comprehensive QC checks with every analysis to ensure our high standards of quality are met. Each QC result has a known or expected target value, which is compared against predetermined Data Quality Objectives (DQOs) to provide confidence in the accuracy of associated test results. This report contains detailed results for all QC results applicable to this sample submission. Please refer to the ALS Quality Control Interpretation report (QCI) for applicable method references and methodology summaries.

### Key :

Anonymous = Refers to samples which are not part of this work order, but which formed part of the QC process lot.

CAS Number = Chemical Abstracts Service number is a unique identifier assigned to discrete substances.

DQO = Data Quality Objective.

LOR = Limit of Reporting (detection limit).

RPD = Relative Percent Difference

# = Indicates a QC result that did not meet the ALS DQO.

---

## Workorder Comments

Holding times are displayed as "---" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

---





### Laboratory Duplicate (DUP) Report

A Laboratory Duplicate (DUP) is a randomly selected intralaboratory replicate sample. Laboratory Duplicates provide information regarding method precision and sample heterogeneity. ALS DQOs for Laboratory Duplicates are expressed as test-specific limits for Relative Percent Difference (RPD), or as an absolute difference limit of 2 times the LOR for low concentration duplicates within ~ 4-10 times the LOR (cut-off is test-specific).

Sub-Matrix: <b>Water</b>					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
<b>Physical Tests (QC Lot: 1644009)</b>											
FJ2402707-027	Anonymous	Conductivity	----	E100	2.0	µS/cm	994	987	0.707%	10%	----
<b>Physical Tests (QC Lot: 1644010)</b>											
FJ2402707-027	Anonymous	pH	----	E108	0.10	pH units	8.51	8.51	0.00%	4%	----
<b>Physical Tests (QC Lot: 1644011)</b>											
FJ2402707-027	Anonymous	Alkalinity, bicarbonate (as CaCO <sub>3</sub> )	----	E290	1.0	mg/L	159	158	0.379%	200%	----
		Alkalinity, carbonate (as CaCO <sub>3</sub> )	----	E290	1.0	mg/L	10.8	10.8	0.00%	200%	----
		Alkalinity, hydroxide (as CaCO <sub>3</sub> )	----	E290	1.0	mg/L	<1.0	<1.0	0.00%	200%	----
		Alkalinity, phenolphthalein (as CaCO <sub>3</sub> )	----	E290	1.0	mg/L	5.4	5.4	0	Diff <2x LOR	----
		Alkalinity, total (as CaCO <sub>3</sub> )	----	E290	1.0	mg/L	170	169	0.355%	20%	----
<b>Physical Tests (QC Lot: 1644020)</b>											
FJ2402712-001	LOCATION 3	Colour, true	----	E329	5.0	CU	<5.0	<5.0	0	Diff <2x LOR	----
<b>Physical Tests (QC Lot: 1646854)</b>											
FJ2402712-001	LOCATION 3	Turbidity	----	E121	0.10	NTU	316	311	1.60%	15%	----
<b>Physical Tests (QC Lot: 1646857)</b>											
FJ2402712-001	LOCATION 3	Absorbance, UV (@ 254nm)	----	E404	0.0050	AU/cm	0.0620	0.0630	1.60%	20%	----
<b>Physical Tests (QC Lot: 1652612)</b>											
FJ2402712-001	LOCATION 3	Solids, total dissolved [TDS]	----	E162	20	mg/L	1340	1340	0.0374%	20%	----
<b>Anions and Nutrients (QC Lot: 1644012)</b>											
FJ2402707-027	Anonymous	Sulfate (as SO <sub>4</sub> )	14808-79-8	E235.SO4	1.50	mg/L	402	402	0.0187%	20%	----
<b>Anions and Nutrients (QC Lot: 1644013)</b>											
FJ2402707-027	Anonymous	Nitrate (as N)	14797-55-8	E235.NO3-L	0.0250	mg/L	0.713	0.714	0.138%	20%	----
<b>Anions and Nutrients (QC Lot: 1644014)</b>											
FJ2402707-027	Anonymous	Nitrite (as N)	14797-65-0	E235.NO2-L	0.0050	mg/L	<0.0050	<0.0050	0	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1644015)</b>											
FJ2402707-027	Anonymous	Fluoride	16984-48-8	E235.F	0.140	mg/L	<0.142	<0.140	0.002	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1644016)</b>											
FJ2402707-027	Anonymous	Chloride	16887-00-6	E235.Cl	2.50	mg/L	<2.50	<2.50	0	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1644017)</b>											
FJ2402707-027	Anonymous	Bromide	24959-67-9	E235.Br-L	0.250	mg/L	<0.250	<0.250	0	Diff <2x LOR	----



Sub-Matrix: Water					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
<b>Cyanides (QC Lot: 1648080)</b>											
VA24C3606-001	Anonymous	Cyanide, strong acid dissociable (Total)	----	E333	0.0050	mg/L	<0.0050	<0.0050	0	Diff <2x LOR	----
<b>Organic / Inorganic Carbon (QC Lot: 1652739)</b>											
FJ2402699-001	Anonymous	Carbon, total organic [TOC]	----	E355-L	0.50	mg/L	5.60	5.71	1.82%	20%	----
<b>Organic / Inorganic Carbon (QC Lot: 1652740)</b>											
FJ2402699-001	Anonymous	Carbon, dissolved organic [DOC]	----	E358-L	0.50	mg/L	0.71	0.84	0.12	Diff <2x LOR	----
<b>Total Sulfides (QC Lot: 1647389)</b>											
FJ2402712-001	LOCATION 3	Sulfide, total (as S)	18496-25-8	E395-H	0.010	mg/L	<0.010	<0.010	0	Diff <2x LOR	----
<b>Total Metals (QC Lot: 1647732)</b>											
FJ2402701-001	Anonymous	Aluminum, total	7429-90-5	E420	0.0030	mg/L	<0.0030	<0.0030	0	Diff <2x LOR	----
		Antimony, total	7440-36-0	E420	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Arsenic, total	7440-38-2	E420	0.00010	mg/L	0.00015	0.00015	0.0000004	Diff <2x LOR	----
		Barium, total	7440-39-3	E420	0.00010	mg/L	0.331	0.328	0.921%	20%	----
		Beryllium, total	7440-41-7	E420	0.000020	mg/L	<0.000020	<0.000020	0	Diff <2x LOR	----
		Bismuth, total	7440-69-9	E420	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	----
		Boron, total	7440-42-8	E420	0.010	mg/L	0.101	0.098	0.003	Diff <2x LOR	----
		Cadmium, total	7440-43-9	E420	0.0000050	mg/L	<0.0000050	<0.0000050	0	Diff <2x LOR	----
		Calcium, total	7440-70-2	E420	0.050	mg/L	61.7	57.8	6.57%	20%	----
		Cesium, total	7440-46-2	E420	0.000010	mg/L	0.000020	0.000019	0.0000001	Diff <2x LOR	----
		Chromium, total	7440-47-3	E420	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	----
		Cobalt, total	7440-48-4	E420	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	----
		Copper, total	7440-50-8	E420	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	----
		Iron, total	7439-89-6	E420	0.010	mg/L	2.94	2.89	1.71%	20%	----
		Lead, total	7439-92-1	E420	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	----
		Lithium, total	7439-93-2	E420	0.0010	mg/L	0.178	0.178	0.137%	20%	----
		Magnesium, total	7439-95-4	E420	0.0050	mg/L	29.2	30.1	3.09%	20%	----
		Manganese, total	7439-96-5	E420	0.00010	mg/L	0.229	0.232	1.29%	20%	----
		Molybdenum, total	7439-98-7	E420	0.000050	mg/L	0.000075	0.000071	0.000004	Diff <2x LOR	----
		Nickel, total	7440-02-0	E420	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	----
		Phosphorus, total	7723-14-0	E420	0.050	mg/L	0.139	0.130	0.009	Diff <2x LOR	----
		Potassium, total	7440-09-7	E420	0.050	mg/L	2.35	2.38	1.34%	20%	----
		Rubidium, total	7440-17-7	E420	0.00020	mg/L	0.00270	0.00278	2.80%	20%	----
		Selenium, total	7782-49-2	E420	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	----
		Silicon, total	7440-21-3	E420	0.10	mg/L	3.88	3.90	0.468%	20%	----
		Silver, total	7440-22-4	E420	0.000010	mg/L	<0.000010	<0.000010	0	Diff <2x LOR	----



Sub-Matrix: **Water**

Laboratory Duplicate (DUP) Report

Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
<b>Total Metals (QC Lot: 1647732) - continued</b>											
FJ2402701-001	Anonymous	Sodium, total	7440-23-5	E420	0.050	mg/L	250	255	1.73%	20%	---
		Strontium, total	7440-24-6	E420	0.00020	mg/L	0.582	0.571	1.90%	20%	---
		Sulfur, total	7704-34-9	E420	0.50	mg/L	1.61	1.77	0.16	Diff <2x LOR	---
		Tellurium, total	13494-80-9	E420	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	---
		Thallium, total	7440-28-0	E420	0.000010	mg/L	<0.000010	<0.000010	0	Diff <2x LOR	---
		Thorium, total	7440-29-1	E420	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	---
		Tin, total	7440-31-5	E420	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	---
		Titanium, total	7440-32-6	E420	0.00030	mg/L	<0.00030	0.00032	0.00002	Diff <2x LOR	---
		Tungsten, total	7440-33-7	E420	0.00010	mg/L	<0.00010	<0.00010	0	Diff <2x LOR	---
		Uranium, total	7440-61-1	E420	0.000010	mg/L	0.000093	0.000096	0.000003	Diff <2x LOR	---
		Vanadium, total	7440-62-2	E420	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	---
		Zinc, total	7440-66-6	E420	0.0030	mg/L	0.0623	0.0622	0.120%	20%	---
		Zirconium, total	7440-67-7	E420	0.00020	mg/L	0.00027	0.00027	0.0000003	Diff <2x LOR	---
<b>Total Metals (QC Lot: 1654017)</b>											
FJ2402701-001	Anonymous	Mercury, total	7439-97-6	E508	0.0000050	mg/L	<0.0000050	<0.0000050	0	Diff <2x LOR	---
<b>Dissolved Metals (QC Lot: 1645007)</b>											
FJ2402699-001	Anonymous	Aluminum, dissolved	7429-90-5	E421	0.0010	mg/L	0.0013	0.0014	0.0001	Diff <2x LOR	---
		Antimony, dissolved	7440-36-0	E421	0.00010	mg/L	0.00015	0.00014	0.000005	Diff <2x LOR	---
		Arsenic, dissolved	7440-38-2	E421	0.00010	mg/L	0.00282	0.00279	0.971%	20%	---
		Barium, dissolved	7440-39-3	E421	0.00010	mg/L	1.92	1.88	2.34%	20%	---
		Beryllium, dissolved	7440-41-7	E421	0.000020	mg/L	<0.000020	<0.000020	0	Diff <2x LOR	---
		Bismuth, dissolved	7440-69-9	E421	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	---
		Boron, dissolved	7440-42-8	E421	0.010	mg/L	0.165	0.163	1.23%	20%	---
		Cadmium, dissolved	7440-43-9	E421	0.0000050	mg/L	<0.0000050	<0.0000050	0	Diff <2x LOR	---
		Calcium, dissolved	7440-70-2	E421	0.050	mg/L	89.8	87.5	2.53%	20%	---
		Cesium, dissolved	7440-46-2	E421	0.000010	mg/L	0.000028	0.000029	0.0000006	Diff <2x LOR	---
		Chromium, dissolved	7440-47-3	E421	0.00050	mg/L	<0.00050	<0.00050	0	Diff <2x LOR	---
		Cobalt, dissolved	7440-48-4	E421	0.00010	mg/L	0.00153	0.00154	0.516%	20%	---
		Copper, dissolved	7440-50-8	E421	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	---
		Iron, dissolved	7439-89-6	E421	0.010	mg/L	10.6	10.6	0.540%	20%	---
		Lead, dissolved	7439-92-1	E421	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	---
		Lithium, dissolved	7439-93-2	E421	0.0010	mg/L	0.0591	0.0565	4.51%	20%	---
		Magnesium, dissolved	7439-95-4	E421	0.0050	mg/L	23.0	23.2	0.938%	20%	---
		Manganese, dissolved	7439-96-5	E421	0.00010	mg/L	0.524	0.525	0.164%	20%	---



Sub-Matrix: **Water** **Laboratory Duplicate (DUP) Report**

Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
<b>Dissolved Metals (QC Lot: 1645007) - continued</b>											
FJ2402699-001	Anonymous	Molybdenum, dissolved	7439-98-7	E421	0.000050	mg/L	0.00122	0.00117	3.69%	20%	----
		Nickel, dissolved	7440-02-0	E421	0.000050	mg/L	0.00184	0.00186	0.00002	Diff <2x LOR	----
		Phosphorus, dissolved	7723-14-0	E421	0.050	mg/L	<0.050	<0.050	0	Diff <2x LOR	----
		Potassium, dissolved	7440-09-7	E421	0.050	mg/L	1.95	1.92	2.06%	20%	----
		Rubidium, dissolved	7440-17-7	E421	0.000020	mg/L	0.00352	0.00359	2.01%	20%	----
		Selenium, dissolved	7782-49-2	E421	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	----
		Silicon, dissolved	7440-21-3	E421	0.050	mg/L	3.63	3.68	1.36%	20%	----
		Silver, dissolved	7440-22-4	E421	0.000010	mg/L	<0.000010	<0.000010	0	Diff <2x LOR	----
		Sodium, dissolved	7440-23-5	E421	0.050	mg/L	7.98	8.14	1.96%	20%	----
		Strontium, dissolved	7440-24-6	E421	0.000020	mg/L	0.279	0.277	0.540%	20%	----
		Sulfur, dissolved	7704-34-9	E421	0.50	mg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Tellurium, dissolved	13494-80-9	E421	0.000020	mg/L	<0.000020	<0.000020	0	Diff <2x LOR	----
		Thallium, dissolved	7440-28-0	E421	0.000010	mg/L	<0.000010	<0.000010	0	Diff <2x LOR	----
		Thorium, dissolved	7440-29-1	E421	0.000010	mg/L	<0.000010	<0.000010	0	Diff <2x LOR	----
		Tin, dissolved	7440-31-5	E421	0.000010	mg/L	<0.000010	<0.000010	0	Diff <2x LOR	----
		Titanium, dissolved	7440-32-6	E421	0.000030	mg/L	<0.000030	<0.000030	0	Diff <2x LOR	----
		Tungsten, dissolved	7440-33-7	E421	0.000010	mg/L	<0.000010	<0.000010	0	Diff <2x LOR	----
		Uranium, dissolved	7440-61-1	E421	0.000010	mg/L	0.000131	0.000135	3.08%	20%	----
Vanadium, dissolved	7440-62-2	E421	0.000050	mg/L	<0.000050	<0.000050	0	Diff <2x LOR	----		
Zinc, dissolved	7440-66-6	E421	0.0010	mg/L	0.0020	0.0018	0.0002	Diff <2x LOR	----		
Zirconium, dissolved	7440-67-7	E421	0.000030	mg/L	<0.000030	<0.000030	0	Diff <2x LOR	----		
<b>Dissolved Metals (QC Lot: 1654684)</b>											
FJ2402704-001	Anonymous	Mercury, dissolved	7439-97-6	E509	0.0000050	mg/L	<0.0000050	<0.0000050	0	Diff <2x LOR	----
<b>Dissolved Gases (QC Lot: 1649070)</b>											
WT2426524-001	Anonymous	Methane	74-82-8	E614B	218	ppmv	3630	3530	2.78%	30%	----
<b>Volatile Organic Compounds (QC Lot: 1648980)</b>											
FJ2402701-001	Anonymous	Benzene	71-43-2	E611A	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Ethylbenzene	100-41-4	E611A	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Methyl-tert-butyl ether [MTBE]	1634-04-4	E611A	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Styrene	100-42-5	E611A	0.50	µg/L	<0.50	<0.50	0	Diff <2x LOR	----
		Toluene	108-88-3	E611A	0.50	µg/L	0.71	0.74	0.03	Diff <2x LOR	----
		Xylene, m+p-	179601-23-1	E611A	0.40	µg/L	<0.40	<0.40	0	Diff <2x LOR	----
		Xylene, o-	95-47-6	E611A	0.30	µg/L	<0.30	<0.30	0	Diff <2x LOR	----

**Hydrocarbons (QC Lot: 1648981)**

Page : 7 of 20  
 Work Order : FJ2402712  
 Client : Tetra Tech Canada Inc.  
 Project : 704-ENW.GENV03704-02- Rose Prairie



Sub-Matrix: **Water**

*Laboratory Duplicate (DUP) Report*

<i>Laboratory sample ID</i>	<i>Client sample ID</i>	<i>Analyte</i>	<i>CAS Number</i>	<i>Method</i>	<i>LOR</i>	<i>Unit</i>	<i>Original Result</i>	<i>Duplicate Result</i>	<i>RPD(%) or Difference</i>	<i>Duplicate Limits</i>	<i>Qualifier</i>
<b>Hydrocarbons (QC Lot: 1648981) - continued</b>											
FJ2402712-001	LOCATION 3	F1 (C6-C10)	----	E581.VH+F1	100	µg/L	<100	<100	0.0%	30%	----
		VHw (C6-C10)	----	E581.VH+F1	100	µg/L	<100	<100	0.0%	30%	----



## Method Blank (MB) Report

A Method Blank is an analyte-free matrix that undergoes sample processing identical to that carried out for test samples. Method Blank results are used to monitor and control for potential contamination from the laboratory environment and reagents. For most tests, the DQO for Method Blanks is for the result to be < LOR.

Sub-Matrix: Water

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
<b>Physical Tests (QCLot: 1644009)</b>						
Conductivity	---	E100	1	µS/cm	1.2	---
<b>Physical Tests (QCLot: 1644011)</b>						
Alkalinity, bicarbonate (as CaCO3)	---	E290	1	mg/L	1.8	---
Alkalinity, carbonate (as CaCO3)	---	E290	1	mg/L	<1.0	---
Alkalinity, hydroxide (as CaCO3)	---	E290	1	mg/L	<1.0	---
Alkalinity, phenolphthalein (as CaCO3)	---	E290	1	mg/L	<1.0	---
Alkalinity, total (as CaCO3)	---	E290	1	mg/L	1.8	---
<b>Physical Tests (QCLot: 1644020)</b>						
Colour, true	---	E329	5	CU	<5.0	---
<b>Physical Tests (QCLot: 1646854)</b>						
Turbidity	---	E121	0.1	NTU	<0.10	---
<b>Physical Tests (QCLot: 1646857)</b>						
Absorbance, UV (@ 254nm)	---	E404	0.005	AU/cm	<0.0050	---
<b>Physical Tests (QCLot: 1652612)</b>						
Solids, total dissolved [TDS]	---	E162	10	mg/L	<10	---
<b>Anions and Nutrients (QCLot: 1644012)</b>						
Sulfate (as SO4)	14808-79-8	E235.SO4	0.3	mg/L	<0.30	---
<b>Anions and Nutrients (QCLot: 1644013)</b>						
Nitrate (as N)	14797-55-8	E235.NO3-L	0.005	mg/L	<0.0050	---
<b>Anions and Nutrients (QCLot: 1644014)</b>						
Nitrite (as N)	14797-65-0	E235.NO2-L	0.001	mg/L	<0.0010	---
<b>Anions and Nutrients (QCLot: 1644015)</b>						
Fluoride	16984-48-8	E235.F	0.02	mg/L	<0.020	---
<b>Anions and Nutrients (QCLot: 1644016)</b>						
Chloride	16887-00-6	E235.Cl	0.5	mg/L	<0.50	---
<b>Anions and Nutrients (QCLot: 1644017)</b>						
Bromide	24959-67-9	E235.Br-L	0.05	mg/L	<0.050	---
<b>Cyanides (QCLot: 1648080)</b>						
Cyanide, strong acid dissociable (Total)	---	E333	0.002	mg/L	<0.0020	---
<b>Organic / Inorganic Carbon (QCLot: 1652739)</b>						
Carbon, total organic [TOC]	---	E355-L	0.5	mg/L	<0.50	---
<b>Organic / Inorganic Carbon (QCLot: 1652740)</b>						



Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
<b>Organic / Inorganic Carbon (QCLot: 1652740) - continued</b>						
Carbon, dissolved organic [DOC]	---	E358-L	0.5	mg/L	<0.50	---
<b>Total Sulfides (QCLot: 1647389)</b>						
Sulfide, total (as S)	18496-25-8	E395-H	0.01	mg/L	<0.010	---
<b>Total Metals (QCLot: 1647732)</b>						
Aluminum, total	7429-90-5	E420	0.003	mg/L	<0.0030	---
Antimony, total	7440-36-0	E420	0.0001	mg/L	<0.00010	---
Arsenic, total	7440-38-2	E420	0.0001	mg/L	<0.00010	---
Barium, total	7440-39-3	E420	0.0001	mg/L	<0.00010	---
Beryllium, total	7440-41-7	E420	0.00002	mg/L	<0.000020	---
Bismuth, total	7440-69-9	E420	0.00005	mg/L	<0.000050	---
Boron, total	7440-42-8	E420	0.01	mg/L	<0.010	---
Cadmium, total	7440-43-9	E420	0.000005	mg/L	<0.0000050	---
Calcium, total	7440-70-2	E420	0.05	mg/L	<0.050	---
Cesium, total	7440-46-2	E420	0.00001	mg/L	<0.000010	---
Chromium, total	7440-47-3	E420	0.0005	mg/L	<0.00050	---
Cobalt, total	7440-48-4	E420	0.0001	mg/L	<0.00010	---
Copper, total	7440-50-8	E420	0.0005	mg/L	<0.00050	---
Iron, total	7439-89-6	E420	0.01	mg/L	<0.010	---
Lead, total	7439-92-1	E420	0.00005	mg/L	<0.000050	---
Lithium, total	7439-93-2	E420	0.001	mg/L	<0.0010	---
Magnesium, total	7439-95-4	E420	0.005	mg/L	<0.0050	---
Manganese, total	7439-96-5	E420	0.0001	mg/L	<0.00010	---
Molybdenum, total	7439-98-7	E420	0.00005	mg/L	<0.000050	---
Nickel, total	7440-02-0	E420	0.0005	mg/L	<0.00050	---
Phosphorus, total	7723-14-0	E420	0.05	mg/L	<0.050	---
Potassium, total	7440-09-7	E420	0.05	mg/L	<0.050	---
Rubidium, total	7440-17-7	E420	0.0002	mg/L	<0.00020	---
Selenium, total	7782-49-2	E420	0.00005	mg/L	<0.000050	---
Silicon, total	7440-21-3	E420	0.1	mg/L	<0.10	---
Silver, total	7440-22-4	E420	0.00001	mg/L	<0.000010	---
Sodium, total	7440-23-5	E420	0.05	mg/L	<0.050	---
Strontium, total	7440-24-6	E420	0.0002	mg/L	<0.00020	---
Sulfur, total	7704-34-9	E420	0.5	mg/L	<0.50	---
Tellurium, total	13494-80-9	E420	0.0002	mg/L	<0.00020	---
Thallium, total	7440-28-0	E420	0.00001	mg/L	<0.000010	---



Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
<b>Total Metals (QCLot: 1647732) - continued</b>						
Thorium, total	7440-29-1	E420	0.0001	mg/L	<0.00010	----
Tin, total	7440-31-5	E420	0.0001	mg/L	<0.00010	----
Titanium, total	7440-32-6	E420	0.0003	mg/L	<0.00030	----
Tungsten, total	7440-33-7	E420	0.0001	mg/L	<0.00010	----
Uranium, total	7440-61-1	E420	0.00001	mg/L	<0.000010	----
Vanadium, total	7440-62-2	E420	0.0005	mg/L	<0.00050	----
Zinc, total	7440-66-6	E420	0.003	mg/L	<0.0030	----
Zirconium, total	7440-67-7	E420	0.0002	mg/L	<0.00020	----
<b>Total Metals (QCLot: 1654017)</b>						
Mercury, total	7439-97-6	E508	0.000005	mg/L	<0.0000050	----
<b>Dissolved Metals (QCLot: 1645007)</b>						
Aluminum, dissolved	7429-90-5	E421	0.001	mg/L	<0.0010	----
Antimony, dissolved	7440-36-0	E421	0.0001	mg/L	<0.00010	----
Arsenic, dissolved	7440-38-2	E421	0.0001	mg/L	<0.00010	----
Barium, dissolved	7440-39-3	E421	0.0001	mg/L	<0.00010	----
Beryllium, dissolved	7440-41-7	E421	0.00002	mg/L	<0.000020	----
Bismuth, dissolved	7440-69-9	E421	0.00005	mg/L	<0.000050	----
Boron, dissolved	7440-42-8	E421	0.01	mg/L	<0.010	----
Cadmium, dissolved	7440-43-9	E421	0.000005	mg/L	<0.0000050	----
Calcium, dissolved	7440-70-2	E421	0.05	mg/L	<0.050	----
Cesium, dissolved	7440-46-2	E421	0.00001	mg/L	<0.000010	----
Chromium, dissolved	7440-47-3	E421	0.0005	mg/L	<0.00050	----
Cobalt, dissolved	7440-48-4	E421	0.0001	mg/L	<0.00010	----
Copper, dissolved	7440-50-8	E421	0.0002	mg/L	<0.00020	----
Iron, dissolved	7439-89-6	E421	0.01	mg/L	<0.010	----
Lead, dissolved	7439-92-1	E421	0.00005	mg/L	<0.000050	----
Lithium, dissolved	7439-93-2	E421	0.001	mg/L	<0.0010	----
Magnesium, dissolved	7439-95-4	E421	0.005	mg/L	<0.0050	----
Manganese, dissolved	7439-96-5	E421	0.0001	mg/L	<0.00010	----
Molybdenum, dissolved	7439-98-7	E421	0.00005	mg/L	<0.000050	----
Nickel, dissolved	7440-02-0	E421	0.0005	mg/L	<0.00050	----
Phosphorus, dissolved	7723-14-0	E421	0.05	mg/L	<0.050	----
Potassium, dissolved	7440-09-7	E421	0.05	mg/L	<0.050	----
Rubidium, dissolved	7440-17-7	E421	0.0002	mg/L	<0.00020	----
Selenium, dissolved	7782-49-2	E421	0.00005	mg/L	<0.000050	----





Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
<b>Dissolved Metals (QCLot: 1645007) - continued</b>						
Silicon, dissolved	7440-21-3	E421	0.05	mg/L	<0.050	----
Silver, dissolved	7440-22-4	E421	0.00001	mg/L	<0.000010	----
Sodium, dissolved	7440-23-5	E421	0.05	mg/L	<0.050	----
Strontium, dissolved	7440-24-6	E421	0.0002	mg/L	<0.00020	----
Sulfur, dissolved	7704-34-9	E421	0.5	mg/L	<0.50	----
Tellurium, dissolved	13494-80-9	E421	0.0002	mg/L	<0.00020	----
Thallium, dissolved	7440-28-0	E421	0.00001	mg/L	<0.000010	----
Thorium, dissolved	7440-29-1	E421	0.0001	mg/L	<0.00010	----
Tin, dissolved	7440-31-5	E421	0.0001	mg/L	<0.00010	----
Titanium, dissolved	7440-32-6	E421	0.0003	mg/L	<0.00030	----
Tungsten, dissolved	7440-33-7	E421	0.0001	mg/L	<0.00010	----
Uranium, dissolved	7440-61-1	E421	0.00001	mg/L	<0.000010	----
Vanadium, dissolved	7440-62-2	E421	0.0005	mg/L	<0.00050	----
Zinc, dissolved	7440-66-6	E421	0.001	mg/L	<0.0010	----
Zirconium, dissolved	7440-67-7	E421	0.0002	mg/L	<0.00020	----
<b>Dissolved Metals (QCLot: 1654684)</b>						
Mercury, dissolved	7439-97-6	E509	0.000005	mg/L	<0.0000050	----
<b>Dissolved Gases (QCLot: 1649070)</b>						
Methane	74-82-8	E614B	20.77	ppmv	<20.8	----
<b>Volatile Organic Compounds (QCLot: 1648980)</b>						
Benzene	71-43-2	E611A	0.5	µg/L	<0.50	----
Ethylbenzene	100-41-4	E611A	0.5	µg/L	<0.50	----
Methyl-tert-butyl ether [MTBE]	1634-04-4	E611A	0.5	µg/L	<0.50	----
Styrene	100-42-5	E611A	0.5	µg/L	<0.50	----
Toluene	108-88-3	E611A	0.5	µg/L	<0.50	----
Xylene, m+p-	179601-23-1	E611A	0.4	µg/L	<0.40	----
Xylene, o-	95-47-6	E611A	0.3	µg/L	<0.30	----
<b>Hydrocarbons (QCLot: 1648981)</b>						
F1 (C6-C10)	----	E581.VH+F1	100	µg/L	<100	----
VHw (C6-C10)	----	E581.VH+F1	100	µg/L	<100	----



## Laboratory Control Sample (LCS) Report

A Laboratory Control Sample (LCS) is an analyte-free matrix that has been fortified (spiked) with test analytes at known concentration and processed in an identical manner to test samples. LCS results are expressed as percent recovery, and are used to monitor and control test method accuracy and precision, independent of test sample matrix.

Sub-Matrix: Water

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
<b>Physical Tests (QCLot: 1644009)</b>									
Conductivity	---	E100	1	µS/cm	147 µS/cm	96.7	90.0	110	---
<b>Physical Tests (QCLot: 1644010)</b>									
pH	---	E108	---	pH units	7 pH units	100	98.0	102	---
<b>Physical Tests (QCLot: 1644011)</b>									
Alkalinity, phenolphthalein (as CaCO <sub>3</sub> )	---	E290	1	mg/L	229 mg/L	94.6	75.0	125	---
Alkalinity, total (as CaCO <sub>3</sub> )	---	E290	1	mg/L	500 mg/L	104	85.0	115	---
<b>Physical Tests (QCLot: 1644020)</b>									
Colour, true	---	E329	5	CU	100 CU	102	85.0	115	---
<b>Physical Tests (QCLot: 1646854)</b>									
Turbidity	---	E121	0.1	NTU	200 NTU	96.5	85.0	115	---
<b>Physical Tests (QCLot: 1646857)</b>									
Absorbance, UV (@ 254nm)	---	E404	0.005	AU/cm	0.693 AU/cm	94.1	85.0	115	---
Transmittance, UV (@ 254nm)	---	E404	---	% T/cm	20.3 % T/cm	110	85.0	115	---
<b>Physical Tests (QCLot: 1652612)</b>									
Solids, total dissolved [TDS]	---	E162	10	mg/L	1000 mg/L	102	85.0	115	---
<b>Anions and Nutrients (QCLot: 1644012)</b>									
Sulfate (as SO <sub>4</sub> )	14808-79-8	E235.SO4	0.3	mg/L	100 mg/L	101	90.0	110	---
<b>Anions and Nutrients (QCLot: 1644013)</b>									
Nitrate (as N)	14797-55-8	E235.NO3-L	0.005	mg/L	2.5 mg/L	100.0	90.0	110	---
<b>Anions and Nutrients (QCLot: 1644014)</b>									
Nitrite (as N)	14797-65-0	E235.NO2-L	0.001	mg/L	0.5 mg/L	100	90.0	110	---
<b>Anions and Nutrients (QCLot: 1644015)</b>									
Fluoride	16984-48-8	E235.F	0.02	mg/L	1 mg/L	101	90.0	110	---
<b>Anions and Nutrients (QCLot: 1644016)</b>									
Chloride	16887-00-6	E235.Cl	0.5	mg/L	100 mg/L	100	90.0	110	---
<b>Anions and Nutrients (QCLot: 1644017)</b>									
Bromide	24959-67-9	E235.Br-L	0.05	mg/L	0.5 mg/L	101	85.0	115	---
<b>Cyanides (QCLot: 1648080)</b>									
Cyanide, strong acid dissociable (Total)	---	E333	0.002	mg/L	0.25 mg/L	93.4	80.0	120	---



Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
<b>Organic / Inorganic Carbon (QCLot: 1652739)</b>									
Carbon, total organic [TOC]	---	E355-L	0.5	mg/L	8.57 mg/L	94.5	80.0	120	---
<b>Organic / Inorganic Carbon (QCLot: 1652740)</b>									
Carbon, dissolved organic [DOC]	---	E358-L	0.5	mg/L	8.57 mg/L	92.7	80.0	120	---
<b>Total Sulfides (QCLot: 1647389)</b>									
Sulfide, total (as H2S)	7783-06-4	E395-H	---	mg/L	0.085 mg/L	105	80.0	120	---
Sulfide, total (as S)	18496-25-8	E395-H	0.01	mg/L	0.08 mg/L	105	80.0	120	---
<b>Total Metals (QCLot: 1647732)</b>									
Aluminum, total	7429-90-5	E420	0.003	mg/L	2 mg/L	107	80.0	120	---
Antimony, total	7440-36-0	E420	0.0001	mg/L	1 mg/L	100	80.0	120	---
Arsenic, total	7440-38-2	E420	0.0001	mg/L	1 mg/L	110	80.0	120	---
Barium, total	7440-39-3	E420	0.0001	mg/L	0.25 mg/L	99.3	80.0	120	---
Beryllium, total	7440-41-7	E420	0.00002	mg/L	0.1 mg/L	99.7	80.0	120	---
Bismuth, total	7440-69-9	E420	0.00005	mg/L	1 mg/L	108	80.0	120	---
Boron, total	7440-42-8	E420	0.01	mg/L	1 mg/L	93.2	80.0	120	---
Cadmium, total	7440-43-9	E420	0.000005	mg/L	0.1 mg/L	103	80.0	120	---
Calcium, total	7440-70-2	E420	0.05	mg/L	50 mg/L	98.3	80.0	120	---
Cesium, total	7440-46-2	E420	0.00001	mg/L	0.05 mg/L	97.2	80.0	120	---
Chromium, total	7440-47-3	E420	0.0005	mg/L	0.25 mg/L	106	80.0	120	---
Cobalt, total	7440-48-4	E420	0.0001	mg/L	0.25 mg/L	104	80.0	120	---
Copper, total	7440-50-8	E420	0.0005	mg/L	0.25 mg/L	104	80.0	120	---
Iron, total	7439-89-6	E420	0.01	mg/L	1 mg/L	98.0	80.0	120	---
Lead, total	7439-92-1	E420	0.00005	mg/L	0.5 mg/L	101	80.0	120	---
Lithium, total	7439-93-2	E420	0.001	mg/L	0.25 mg/L	102	80.0	120	---
Magnesium, total	7439-95-4	E420	0.005	mg/L	50 mg/L	110	80.0	120	---
Manganese, total	7439-96-5	E420	0.0001	mg/L	0.25 mg/L	110	80.0	120	---
Molybdenum, total	7439-98-7	E420	0.00005	mg/L	0.25 mg/L	101	80.0	120	---
Nickel, total	7440-02-0	E420	0.0005	mg/L	0.5 mg/L	104	80.0	120	---
Phosphorus, total	7723-14-0	E420	0.05	mg/L	10 mg/L	112	80.0	120	---
Potassium, total	7440-09-7	E420	0.05	mg/L	50 mg/L	100	80.0	120	---
Rubidium, total	7440-17-7	E420	0.0002	mg/L	0.1 mg/L	106	80.0	120	---
Selenium, total	7782-49-2	E420	0.00005	mg/L	1 mg/L	107	80.0	120	---
Silicon, total	7440-21-3	E420	0.1	mg/L	10 mg/L	114	80.0	120	---
Silver, total	7440-22-4	E420	0.00001	mg/L	0.1 mg/L	90.1	80.0	120	---
Sodium, total	7440-23-5	E420	0.05	mg/L	50 mg/L	106	80.0	120	---



Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
<b>Total Metals (QCLot: 1647732) - continued</b>									
Strontium, total	7440-24-6	E420	0.0002	mg/L	0.25 mg/L	102	80.0	120	----
Sulfur, total	7704-34-9	E420	0.5	mg/L	50 mg/L	101	80.0	120	----
Tellurium, total	13494-80-9	E420	0.0002	mg/L	0.1 mg/L	105	80.0	120	----
Thallium, total	7440-28-0	E420	0.00001	mg/L	1 mg/L	104	80.0	120	----
Thorium, total	7440-29-1	E420	0.0001	mg/L	0.1 mg/L	103	80.0	120	----
Tin, total	7440-31-5	E420	0.0001	mg/L	0.5 mg/L	98.8	80.0	120	----
Titanium, total	7440-32-6	E420	0.0003	mg/L	0.25 mg/L	106	80.0	120	----
Tungsten, total	7440-33-7	E420	0.0001	mg/L	0.1 mg/L	105	80.0	120	----
Uranium, total	7440-61-1	E420	0.00001	mg/L	0.005 mg/L	108	80.0	120	----
Vanadium, total	7440-62-2	E420	0.0005	mg/L	0.5 mg/L	106	80.0	120	----
Zinc, total	7440-66-6	E420	0.003	mg/L	0.5 mg/L	112	80.0	120	----
Zirconium, total	7440-67-7	E420	0.0002	mg/L	0.1 mg/L	98.2	80.0	120	----
<b>Total Metals (QCLot: 1654017)</b>									
Mercury, total	7439-97-6	E508	0.000005	mg/L	0 mg/L	100	80.0	120	----
<b>Dissolved Metals (QCLot: 1645007)</b>									
Aluminum, dissolved	7429-90-5	E421	0.001	mg/L	2 mg/L	99.5	80.0	120	----
Antimony, dissolved	7440-36-0	E421	0.0001	mg/L	1 mg/L	95.3	80.0	120	----
Arsenic, dissolved	7440-38-2	E421	0.0001	mg/L	1 mg/L	100.0	80.0	120	----
Barium, dissolved	7440-39-3	E421	0.0001	mg/L	0.25 mg/L	95.8	80.0	120	----
Beryllium, dissolved	7440-41-7	E421	0.00002	mg/L	0.1 mg/L	99.0	80.0	120	----
Bismuth, dissolved	7440-69-9	E421	0.00005	mg/L	1 mg/L	96.7	80.0	120	----
Boron, dissolved	7440-42-8	E421	0.01	mg/L	1 mg/L	107	80.0	120	----
Cadmium, dissolved	7440-43-9	E421	0.000005	mg/L	0.1 mg/L	93.7	80.0	120	----
Calcium, dissolved	7440-70-2	E421	0.05	mg/L	50 mg/L	100	80.0	120	----
Cesium, dissolved	7440-46-2	E421	0.00001	mg/L	0.05 mg/L	94.8	80.0	120	----
Chromium, dissolved	7440-47-3	E421	0.0005	mg/L	0.25 mg/L	95.6	80.0	120	----
Cobalt, dissolved	7440-48-4	E421	0.0001	mg/L	0.25 mg/L	94.5	80.0	120	----
Copper, dissolved	7440-50-8	E421	0.0002	mg/L	0.25 mg/L	93.1	80.0	120	----
Iron, dissolved	7439-89-6	E421	0.01	mg/L	1 mg/L	97.2	80.0	120	----
Lead, dissolved	7439-92-1	E421	0.00005	mg/L	0.5 mg/L	95.9	80.0	120	----
Lithium, dissolved	7439-93-2	E421	0.001	mg/L	0.25 mg/L	95.6	80.0	120	----
Magnesium, dissolved	7439-95-4	E421	0.005	mg/L	50 mg/L	98.3	80.0	120	----
Manganese, dissolved	7439-96-5	E421	0.0001	mg/L	0.25 mg/L	96.3	80.0	120	----
Molybdenum, dissolved	7439-98-7	E421	0.00005	mg/L	0.25 mg/L	95.4	80.0	120	----
Nickel, dissolved	7440-02-0	E421	0.0005	mg/L	0.5 mg/L	95.1	80.0	120	----



Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
<b>Dissolved Metals (QCLot: 1645007) - continued</b>									
Phosphorus, dissolved	7723-14-0	E421	0.05	mg/L	10 mg/L	105	80.0	120	----
Potassium, dissolved	7440-09-7	E421	0.05	mg/L	50 mg/L	102	80.0	120	----
Rubidium, dissolved	7440-17-7	E421	0.0002	mg/L	0.1 mg/L	99.1	80.0	120	----
Selenium, dissolved	7782-49-2	E421	0.00005	mg/L	1 mg/L	93.1	80.0	120	----
Silicon, dissolved	7440-21-3	E421	0.05	mg/L	10 mg/L	96.3	80.0	120	----
Silver, dissolved	7440-22-4	E421	0.00001	mg/L	0.1 mg/L	88.1	80.0	120	----
Sodium, dissolved	7440-23-5	E421	0.05	mg/L	50 mg/L	99.5	80.0	120	----
Strontium, dissolved	7440-24-6	E421	0.0002	mg/L	0.25 mg/L	97.2	80.0	120	----
Sulfur, dissolved	7704-34-9	E421	0.5	mg/L	50 mg/L	89.1	80.0	120	----
Tellurium, dissolved	13494-80-9	E421	0.0002	mg/L	0.1 mg/L	93.5	80.0	120	----
Thallium, dissolved	7440-28-0	E421	0.00001	mg/L	1 mg/L	97.3	80.0	120	----
Thorium, dissolved	7440-29-1	E421	0.0001	mg/L	0.1 mg/L	95.7	80.0	120	----
Tin, dissolved	7440-31-5	E421	0.0001	mg/L	0.5 mg/L	90.9	80.0	120	----
Titanium, dissolved	7440-32-6	E421	0.0003	mg/L	0.25 mg/L	93.9	80.0	120	----
Tungsten, dissolved	7440-33-7	E421	0.0001	mg/L	0.1 mg/L	94.1	80.0	120	----
Uranium, dissolved	7440-61-1	E421	0.00001	mg/L	0.005 mg/L	98.3	80.0	120	----
Vanadium, dissolved	7440-62-2	E421	0.0005	mg/L	0.5 mg/L	97.0	80.0	120	----
Zinc, dissolved	7440-66-6	E421	0.001	mg/L	0.5 mg/L	91.2	80.0	120	----
Zirconium, dissolved	7440-67-7	E421	0.0002	mg/L	0.1 mg/L	93.4	80.0	120	----
Mercury, dissolved	7439-97-6	E509	0.000005	mg/L	0 mg/L	99.4	80.0	120	----
<b>Dissolved Gases (QCLot: 1649070)</b>									
Methane	74-82-8	E614B	20.77	ppmv	432 ppmv	94.3	80.0	120	----
<b>Volatile Organic Compounds (QCLot: 1648980)</b>									
Benzene	71-43-2	E611A	0.5	µg/L	100 µg/L	111	70.0	130	----
Ethylbenzene	100-41-4	E611A	0.5	µg/L	100 µg/L	91.6	70.0	130	----
Methyl-tert-butyl ether [MTBE]	1634-04-4	E611A	0.5	µg/L	100 µg/L	128	70.0	130	----
Styrene	100-42-5	E611A	0.5	µg/L	100 µg/L	96.2	70.0	130	----
Toluene	108-88-3	E611A	0.5	µg/L	100 µg/L	99.1	70.0	130	----
Xylene, m+p-	179601-23-1	E611A	0.4	µg/L	200 µg/L	101	70.0	130	----
Xylene, o-	95-47-6	E611A	0.3	µg/L	100 µg/L	94.6	70.0	130	----
<b>Hydrocarbons (QCLot: 1648981)</b>									
F1 (C6-C10)	----	E581.VH+F1	100	µg/L	6310 µg/L	83.3	70.0	130	----
VHw (C6-C10)	----	E581.VH+F1	100	µg/L	6310 µg/L	75.3	70.0	130	----



Sub-Matrix: **Water**

					<i>Laboratory Control Sample (LCS) Report</i>				
					<i>Spike</i>	<i>Recovery (%)</i>	<i>Recovery Limits (%)</i>		
<i>Analyte</i>	<i>CAS Number</i>	<i>Method</i>	<i>LOR</i>	<i>Unit</i>	<i>Target Concentration</i>	<i>LCS</i>	<i>Low</i>	<i>High</i>	<i>Qualifier</i>



### Matrix Spike (MS) Report

A Matrix Spike (MS) is a randomly selected intra-laboratory replicate sample that has been fortified (spiked) with test analytes at known concentration, and processed in an identical manner to test samples. Matrix Spikes provide information regarding analyte recovery and potential matrix effects. MS DQO exceedances due to sample matrix may sometimes be unavoidable; in such cases, test results for the associated sample (or similar samples) may be subject to bias. ND – Recovery not determined, background level >= 1x spike level.

Sub-Matrix: **Water**

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
<b>Anions and Nutrients (QCLot: 1644012)</b>										
FJ2402707-028	Anonymous	Sulfate (as SO4)	14808-79-8	E235.SO4	ND mg/L	----	ND	75.0	125	----
<b>Anions and Nutrients (QCLot: 1644013)</b>										
FJ2402707-028	Anonymous	Nitrate (as N)	14797-55-8	E235.NO3-L	2.48 mg/L	2.5 mg/L	99.0	75.0	125	----
<b>Anions and Nutrients (QCLot: 1644014)</b>										
FJ2402707-028	Anonymous	Nitrite (as N)	14797-65-0	E235.NO2-L	0.504 mg/L	0.5 mg/L	101	75.0	125	----
<b>Anions and Nutrients (QCLot: 1644015)</b>										
FJ2402707-028	Anonymous	Fluoride	16984-48-8	E235.F	0.997 mg/L	1 mg/L	99.7	75.0	125	----
<b>Anions and Nutrients (QCLot: 1644016)</b>										
FJ2402707-028	Anonymous	Chloride	16887-00-6	E235.Cl	99.9 mg/L	100 mg/L	99.9	75.0	125	----
<b>Anions and Nutrients (QCLot: 1644017)</b>										
FJ2402707-028	Anonymous	Bromide	24959-67-9	E235.Br-L	0.490 mg/L	0.5 mg/L	98.1	75.0	125	----
<b>Cyanides (QCLot: 1648080)</b>										
VA24C3606-001	Anonymous	Cyanide, strong acid dissociable (Total)	----	E333	0.207 mg/L	0.25 mg/L	82.8	75.0	125	----
<b>Organic / Inorganic Carbon (QCLot: 1652739)</b>										
FJ2402699-001	Anonymous	Carbon, total organic [TOC]	----	E355-L	ND mg/L	----	ND	70.0	130	----
<b>Organic / Inorganic Carbon (QCLot: 1652740)</b>										
FJ2402699-001	Anonymous	Carbon, dissolved organic [DOC]	----	E358-L	5.49 mg/L	5 mg/L	110	70.0	130	----
<b>Total Sulfides (QCLot: 1647389)</b>										
VA24C3586-001	Anonymous	Sulfide, total (as S)	18496-25-8	E395-H	0.998 mg/L	1 mg/L	99.8	75.0	125	----
<b>Total Metals (QCLot: 1647732)</b>										
FJ2402701-002	Anonymous	Aluminum, total	7429-90-5	E420	ND mg/L	----	ND	70.0	130	----
		Antimony, total	7440-36-0	E420	0.0183 mg/L	0.02 mg/L	91.6	70.0	130	----
		Arsenic, total	7440-38-2	E420	0.0207 mg/L	0.02 mg/L	104	70.0	130	----
		Barium, total	7440-39-3	E420	ND mg/L	----	ND	70.0	130	----
		Beryllium, total	7440-41-7	E420	0.0372 mg/L	0.04 mg/L	93.1	70.0	130	----
		Bismuth, total	7440-69-9	E420	0.00912 mg/L	0.01 mg/L	91.2	70.0	130	----
		Boron, total	7440-42-8	E420	0.086 mg/L	0.1 mg/L	85.6	70.0	130	----
		Cadmium, total	7440-43-9	E420	0.00384 mg/L	0.004 mg/L	95.9	70.0	130	----
		Calcium, total	7440-70-2	E420	ND mg/L	----	ND	70.0	130	----
		Cesium, total	7440-46-2	E420	0.00953 mg/L	0.01 mg/L	95.3	70.0	130	----
		Chromium, total	7440-47-3	E420	0.0387 mg/L	0.04 mg/L	96.8	70.0	130	----
		Cobalt, total	7440-48-4	E420	0.0190 mg/L	0.02 mg/L	95.0	70.0	130	----
		Copper, total	7440-50-8	E420	0.0188 mg/L	0.02 mg/L	94.0	70.0	130	----



Sub-Matrix: Water

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
<b>Total Metals (QCLot: 1647732) - continued</b>										
FJ2402701-002	Anonymous	Iron, total	7439-89-6	E420	1.93 mg/L	2 mg/L	96.5	70.0	130	---
		Lead, total	7439-92-1	E420	0.0180 mg/L	0.02 mg/L	90.0	70.0	130	---
		Lithium, total	7439-93-2	E420	0.0939 mg/L	0.1 mg/L	93.9	70.0	130	---
		Magnesium, total	7439-95-4	E420	ND mg/L	---	ND	70.0	130	---
		Manganese, total	7439-96-5	E420	0.0193 mg/L	0.02 mg/L	96.5	70.0	130	---
		Molybdenum, total	7439-98-7	E420	0.0192 mg/L	0.02 mg/L	95.9	70.0	130	---
		Nickel, total	7440-02-0	E420	0.0377 mg/L	0.04 mg/L	94.2	70.0	130	---
		Phosphorus, total	7723-14-0	E420	10.0 mg/L	10 mg/L	100	70.0	130	---
		Potassium, total	7440-09-7	E420	3.65 mg/L	4 mg/L	91.2	70.0	130	---
		Rubidium, total	7440-17-7	E420	0.0197 mg/L	0.02 mg/L	98.6	70.0	130	---
		Selenium, total	7782-49-2	E420	0.0415 mg/L	0.04 mg/L	104	70.0	130	---
		Silicon, total	7440-21-3	E420	9.65 mg/L	10 mg/L	96.5	70.0	130	---
		Silver, total	7440-22-4	E420	0.00369 mg/L	0.004 mg/L	92.2	70.0	130	---
		Sodium, total	7440-23-5	E420	1.90 mg/L	2 mg/L	95.0	70.0	130	---
		Strontium, total	7440-24-6	E420	ND mg/L	---	ND	70.0	130	---
		Sulfur, total	7704-34-9	E420	20.4 mg/L	20 mg/L	102	70.0	130	---
		Tellurium, total	13494-80-9	E420	0.0400 mg/L	0.04 mg/L	99.9	70.0	130	---
		Thallium, total	7440-28-0	E420	0.00369 mg/L	0.004 mg/L	92.3	70.0	130	---
		Thorium, total	7440-29-1	E420	0.0194 mg/L	0.02 mg/L	97.2	70.0	130	---
		Tin, total	7440-31-5	E420	0.0190 mg/L	0.02 mg/L	95.1	70.0	130	---
		Titanium, total	7440-32-6	E420	0.0400 mg/L	0.04 mg/L	99.9	70.0	130	---
		Tungsten, total	7440-33-7	E420	0.0193 mg/L	0.02 mg/L	96.7	70.0	130	---
		Uranium, total	7440-61-1	E420	0.00387 mg/L	0.004 mg/L	96.9	70.0	130	---
		Vanadium, total	7440-62-2	E420	0.0984 mg/L	0.1 mg/L	98.4	70.0	130	---
		Zinc, total	7440-66-6	E420	0.406 mg/L	0.4 mg/L	101	70.0	130	---
		Zirconium, total	7440-67-7	E420	0.0359 mg/L	0.04 mg/L	89.8	70.0	130	---
<b>Total Metals (QCLot: 1654017)</b>										
FJ2402701-002	Anonymous	Mercury, total	7439-97-6	E508	0.0000900 mg/L	0 mg/L	90.0	70.0	130	---
<b>Dissolved Metals (QCLot: 1645007)</b>										
FJ2402712-001	LOCATION 3	Aluminum, dissolved	7429-90-5	E421	0.189 mg/L	0.2 mg/L	94.4	70.0	130	---
		Antimony, dissolved	7440-36-0	E421	0.0172 mg/L	0.02 mg/L	85.8	70.0	130	---
		Arsenic, dissolved	7440-38-2	E421	0.0199 mg/L	0.02 mg/L	99.4	70.0	130	---
		Barium, dissolved	7440-39-3	E421	ND mg/L	---	ND	70.0	130	---
		Beryllium, dissolved	7440-41-7	E421	0.0370 mg/L	0.04 mg/L	92.6	70.0	130	---
		Bismuth, dissolved	7440-69-9	E421	0.00768 mg/L	0.01 mg/L	76.8	70.0	130	---
		Boron, dissolved	7440-42-8	E421	ND mg/L	---	ND	70.0	130	---
		Cadmium, dissolved	7440-43-9	E421	0.00347 mg/L	0.004 mg/L	86.7	70.0	130	---
		Calcium, dissolved	7440-70-2	E421	ND mg/L	---	ND	70.0	130	---
		Cesium, dissolved	7440-46-2	E421	0.00860 mg/L	0.01 mg/L	86.0	70.0	130	---
		Chromium, dissolved	7440-47-3	E421	0.0360 mg/L	0.04 mg/L	90.1	70.0	130	---
		Cobalt, dissolved	7440-48-4	E421	0.0168 mg/L	0.02 mg/L	84.0	70.0	130	---
		Copper, dissolved	7440-50-8	E421	0.0161 mg/L	0.02 mg/L	80.4	70.0	130	---
		Iron, dissolved	7439-89-6	E421	1.68 mg/L	2 mg/L	84.0	70.0	130	---





Sub-Matrix: Water

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
<b>Dissolved Metals (QCLot: 1645007) - continued</b>										
FJ2402712-001	LOCATION 3	Lead, dissolved	7439-92-1	E421	0.0158 mg/L	0.02 mg/L	78.8	70.0	130	----
		Lithium, dissolved	7439-93-2	E421	0.0908 mg/L	0.1 mg/L	90.8	70.0	130	----
		Magnesium, dissolved	7439-95-4	E421	ND mg/L	----	ND	70.0	130	----
		Manganese, dissolved	7439-96-5	E421	ND mg/L	----	ND	70.0	130	----
		Molybdenum, dissolved	7439-98-7	E421	0.0183 mg/L	0.02 mg/L	91.4	70.0	130	----
		Nickel, dissolved	7440-02-0	E421	0.0328 mg/L	0.04 mg/L	81.9	70.0	130	----
		Phosphorus, dissolved	7723-14-0	E421	10.6 mg/L	10 mg/L	106	70.0	130	----
		Potassium, dissolved	7440-09-7	E421	ND mg/L	----	ND	70.0	130	----
		Rubidium, dissolved	7440-17-7	E421	0.0176 mg/L	0.02 mg/L	88.3	70.0	130	----
		Selenium, dissolved	7782-49-2	E421	0.0373 mg/L	0.04 mg/L	93.3	70.0	130	----
		Silicon, dissolved	7440-21-3	E421	8.40 mg/L	10 mg/L	84.0	70.0	130	----
		Silver, dissolved	7440-22-4	E421	0.00249 mg/L	0.004 mg/L	62.2	70.0	130	MES
		Sodium, dissolved	7440-23-5	E421	ND mg/L	----	ND	70.0	130	----
		Strontium, dissolved	7440-24-6	E421	ND mg/L	----	ND	70.0	130	----
		Sulfur, dissolved	7704-34-9	E421	ND mg/L	----	ND	70.0	130	----
		Tellurium, dissolved	13494-80-9	E421	0.0362 mg/L	0.04 mg/L	90.4	70.0	130	----
		Thallium, dissolved	7440-28-0	E421	0.00317 mg/L	0.004 mg/L	79.3	70.0	130	----
		Thorium, dissolved	7440-29-1	E421	0.0182 mg/L	0.02 mg/L	90.9	70.0	130	----
		Tin, dissolved	7440-31-5	E421	0.0167 mg/L	0.02 mg/L	83.6	70.0	130	----
		Titanium, dissolved	7440-32-6	E421	0.0377 mg/L	0.04 mg/L	94.2	70.0	130	----
		Tungsten, dissolved	7440-33-7	E421	0.0172 mg/L	0.02 mg/L	85.8	70.0	130	----
		Uranium, dissolved	7440-61-1	E421	0.00343 mg/L	0.004 mg/L	85.7	70.0	130	----
		Vanadium, dissolved	7440-62-2	E421	0.0938 mg/L	0.1 mg/L	93.8	70.0	130	----
		Zinc, dissolved	7440-66-6	E421	0.327 mg/L	0.4 mg/L	81.8	70.0	130	----
		Zirconium, dissolved	7440-67-7	E421	0.0389 mg/L	0.04 mg/L	97.2	70.0	130	----
<b>Dissolved Metals (QCLot: 1654684)</b>										
FJ2402704-002	Anonymous	Mercury, dissolved	7439-97-6	E509	0.0000987 mg/L	0 mg/L	98.7	70.0	130	----
<b>Volatile Organic Compounds (QCLot: 1648980)</b>										
FJ2402701-002	Anonymous	Benzene	71-43-2	E611A	112 µg/L	100 µg/L	112	60.0	140	----
		Ethylbenzene	100-41-4	E611A	92.5 µg/L	100 µg/L	92.5	60.0	140	----
		Methyl-tert-butyl ether [MTBE]	1634-04-4	E611A	133 µg/L	100 µg/L	133	60.0	140	----
		Styrene	100-42-5	E611A	96.6 µg/L	100 µg/L	96.6	60.0	140	----
		Toluene	108-88-3	E611A	99.7 µg/L	100 µg/L	99.7	60.0	140	----
		Xylene, m+p-	179601-23-1	E611A	209 µg/L	200 µg/L	104	60.0	140	----
		Xylene, o-	95-47-6	E611A	96.8 µg/L	100 µg/L	96.8	60.0	140	----
<b>Hydrocarbons (QCLot: 1648981)</b>										
VA24C3243-001	Anonymous	F1 (C6-C10)	----	E581.VH+F1	4910 µg/L	6310 µg/L	77.8	60.0	140	----
		VHw (C6-C10)	----	E581.VH+F1	4440 µg/L	6310 µg/L	70.4	60.0	140	----



---

## Qualifiers

Qualifier	Description
MES	<i>Data Quality Objective was marginally exceeded (by &lt; 10% absolute) for &lt; 10% of analytes in a Multi-Element Scan / Multi-Parameter Scan (considered acceptable as per OMOE &amp; CCME).</i>

---



Chain of Custody (COC) / Analytical Request Form


COC Number: 21 -

Environmental Division  
Fort St. John  
Work Order Reference  
**FJ2402712**

Canada Toll Free: 1 800 668 9878

Page 1 of 1

*ESDAT FORMAT*



Telephone : +1 250 261 5517

<b>Report To</b> Contact and company name below will appear on the final report		<b>Reports / Recipients</b>			<b>Turnaround Time (TAT) Requested</b>																	
Company:	Tetra Tech	Select Report Format: <input checked="" type="checkbox"/> PDF <input checked="" type="checkbox"/> EXCEL <input checked="" type="checkbox"/> EDD (DIGITAL)			<input checked="" type="checkbox"/> Routine [R] if received by 3pm M-F - no surcharges apply																	
Contact:	Andrea McMillan	Merge QC/QCI Reports with COA <input type="checkbox"/> YES <input type="checkbox"/> NO <input type="checkbox"/> N/A			<input type="checkbox"/> 4 day [P4] if received by 3pm M-F - 20% rush surcharge min																	
Phone:	403-203-3355	<input type="checkbox"/> Compare Results to Criteria on Report - provide details below if box checked			<input type="checkbox"/> 3 day [P3] if received by 3pm M-F - 25% rush surcharge min																	
Company address below will appear on the final report		Select Distribution: <input checked="" type="checkbox"/> EMAIL <input type="checkbox"/> MAIL <input type="checkbox"/> FAX			<input type="checkbox"/> 2 day [P2] if received by 3pm M-F - 50% rush surcharge min																	
Street:	140 Quarry Park Blvd	Email 1 or Fax Andrea.McMillan@tetratech.com			<input type="checkbox"/> 1 day [E] if received by 3pm M-F - 100% rush surcharge min																	
City/Province:	Calgary, Alberta	Email 2 EBA.labdata@tetratech.com			<input type="checkbox"/> Same day [E2] if received by 10am M-S - 200% rush surcharge																	
Postal Code:	T2C 3G3	Email 3 Aziz.Shaikh@tetratech.com			Additional fees may apply to rush requests on weeken																	
<b>Invoice To</b>	Same as Report To <input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	<b>Invoice Recipients</b>			Date and Time Required for all E&P TATs: <b>9-SEP-24 9:00 AM</b>																	
	Copy of Invoice with Report <input type="checkbox"/> YES <input type="checkbox"/> NO	Select Invoice Distribution: <input type="checkbox"/> EMAIL <input type="checkbox"/> MAIL <input type="checkbox"/> FAX			For all tests with rush TATs requested, please contact your AM to confirm availability.																	
Company:		Email 1 or Fax			<b>Analysis Request</b>																	
Contact:		Email 2			Indicate Filtered (F), Preserved (P) or Filtered and Preserved (F/P) below																	
<b>Project Information</b>		<b>Oil and Gas Required Fields (client use)</b>			<b>NUMBER OF CONTAINERS</b>	Dissolved Gas (CH <sub>4</sub> , H <sub>2</sub> S)	Routine	Anions	Physical Test	H <sub>2</sub> S	Dissolved Metals	Total Metals + Hg	Cyanide	DOC	Total Organic Carbon	BTX - F1, F2	MHL	VOC	LEPH/PH/TH/TH/TH	<b>SAMPLES ON HOLD</b>	<b>EXTENDED STORAGE REQUIRED</b>	<b>SUSPECTED HAZARD (see notes)</b>
ALS Account # / Quote #:	V24-EBAG100-013	AFE/Cost Center:	PO#																			
Job #:	704-ENW.GENV03704-02 / ROSE PRODIGE	Major/Minor Code:	Routing Code:																			
PO / AFE:		Requisitioner:																				
LSD:		Location:																				
ALS Lab Work Order # (ALS use only):		ALS Contact:		Sampler:																		
ALS Sample # (ALS use only)	Sample Identification and/or Coordinates (This description will appear on the report)	Date (dd-mmm-yy)	Time (hh:mm)	Sample Type																		
	LOCATION 3	09-SEP-24	11:07	WATER	1	X	X	X	X	X	X	X	X	X	X	X	X	X				

**FJAE Shipping & Receiving**  
 Call Out  Expedite   
 Priority   
 Air   
 Ground   
 # of Coolers   
 # of Carboys

<b>Drinking Water (DW) Samples<sup>1</sup> (client use)</b>		<b>Notes / Specify Limits for result evaluation by selecting from drop-down below (Excel COC only)</b>			<b>SAMPLE RECEIPT DETAILS (ALS use only)</b>		
Are samples taken from a Regulated DW System? <input type="checkbox"/> YES <input type="checkbox"/> NO		Confirm Analysis with Andrea McMillan / ESDAT FORMAT			Cooling Method: <input type="checkbox"/> NONE <input type="checkbox"/> ICE <input checked="" type="checkbox"/> ICE PACKS <input type="checkbox"/> FROZEN <input type="checkbox"/> COOLING INITIATED		
Are samples for human consumption/ use? <input type="checkbox"/> YES <input type="checkbox"/> NO					Submission Comments identified on Sample Receipt Notification: <input type="checkbox"/> YES <input type="checkbox"/> NO		
					Cooler Custody Seals Intact: <input type="checkbox"/> YES <input type="checkbox"/> N/A Sample Custody Seals Intact: <input type="checkbox"/> YES <input type="checkbox"/> N/A		
					INITIAL COOLER TEMPERATURES °C: 16°		
					FINAL COOLER TEMPERATURES °C: 9		
<b>SHIPMENT RELEASE (client use)</b>		<b>INITIAL SHIPMENT RECEPTION (ALS use only)</b>			<b>FINAL SHIPMENT RECEPTION (ALS use only)</b>		
Released by: <i>THOMAS KAS</i>	Date: <i>9/9/24</i>	Time: <i>11:07</i>	Date: <i>09/09/24</i>	Time: <i>11:10</i>	Date: <i>Sept 10</i>	Time: <i>11:55pm</i>	

REFER TO BACK PAGE FOR ALS LOCATIONS AND SAMPLING INFORMATION  
 FAILURE TO COMPLETE ALL PORTIONS OF THIS FORM MAY DELAY ANALYSIS. PLEASE FILL IN THIS FORM LEGIBLY. BY THE USER'S SIGNATURE AND AGREES WITH THE TERMS AND CONDITIONS AS SPECIFIED ON THE BACK PAGE OF THE WHITE - REPORT COPY.  
 1. If any water samples are taken from a Regulated Drinking Water (DW) System, please submit using an Authorized DW COC form.



## CERTIFICATE OF ANALYSIS

<p><b>Work Order</b> : <b>FJ2402713</b></p> <p>Client : <b>Tetra Tech Canada Inc.</b></p> <p>Contact : Andrea McMillan</p> <p>Address : 110, 140 Quarry Park Blvd SE Calgary AB Canada T2C 3G3</p> <p>Telephone : ----</p> <p>Project : 704.ENW.GEN03704-02</p> <p>PO : ----</p> <p>C-O-C number : ----</p> <p>Sampler : Thomas Kolb</p> <p>Site : ----</p> <p>Quote number : VA24-EBAE100-013</p> <p>No. of samples received : 1</p> <p>No. of samples analysed : 1</p>	<p>Page : 1 of 4</p> <p>Laboratory : ALS Environmental - Fort St. John</p> <p>Account Manager : Brent Mack</p> <p>Address : 11007 Alaska Road Fort St. John BC Canada V1J 6P3</p> <p>Telephone : 778-370-3279</p> <p>Date Samples Received : 09-Sep-2024 13:10</p> <p>Date Analysis Commenced : 13-Sep-2024</p> <p>Issue Date : 18-Sep-2024 08:34</p>
--	---

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Certificate of Analysis contains the following information:

- General Comments
- Analytical Results

Additional information pertinent to this report will be found in the following separate attachments: Quality Control Report, QC Interpretive report to assist with Quality Review and Sample Receipt Notification (SRN).

### Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

<i>Signatories</i>	<i>Position</i>	<i>Laboratory Department</i>
David Tremblett	VOC Section Supervisor	Air Quality, Waterloo, Ontario



## General Comments

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Refer to the ALS Quality Control Interpretive report (QCI) for applicable references and methodology summaries. Reference methods may incorporate modifications to improve performance.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis.

Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

Please refer to Quality Control Interpretive report (QCI) for information regarding Holding Time compliance.

Key : CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances  
LOR: Limit of Reporting (detection limit).

<i>Unit</i>	<i>Description</i>
-	no units
%	percent
µg/m <sup>3</sup>	micrograms per cubic metre
Inches Hg	inches of mercury
ppbv	parts per billion (volume/volume)

<: less than.

>: greater than.

Surrogate: An analyte that is similar in behavior to target analyte(s), but that does not occur naturally in environmental samples. For applicable tests, surrogates are added to samples prior to analysis as a check on recovery.

Test results reported relate only to the samples as received by the laboratory.

UNLESS OTHERWISE STATED on SRN or QCI Report, ALL SAMPLES WERE RECEIVED IN ACCEPTABLE CONDITION.

## Qualifiers

<i>Qualifier</i>	<i>Description</i>
HTA	Analytical holding time was exceeded.



## Analytical Results

Sub-Matrix: Air					Client sample ID	LOCATION 3	---	---	---	---
(Matrix: Air)					Client sampling date / time	09-Sep-2024 11:16	---	---	---	---
Analyte	CAS Number	Method/Lab	LOR	Unit	FJ2402713-001	-----	-----	-----	-----	
						Result	---	---	---	---
<b>Field Tests</b>										
ID, batch proof	----	EF001/WT	-	-	240702.221	---	---	---	---	---
ID, canister	----	EF001/WT	-	-	01400-0101	---	---	---	---	---
ID, regulator	----	EF001/WT	-	-	G245	---	---	---	---	---
Pressure on receipt	----	EF001/WT	0.10	Inches Hg	-2.05	---	---	---	---	---
<b>Sulfur Compounds</b>										
Carbon disulfide	75-15-0	EC630/WT	6.2	µg/m <sup>3</sup>	<6.2	---	---	---	---	---
Carbon disulfide	75-15-0	E630/WT	2.0	ppbv	<2.0 <sup>HTA</sup>	---	---	---	---	---
Carbonyl sulfide	463-58-1	EC630/WT	10	µg/m <sup>3</sup>	24	---	---	---	---	---
Carbonyl sulfide	463-58-1	E630/WT	4.0	ppbv	9.6 <sup>HTA</sup>	---	---	---	---	---
Diethyl disulfide	110-81-6	EC630/WT	10	µg/m <sup>3</sup>	<10	---	---	---	---	---
Diethyl disulfide	110-81-6	E630/WT	2.0	ppbv	<2.0 <sup>HTA</sup>	---	---	---	---	---
Diethyl sulfide	352-93-2	EC630/WT	15	µg/m <sup>3</sup>	<15	---	---	---	---	---
Diethyl sulfide	352-93-2	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---	---
Dimethyl disulfide	624-92-0	EC630/WT	7.7	µg/m <sup>3</sup>	<7.7	---	---	---	---	---
Dimethyl disulfide	624-92-0	E630/WT	2.0	ppbv	<2.0 <sup>HTA</sup>	---	---	---	---	---
Dimethyl sulfide	75-18-3	EC630/WT	10	µg/m <sup>3</sup>	<10	---	---	---	---	---
Dimethyl sulfide	75-18-3	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---	---
Dimethylthiophene, 2,5-	638-02-8	EC630/WT	18	µg/m <sup>3</sup>	<18	---	---	---	---	---
Dimethylthiophene, 2,5-	638-02-8	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---	---
Ethyl mercaptan	75-08-1	EC630/WT	10	µg/m <sup>3</sup>	<10	---	---	---	---	---
Ethyl mercaptan	75-08-1	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---	---
Ethyl methyl sulfide	624-89-5	EC630/WT	12	µg/m <sup>3</sup>	<12	---	---	---	---	---
Ethyl methyl sulfide	624-89-5	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---	---
Ethylthiophene, 2-	872-55-9	EC630/WT	18	µg/m <sup>3</sup>	<18	---	---	---	---	---
Ethylthiophene, 2-	872-55-9	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---	---
Hydrogen sulfide	7783-06-4	EC630/WT	5.6	µg/m <sup>3</sup>	<5.6	---	---	---	---	---
Hydrogen sulfide	7783-06-4	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---	---
Isobutyl mercaptan	513-44-0	EC630/WT	15	µg/m <sup>3</sup>	<15	---	---	---	---	---
Isobutyl mercaptan	513-44-0	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---	---



## Analytical Results

Sub-Matrix: Air					Client sample ID	LOCATION 3	----	----	----	----
(Matrix: Air)					Client sampling date / time	09-Sep-2024 11:16	----	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	FJ2402713-001	-----	-----	-----	-----	
					Result	---	---	---	---	
<b>Sulfur Compounds</b>										
Isopropyl mercaptan	75-33-2	EC630/WT	12	µg/m <sup>3</sup>	<12	---	---	---	---	
Isopropyl mercaptan	75-33-2	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---	
Methyl mercaptan	74-93-1	EC630/WT	7.9	µg/m <sup>3</sup>	<7.9	---	---	---	---	
Methyl mercaptan	74-93-1	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---	
Methylthiophene, 2-	554-14-3	EC630/WT	16	µg/m <sup>3</sup>	<16	---	---	---	---	
Methylthiophene, 2-	554-14-3	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---	
Methylthiophene, 3-	616-44-4	EC630/WT	16	µg/m <sup>3</sup>	<16	---	---	---	---	
Methylthiophene, 3-	616-44-4	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---	
n-Butyl mercaptan	109-79-5	EC630/WT	15	µg/m <sup>3</sup>	<15	---	---	---	---	
n-Butyl mercaptan	109-79-5	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---	
Propyl mercaptan	107-03-9	EC630/WT	12	µg/m <sup>3</sup>	<12	---	---	---	---	
Propyl mercaptan	107-03-9	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---	
sec-butyl mercaptan + thiophene	----	EC630/WT	14	µg/m <sup>3</sup>	<21	---	---	---	---	
sec-butyl mercaptan + thiophene	----	E630/WT	6.0	ppbv	<6.0 <sup>HTA</sup>	---	---	---	---	
t-Butyl mercaptan	75-66-1	EC630/WT	15	µg/m <sup>3</sup>	<15	---	---	---	---	
t-Butyl mercaptan	75-66-1	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---	
Tetrahydrothiophene	110-01-0	EC630/WT	14	µg/m <sup>3</sup>	<14	---	---	---	---	
Tetrahydrothiophene	110-01-0	E630/WT	4.0	ppbv	<4.0 <sup>HTA</sup>	---	---	---	---	
<b>Sulfur, total reduced (as H2S), 10 compounds</b>	----	EC630/WT	16	µg/m <sup>3</sup>	<16	---	---	---	---	
<b>Sulfur, total reduced (as H2S), 22 compounds</b>	----	EC630/WT	25	µg/m <sup>3</sup>	<25	---	---	---	---	
<b>Sulfur, total reduced (as H2S), NPRI 6</b>	----	EC630/WT	12	µg/m <sup>3</sup>	13	---	---	---	---	
<b>Sulfur, total reduced (as H2S), Ontario 4</b>	----	EC630/WT	11	µg/m <sup>3</sup>	<11	---	---	---	---	
<b>Permanent Gases</b>										
Methane	74-82-8	E629B-H/WT	0.050	%	<0.050	---	---	---	---	

Please refer to the General Comments section for an explanation of any result qualifiers detected.

Please refer to the Accreditation section for an explanation of analyte accreditations.

## QUALITY CONTROL INTERPRETIVE REPORT

<p><b>Work Order</b> : <b>FJ2402713</b></p> <p><b>Client</b> : <b>Tetra Tech Canada Inc.</b></p> <p><b>Contact</b> : Andrea McMillan</p> <p><b>Address</b> : 110, 140 Quarry Park Blvd SE Calgary AB Canada T2C 3G3</p> <p><b>Telephone</b> : ----</p> <p><b>Project</b> : 704.ENW.GEN03704-02</p> <p><b>PO</b> : ----</p> <p><b>C-O-C number</b> : ----</p> <p><b>Sampler</b> : Thomas Kolb</p> <p><b>Site</b> : ----</p> <p><b>Quote number</b> : VA24-EBAE100-013</p> <p><b>No. of samples received</b> : 1</p> <p><b>No. of samples analysed</b> : 1</p>	<p><b>Page</b> : 1 of 5</p> <p><b>Laboratory</b> : ALS Environmental - Fort St. John</p> <p><b>Account Manager</b> : Brent Mack</p> <p><b>Address</b> : 11007 Alaska Road Fort St. John, British Columbia Canada V1J 6P3</p> <p><b>Telephone</b> : 778-370-3279</p> <p><b>Date Samples Received</b> : 09-Sep-2024 13:10</p> <p><b>Issue Date</b> : 18-Sep-2024 08:34</p>
--	--

This report is automatically generated by the ALS LIMS (Laboratory Information Management System) through evaluation of Quality Control (QC) results and other QA parameters associated with this submission, and is intended to facilitate rapid data validation by auditors or reviewers. The report highlights any exceptions and outliers to ALS Data Quality Objectives, provides holding time details and exceptions, summarizes QC sample frequencies, and lists applicable methodology references and summaries.

**Key**

- Anonymous: Refers to samples which are not part of this work order, but which formed part of the QC process lot.
- CAS Number: Chemical Abstracts Service number is a unique identifier assigned to discrete substances.
- DQO: Data Quality Objective.
- LOR: Limit of Reporting (detection limit).
- RPD: Relative Percent Difference.

### ***Workorder Comments***

Holding times are displayed as "----" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

### ***Summary of Outliers***

#### ***Outliers : Quality Control Samples***

- No Method Blank value outliers occur.
- No Duplicate outliers occur.
- No Laboratory Control Sample (LCS) outliers occur
- No Test sample Surrogate recovery outliers exist.

#### ***Outliers: Reference Material (RM) Samples***

- No Reference Material (RM) Sample outliers occur.

#### ***Outliers : Analysis Holding Time Compliance (Breaches)***

- Analysis Holding Time Outliers exist - please see following pages for full details.



## ***Outliers : Frequency of Quality Control Samples***

- No Quality Control Sample Frequency Outliers occur.



## Analysis Holding Time Compliance

This report summarizes extraction / preparation and analysis times and compares each with ALS recommended holding times, which are selected to meet known provincial and /or federal requirements. In the absence of regulatory hold times, ALS establishes recommendations based on guidelines published by organizations such as CCME, US EPA, APHA Standard Methods, ASTM, or Environment Canada (where available). Dates and holding times reported below represent the first dates of extraction or analysis. If subsequent tests or dilutions exceeded holding times, qualifiers are added (refer to COA).

If samples are identified below as having been analyzed or extracted outside of recommended holding times, measurement uncertainties may be increased, and this should be taken into consideration when interpreting results.

Where actual sampling date is not provided on the chain of custody, the date of receipt with time at 00:00 is used for calculation purposes.

Where only the sample date without time is provided on the chain of custody, the sampling date at 00:00 is used for calculation purposes.

Matrix: Air

Evaluation: \* = Holding time exceedance ; ✓ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis			
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval
				Rec	Actual			Rec	Actual	
<b>Field Tests : Air Canister Information</b>										
<b>Canister</b> LOCATION 3	EF001	09-Sep-2024	----	----	----		13-Sep-2024	----	4 days	
<b>Permanent Gases : Permanent Gases (Methane, CO2, CO, N2, and O2) in Air (Routine Level, %)</b>										
<b>Canister</b> LOCATION 3	E629B-H	09-Sep-2024	----	----	----		13-Sep-2024	30 days	4 days	✓
<b>Sulfur Compounds : Reduced Sulfur Compounds in Passivated Canisters by GC-SCD (All List) (ppbV)</b>										
<b>Canister</b> LOCATION 3	E630	09-Sep-2024	----	----	----		17-Sep-2024	7 days	8 days	* EHT

### Legend & Qualifier Definitions

EHT: Exceeded ALS recommended hold time prior to analysis.

Rec. HT: ALS recommended hold time (see units).



## Quality Control Parameter Frequency Compliance

The following report summarizes the frequency of laboratory QC samples analyzed within the analytical batches (QC lots) in which the submitted samples were processed. The actual frequency should be greater than or equal to the expected frequency.

Matrix: Air

Evaluation: ✖ = QC frequency outside specification; ✔ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		
			QC	Regular	Actual	Expected	Evaluation
<b>Analytical Methods</b>							
<b>Laboratory Duplicates (DUP)</b>							
Permanent Gases (Methane, CO <sub>2</sub> , CO, N <sub>2</sub> , and O <sub>2</sub> ) in Air (Routine Level, %)	E629B-H	1649291	1	1	100.0	5.0	✔
Reduced Sulfur Compounds in Passivated Canisters by GC-SCD (All List) (ppbV)	E630	1649183	1	1	100.0	5.0	✔
<b>Laboratory Control Samples (LCS)</b>							
Permanent Gases (Methane, CO <sub>2</sub> , CO, N <sub>2</sub> , and O <sub>2</sub> ) in Air (Routine Level, %)	E629B-H	1649291	1	1	100.0	5.0	✔
Reduced Sulfur Compounds in Passivated Canisters by GC-SCD (All List) (ppbV)	E630	1649183	1	1	100.0	5.0	✔
<b>Method Blanks (MB)</b>							
Air Canister Information	EF001	1649126	1	6	16.6	5.0	✔
Permanent Gases (Methane, CO <sub>2</sub> , CO, N <sub>2</sub> , and O <sub>2</sub> ) in Air (Routine Level, %)	E629B-H	1649291	1	1	100.0	5.0	✔
Reduced Sulfur Compounds in Passivated Canisters by GC-SCD (All List) (ppbV)	E630	1649183	1	1	100.0	5.0	✔



## Methodology References and Summaries

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Reference methods may incorporate modifications to improve performance (indicated by "mod").

Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Permanent Gases (Methane, CO <sub>2</sub> , CO, N <sub>2</sub> , and O <sub>2</sub> ) in Air (Routine Level, %)	E629B-H  ALS Environmental - Waterloo	Air	EPA Method 3C & ASTM D1946	This analysis is performed using procedures adapted from EPA Method 3C & ASTM D1946. Air samples are collected into cleaned evacuated canisters. A volume of air is removed from the canister and injected by means of a gas-sampling/backflush valve onto a series of packed GC columns and measured using a thermal conductivity detector (TCD).  Oxygen is not separated from Argon.  Canister samples will be retained for 7 calendar days after final report. If you require a longer canister storage time, please contact your account manager.
Reduced Sulfur Compounds in Passivated Canisters by GC-SCD (All List) (ppbV)	E630  ALS Environmental - Waterloo	Air	ASTM D5504	This analysis is performed using procedures adapted from ASTM D5504. Air samples are collected into cleaned evacuated silica-coated canisters. By means of a loop system, a volume of air is transferred from the canister and cryofocused before determining the sulfur compounds by GC-SCD. Silica coated passivated canisters may allow for reliable sample analysis after 24 hours. In such cases, analysis is recommended within 7 days of collection.  Canister samples will be retained for 7 calendar days after final report. If you require a longer canister storage time, please contact your Project Manager.
Reduced Sulfur Compounds in Passivated Canisters by GC-SCD (All List) (ug/m <sup>3</sup> )	EC630  ALS Environmental - Waterloo	Air	ASTM D5504	convert ppbv to ug/m <sup>3</sup>
Air Canister Information	EF001  ALS Environmental - Waterloo	Air	In-house	Air canister information provided by client and recorded on ALS report may affect the validity of results.

## QUALITY CONTROL REPORT

<p><b>Work Order</b> : <b>FJ2402713</b></p> <p>Client : Tetra Tech Canada Inc.</p> <p>Contact : Andrea McMillan</p> <p>Address : 110, 140 Quarry Park Blvd SE Calgary AB Canada T2C 3G3</p> <p>Telephone : ----</p> <p>Project : 704.ENW.GEN03704-02</p> <p>PO : ----</p> <p>C-O-C number : ----</p> <p>Sampler : Thomas Kolb</p> <p>Site : ----</p> <p>Quote number : VA24-EBAE100-013</p> <p>No. of samples received : 1</p> <p>No. of samples analysed : 1</p>	<p>Page : 1 of 5</p> <p>Laboratory : ALS Environmental - Fort St. John</p> <p>Account Manager : Brent Mack</p> <p>Address : 11007 Alaska Road Fort St. John, British Columbia Canada V1J 6P3</p> <p>Telephone : 778-370-3279</p> <p>Date Samples Received : 09-Sep-2024 13:10</p> <p>Date Analysis Commenced : 13-Sep-2024</p> <p>Issue Date : 18-Sep-2024 08:34</p>
---	--

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Quality Control Report contains the following information:

- Laboratory Duplicate (DUP) Report; Relative Percent Difference (RPD) and Data Quality Objectives
- Method Blank (MB) Report; Recovery and Data Quality Objectives
- Laboratory Control Sample (LCS) Report; Recovery and Data Quality Objectives

### Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

<i>Signatories</i>	<i>Position</i>	<i>Laboratory Department</i>
David Tremblett	VOC Section Supervisor	Waterloo Air Quality, Waterloo, Ontario



---

## General Comments

The ALS Quality Control (QC) report is optionally provided to ALS clients upon request. ALS test methods include comprehensive QC checks with every analysis to ensure our high standards of quality are met. Each QC result has a known or expected target value, which is compared against predetermined Data Quality Objectives (DQOs) to provide confidence in the accuracy of associated test results. This report contains detailed results for all QC results applicable to this sample submission. Please refer to the ALS Quality Control Interpretation report (QCI) for applicable method references and methodology summaries.

### Key :

Anonymous = Refers to samples which are not part of this work order, but which formed part of the QC process lot.

CAS Number = Chemical Abstracts Service number is a unique identifier assigned to discrete substances.

DQO = Data Quality Objective.

LOR = Limit of Reporting (detection limit).

RPD = Relative Percent Difference

# = Indicates a QC result that did not meet the ALS DQO.

---

## Workorder Comments

Holding times are displayed as "---" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

---



### Laboratory Duplicate (DUP) Report

A Laboratory Duplicate (DUP) is a randomly selected intralaboratory replicate sample. Laboratory Duplicates provide information regarding method precision and sample heterogeneity. ALS DQOs for Laboratory Duplicates are expressed as test-specific limits for Relative Percent Difference (RPD), or as an absolute difference limit of 2 times the LOR for low concentration duplicates within ~ 4-10 times the LOR (cut-off is test-specific).

Sub-Matrix: Air

					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
<b>Sulfur Compounds (QC Lot: 1649183)</b>											
FJ2402713-001	LOCATION 3	Carbon disulfide	75-15-0	E630	2.0	ppbv	<2.0	<2.0	0	Diff <2x LOR	----
		Carbonyl sulfide	463-58-1	E630	4.0	ppbv	9.6	9.4	0.2	Diff <2x LOR	----
		Diethyl disulfide	110-81-6	E630	2.0	ppbv	<2.0	<2.0	0	Diff <2x LOR	----
		Diethyl sulfide	352-93-2	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Dimethyl disulfide	624-92-0	E630	2.0	ppbv	<2.0	<2.0	0	Diff <2x LOR	----
		Dimethyl sulfide	75-18-3	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Dimethylthiophene, 2,5-	638-02-8	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Ethyl mercaptan	75-08-1	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Ethyl methyl sulfide	624-89-5	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Ethylthiophene, 2-	872-55-9	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Hydrogen sulfide	7783-06-4	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Isobutyl mercaptan	513-44-0	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Isopropyl mercaptan	75-33-2	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Methyl mercaptan	74-93-1	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Methylthiophene, 2-	554-14-3	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Methylthiophene, 3-	616-44-4	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		n-Butyl mercaptan	109-79-5	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Propyl mercaptan	107-03-9	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		sec-butyl mercaptan + thiophene	----	E630	6.0	ppbv	<6.0	<6.0	0	Diff <2x LOR	----
		t-Butyl mercaptan	75-66-1	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Tetrahydrothiophene	110-01-0	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
<b>Permanent Gases (QC Lot: 1649291)</b>											
FJ2402713-001	LOCATION 3	Methane	74-82-8	E629B-H	0.050	%	<0.050	<0.050	0	Diff <2x LOR	----



## Method Blank (MB) Report

A Method Blank is an analyte-free matrix that undergoes sample processing identical to that carried out for test samples. Method Blank results are used to monitor and control for potential contamination from the laboratory environment and reagents. For most tests, the DQO for Method Blanks is for the result to be < LOR.

Sub-Matrix: Air

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
<b>Field Tests (QCLot: 1649126)</b>						
Pressure on receipt	---	EF001	0.1	Inches Hg	-30.0	---
<b>Sulfur Compounds (QCLot: 1649183)</b>						
Carbon disulfide	75-15-0	E630	2	ppbv	<2.0	---
Carbonyl sulfide	463-58-1	E630	4	ppbv	<4.0	---
Diethyl disulfide	110-81-6	E630	2	ppbv	<2.0	---
Diethyl sulfide	352-93-2	E630	4	ppbv	<4.0	---
Dimethyl disulfide	624-92-0	E630	2	ppbv	<2.0	---
Dimethyl sulfide	75-18-3	E630	4	ppbv	<4.0	---
Dimethylthiophene, 2,5-	638-02-8	E630	4	ppbv	<4.0	---
Ethyl mercaptan	75-08-1	E630	4	ppbv	<4.0	---
Ethyl methyl sulfide	624-89-5	E630	4	ppbv	<4.0	---
Ethylthiophene, 2-	872-55-9	E630	4	ppbv	<4.0	---
Hydrogen sulfide	7783-06-4	E630	4	ppbv	<4.0	---
Isobutyl mercaptan	513-44-0	E630	4	ppbv	<4.0	---
Isopropyl mercaptan	75-33-2	E630	4	ppbv	<4.0	---
Methyl mercaptan	74-93-1	E630	4	ppbv	<4.0	---
Methylthiophene, 2-	554-14-3	E630	4	ppbv	<4.0	---
Methylthiophene, 3-	616-44-4	E630	4	ppbv	<4.0	---
n-Butyl mercaptan	109-79-5	E630	4	ppbv	<4.0	---
Propyl mercaptan	107-03-9	E630	4	ppbv	<4.0	---
sec-butyl mercaptan + thiophene	---	E630	6	ppbv	<6.0	---
t-Butyl mercaptan	75-66-1	E630	4	ppbv	<4.0	---
Tetrahydrothiophene	110-01-0	E630	4	ppbv	<4.0	---
<b>Permanent Gases (QCLot: 1649291)</b>						
Methane	74-82-8	E629B-H	0.05	%	<0.050	---





## Laboratory Control Sample (LCS) Report

A Laboratory Control Sample (LCS) is an analyte-free matrix that has been fortified (spiked) with test analytes at known concentration and processed in an identical manner to test samples. LCS results are expressed as percent recovery, and are used to monitor and control test method accuracy and precision, independent of test sample matrix.

Sub-Matrix: Air

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
<b>Sulfur Compounds (QCLot: 1649183)</b>									
Carbonyl sulfide	463-58-1	E630	4	ppbv	104 ppbv	98.6	60.0	140	----
Hydrogen sulfide	7783-06-4	E630	4	ppbv	112 ppbv	97.1	60.0	140	----
Methyl mercaptan	74-93-1	E630	4	ppbv	101 ppbv	102	60.0	140	----
<b>Permanent Gases (QCLot: 1649291)</b>									
Methane	74-82-8	E629B-H	0.05	%	15 %	93.4	70.0	130	----

Rush Samples

FJAE Shipping & Receiving

Call Out Expedite

Priority

# of Coolers Air

# of Carboys Ground

60 NORTHLAND ROAD, UNIT 1  
WATERLOO, ON N2V 2B8

Phone: (519) 886-6910

Fax: (519) 886-9047

Toll Free: 1-800-668-9878



AIR QUALITY CHAIN OF CUSTODY FORM - Canister/Tube/Gas Bag

Note: All TAT Quoted is in business days which exclude statutory holidays and weekends. TAT of samples received past 3:00 pm or Saturday / Sunday begin the next day.

DATE REQUIRED	SERVICE REQUESTED	Rush 3 day (100%)	<input checked="" type="checkbox"/>
9/13/24	10 day (regular)	Rush 2 day (200%)	<input type="checkbox"/>
	Rush 5 day (50%)	Rush 1 day (300%) - Enquire	<input type="checkbox"/>

COMPANY NAME: TETRA TECH  
 OFFICE: 140 QUEENY PARK BLVD, CANADA, MISSISSAUGA ONT L4W 3G3  
 PROJECT MANAGER: ANNEKA MC MILLAN  
 PROJECT #: 704-ENW. GEN03701-02  
 PHONE: 403 203 3355  
 ACCOUNT #: TETRA TECH  
 QUOTATION #: VA 24-6046100-013

REGULATION: [ ]  
 CRITERIA: [ ]  
 OTHER INFORMATION: [ ]  
 REPORT FORMAT/DISTRIBUTION: EMAIL  FAX [ ] BOTH [ ]  
 SELECT: PDF  DIGITAL  BOTH   
 EMAIL 1: ANNEKA.MCMILLAN@TETRA.TECH.COM  
 EMAIL 2: AZIZ.SHAIKH@TETRA.TECH.COM

All rush work requires lab approval before sample submission  
 SUBMISSION #: [ ]  
 ENTERED BY: [ ]  
 DATE/TIME ENTERED: [ ]  
 BIN #: [ ]

SAMPLING INFORMATION				
Sample Date/Time	Canister or Tube ID#	Regulator Serial #	Matrix Type	Time (24hr)
09-SEP-24 11:16	01400-0101	Q245	AA	

TUBE AIR VOLUME	STARTING PRESSURE - Pre-Sampling ("Hg)	ENDING PRESSURE - Post Sampling ("Hg)	COLLECTION TIME (MIN)	Field Conditions (Rain/Wind/Dust/Odour)	Field PID Reading	LAB ID
1.4	30	28	4	RAIN, Open		

Environmental Division  
 Fort St. John  
 Work Order Reference  
**FJ2402713**



Telephone : +1 250 261 5517

SPECIAL INSTRUCTIONS/COMMENTS: [ ]

SAMPLED BY: THOMAS KOLB  
 RELINQUISHED BY: THOMAS KOLB

This Chain of Custody Form is only to be used for Air Quality Samples

Soil Gas Vapour = SG  
 Indoor Air = IA  
 Ambient Air = AA  
 Industrial Hygiene = IH

DATE & TIME: 9/13/24 11:00  
 RECEIVED BY: [ ]  
 DATE & TIME: 9/14/24 1:00  
 RECEIVED AT LAB BY: [ ]

SAMPLE CONDITION AS RECEIVED

FROZEN   
 COLD   
 COOLING INITIATED   
 AMBIENT

OBSERVATIONS: Yes  No   
 If yes add SIF

Notes

1. Quote number must be provided to ensure proper pricing

2. TAT may vary dependent on complexity of analysis and lab workload at time of submission. Please contact the lab to confirm TATs.

3. Any known or suspected hazards relating to a sample must be noted on the chain of custody in comments section.

1400

# AIR SAMPLING MEDIA REQUEST FORM



COMPLETE Blue sections. Gray sections are for INTERNAL USE ONLY  
Form MUST be reviewed & initiated by an ALS Account Manager prior to submission to NAWTR AIRMEDIA REQUEST (nawtr.airmediarequest@alsglobal.com)

CLIENT:	TetraTech	ORDER TAKEN BY:	Wendy Sears
CLIENT CONTACT:	Andrea McMillan	ORDER DATE:	21-Aug-24
CLIENT PROJECT/PO:	Gas and GW sampling	AM REVIEWER:	DSTASTNY
QUOTE #: (mandatory)	TetraTech MSA	CLIENT EXPECT DATE:	23-Aug-24
DELIVERY TO:	ALS Fort St John BC, 11607 Alaska Road, Fort St John, BC, V1J 6P3 for client P/U	ORDER FILLED BY:	YB
TELEPHONE NUMBER:	587-930-1121	PEER REVIEWER:	
SHIP TO (include email):	andrea.mcmillan@tetratech.com	DATE COMPLETED:	23-Aug-24

Shipping Method:  Regular (ALS will cover shipping cost)  
 RUSH (Client will be billed for shipping costs, please confirm with Account Manager)  
 External Courier  
 Pickup at ALS  
 Location:   
 ALS Drivers

Shipping Company:  FedEx  
 Purolator  
 DHL  
 UPS  
 Other  
 N/A

Tracking Number:

Completion of all Sections is Mandatory

1. What type of air is being sampled? **Check all appropriate types in the Additional Information Box below**
  2. Please provide a list of compounds and reporting limits that are required. **Include regulation & target list (attach to email)**
  3. What is your planned canister sampling time? **Options listed under Regulator Times**
  4. Trip blanks will be shipped pre-filled unless specifically requested below.
- Note: If analysis required is DIFFERENT than what is LISTED on this form, email nawtr.airmediarequest@alsglobal.com ASAP to confirm the media was adequately proofed.**

Canister Size/Tube	Regulator Times	Regulator Quantity	Parameters/ Product Codes	Canister/Tube Identification #	Initial Pressure/Flow (mmHg/mL per min)	Controller Identification #
6L Canister	24 hr					
	12 hr					
	8 hr					
	4 hr					
	1 hr					
	0.5 hr					
Number of Canisters	Trip Blank					
1.4L Canister	60 mins		Methane, S629M, Full Sulfur Scan S830	01400-0101	-28.7	G245
	20 mins					
	10 mins					
	4 mins	1				
	No Restrictor					
Number of Canisters	1 Trip Blank					
Bottle Vacs	40 mins					
	14 mins					
	7 mins					
	3 mins					
Number of Canisters	Trip Blank					
Passive CarboPak X Tubes						
Diffusive Caps						
Active SVI Tubes						
Calibration Tube for SVI (yes/no)						

Other Sampling Supplies	Quantity	ID #	Additional Information & Special Instructions or Requests
Pressure Gauge			Check all that apply: <input type="checkbox"/> Indoor Air <input type="checkbox"/> Sub-Slab <input type="checkbox"/> Industrial <input checked="" type="checkbox"/> Ambient Air <input type="checkbox"/> Landfill <input type="checkbox"/> Commercial <input type="checkbox"/> Probe/Well <input type="checkbox"/> Crawlspace <input type="checkbox"/> Residential <input type="checkbox"/> Other (specify):
Caplok Tool			
Canister Stands			
Valve Adaptor for Soil Vapour			
Chargeable Supplies			COMMENTS: Methane: \$100, Sulfurs \$242, Canister 2WEEK rental \$105
Duplicate Sampler - \$45 canister			
Valve Adaptor for Soil Vapour \$5			
Teflon Tubing - \$3 per foot	-Total length (ft) -Length per section (ft)		
Nut & Ferrule Sets - \$8 per set			
Tedlar Bags (contact the lab before SUBMITTING)	-\$28 unpurged -\$45 purged		
Siloxane Kit - \$100 each (Kit: \$50, TD tube prep/rental: \$50)			
Rush Order Prep Charge (<48 hour notice, not including shipping)	\$50		
Include sampling supplies from other ALS location (yes/no)			
SEE COMMENTS			

RENTAL COSTS: Canister Rental is 2 WEEKS only. After this time additional rental fees apply.  
 MEDIA REPLACEMENT COSTS: (Media lost or damaged will be charged to the client)  
 1) TD SORBENT TUBE & CAPS - \$190.00 2) TD DIFFUSION CAP - \$90.00 3) CAPLOK TOOL SET - \$95.00 4) VACUUM GAUGE - \$240.00 5) BOTTLEVAC CANISTER - \$135.00  
 6) PROTECTIVE CAP - \$35.00 7) CANISTER - 6L: \$650.00; 1.4L: \$480.00 8) CONTROLLER - TWA: \$1000.00 GRAB: \$850.00 9) CANISTER STAND - \$75.00 10) DUPLICATE SAMPLER - \$550.00

**CERTIFICATE OF ANALYSIS**

<b>Work Order</b>	: <b>FJ2403535</b>		
Client	: Tetra Tech Canada Inc.	Laboratory	: ALS Environmental - Waterloo
Contact	: Andrea McMillan	Account Manager	: Brent Mack
Address	: 110, 140 Quarry Park Blvd SE Calgary Alberta Canada T2C 3G3	Address	: 60 Northland Road, Unit 1 Waterloo ON Canada N2V 2B8
Telephone	: ----	Telephone	: 778-370-3279
Project	: 704-ENW.GENV03704-02, Task 001	Date Samples Received	: 20-Nov-2024 12:45
PO	: ----	Date Analysis Commenced	: 22-Nov-2024
C-O-C number	: ----	Issue Date	: 27-Nov-2024 10:05
Sampler	: Leroy Wolford		
Site	: ----		
Quote number	: VA24-EBAE100-013		
No. of samples received	: 1		
No. of samples analysed	: 1		

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Certificate of Analysis contains the following information:

- General Comments
- Analytical Results

Additional information pertinent to this report will be found in the following separate attachments: Quality Control Report, QC Interpretive report to assist with Quality Review and Sample Receipt Notification (SRN).

**Signatories**

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

<i>Signatories</i>	<i>Position</i>	<i>Laboratory Department</i>
David Tremblett	VOC Section Supervisor	Air Quality, Waterloo, Ontario



## General Comments

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Refer to the ALS Quality Control Interpretive report (QCI) for applicable references and methodology summaries. Reference methods may incorporate modifications to improve performance.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis.

Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

Please refer to Quality Control Interpretive report (QCI) for information regarding Holding Time compliance.

Key: CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances.  
LOR: Limit of Reporting (detection limit).

<i>Unit</i>	<i>Description</i>
-	no units
inches Hg	inches of mercury
µg/m <sup>3</sup>	micrograms per cubic metre
ppbv	parts per billion (volume/volume)
%	percent

<: less than.

>: greater than.

Surrogate: An analyte that is similar in behavior to target analyte(s), but that does not occur naturally in environmental samples. For applicable tests, surrogates are added to samples prior to analysis as a check on recovery.

Test results reported relate only to the samples as received by the laboratory.

UNLESS OTHERWISE STATED on SRN or QCI Report, ALL SAMPLES WERE RECEIVED IN ACCEPTABLE CONDITION.

Work Order : FJ2403535  
Client : Tetra Tech Canada Inc.  
Project : 704-ENW.GENV03704-02, Task 001

---





**Analytical Results**

Sub-Matrix: Air (Matrix: Air)					Client sample ID	Location 3	----	----	----	----
Client sampling date / time					20-Nov-2024 11:10	----	----	----	----	
Analyte	CAS Number	Method/Lab	LOR	Unit	FJ2403535-001	----	----	----	----	
					Result	----	----	----	----	
<b>Field Tests</b>										
ID, batch proof	----	EF001/WT	-	-	240728.222	----	----	----	----	
ID, canister	----	EF001/WT	-	-	01400-0216	----	----	----	----	
ID, regulator	----	EF001/WT	-	-	G289	----	----	----	----	
Pressure on receipt	----	EF001/WT	0.10	inches Hg	-6.13	----	----	----	----	
<b>Sulfur Compounds</b>										
Carbon disulfide	75-15-0	E630/WT	2.0	ppbv	<2.0	----	----	----	----	
Carbon disulfide	75-15-0	EC630/WT	6.2	µg/m³	<6.2	----	----	----	----	
Carbonyl sulfide	463-58-1	E630/WT	4.0	ppbv	<4.0	----	----	----	----	
Carbonyl sulfide	463-58-1	EC630/WT	10	µg/m³	<10	----	----	----	----	
Diethyl disulfide	110-81-6	E630/WT	2.0	ppbv	<2.0	----	----	----	----	
Diethyl disulfide	110-81-6	EC630/WT	10	µg/m³	<10	----	----	----	----	
Diethyl sulfide	352-93-2	E630/WT	4.0	ppbv	<4.0	----	----	----	----	
Diethyl sulfide	352-93-2	EC630/WT	15	µg/m³	<15	----	----	----	----	
Dimethyl disulfide	624-92-0	E630/WT	2.0	ppbv	<2.0	----	----	----	----	
Dimethyl disulfide	624-92-0	EC630/WT	7.7	µg/m³	<7.7	----	----	----	----	
Dimethyl sulfide	75-18-3	E630/WT	4.0	ppbv	<4.0	----	----	----	----	
Dimethyl sulfide	75-18-3	EC630/WT	10	µg/m³	<10	----	----	----	----	
Dimethylthiophene, 2,5-	638-02-8	E630/WT	4.0	ppbv	<4.0	----	----	----	----	
Dimethylthiophene, 2,5-	638-02-8	EC630/WT	18	µg/m³	<18	----	----	----	----	
Ethyl mercaptan	75-08-1	E630/WT	4.0	ppbv	<4.0	----	----	----	----	
Ethyl mercaptan	75-08-1	EC630/WT	10	µg/m³	<10	----	----	----	----	



### Analytical Results

Sub-Matrix: Air (Matrix: Air)					Client sample ID	Location 3	----	----	----	----
Client sampling date / time					20-Nov-2024 11:10	----	----	----	----	
Analyte	CAS Number	Method/Lab	LOR	Unit	FJ2403535-001	----	----	----	----	
					Result	----	----	----	----	
<b>Sulfur Compounds</b>										
Ethyl methyl sulfide	624-89-5	E630/WT	4.0	ppbv	<4.0	----	----	----	----	
Ethyl methyl sulfide	624-89-5	EC630/WT	12	µg/m³	<12	----	----	----	----	
Ethylthiophene, 2-	872-55-9	E630/WT	4.0	ppbv	<4.0	----	----	----	----	
Ethylthiophene, 2-	872-55-9	EC630/WT	18	µg/m³	<18	----	----	----	----	
Hydrogen sulfide	7783-06-4	E630/WT	4.0	ppbv	<4.0	----	----	----	----	
Hydrogen sulfide	7783-06-4	EC630/WT	5.6	µg/m³	<5.6	----	----	----	----	
Isobutyl mercaptan	513-44-0	E630/WT	4.0	ppbv	<4.0	----	----	----	----	
Isobutyl mercaptan	513-44-0	EC630/WT	15	µg/m³	<15	----	----	----	----	
Isopropyl mercaptan	75-33-2	E630/WT	4.0	ppbv	<4.0	----	----	----	----	
Isopropyl mercaptan	75-33-2	EC630/WT	12	µg/m³	<12	----	----	----	----	
Methyl mercaptan	74-93-1	E630/WT	4.0	ppbv	<4.0	----	----	----	----	
Methyl mercaptan	74-93-1	EC630/WT	7.9	µg/m³	<7.9	----	----	----	----	
Methylthiophene, 2-	554-14-3	E630/WT	4.0	ppbv	<4.0	----	----	----	----	
Methylthiophene, 2-	554-14-3	EC630/WT	16	µg/m³	<16	----	----	----	----	
Methylthiophene, 3-	616-44-4	E630/WT	4.0	ppbv	<4.0	----	----	----	----	
Methylthiophene, 3-	616-44-4	EC630/WT	16	µg/m³	<16	----	----	----	----	
n-Butyl mercaptan	109-79-5	E630/WT	4.0	ppbv	<4.0	----	----	----	----	
n-Butyl mercaptan	109-79-5	EC630/WT	15	µg/m³	<15	----	----	----	----	
Propyl mercaptan	107-03-9	E630/WT	4.0	ppbv	<4.0	----	----	----	----	
Propyl mercaptan	107-03-9	EC630/WT	12	µg/m³	<12	----	----	----	----	
sec-butyl mercaptan + thiophene	----	E630/WT	6.0	ppbv	<6.0	----	----	----	----	





### Analytical Results

Sub-Matrix: Air  
 (Matrix: Air)

					Client sample ID	Location 3	----	----	----	----
					Client sampling date / time	20-Nov-2024 11:10	----	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	FJ2403535-001	----	----	----	----	----
						Result	----	----	----	----
<b>Sulfur Compounds</b>										
sec-butyl mercaptan + thiophene	----	EC630/WT	14	µg/m³	<21	----	----	----	----	----
t-Butyl mercaptan	75-66-1	E630/WT	4.0	ppbv	<4.0	----	----	----	----	----
t-Butyl mercaptan	75-66-1	EC630/WT	15	µg/m³	<15	----	----	----	----	----
Tetrahydrothiophene	110-01-0	E630/WT	4.0	ppbv	<4.0	----	----	----	----	----
Tetrahydrothiophene	110-01-0	EC630/WT	14	µg/m³	<14	----	----	----	----	----
Sulfur, total reduced (as H2S), 10 compounds	----	EC630/WT	16	µg/m³	<16	----	----	----	----	----
Sulfur, total reduced (as H2S), 22 compounds	----	EC630/WT	25	µg/m³	<25	----	----	----	----	----
Sulfur, total reduced (as H2S), NPRI 6	----	EC630/WT	12	µg/m³	<12	----	----	----	----	----
Sulfur, total reduced (as H2S), Ontario 4	----	EC630/WT	11	µg/m³	<11	----	----	----	----	----
<b>Permanent Gases</b>										
Methane	74-82-8	E629B-H/WT	0.050	%	<0.050	----	----	----	----	----

Please refer to the General Comments section for an explanation of any result qualifiers detected.

## QUALITY CONTROL INTERPRETIVE REPORT

<p><b>Work Order</b> : <b>FJ2403535</b></p> <p><b>Client</b> : <b>Tetra Tech Canada Inc.</b></p> <p><b>Contact</b> : Andrea McMillan</p> <p><b>Address</b> : 110, 140 Quarry Park Blvd SE Calgary AB Canada T2C 3G3</p> <p><b>Telephone</b> : ----</p> <p><b>Project</b> : 704-ENW.GENV03704-02, Task 001</p> <p><b>PO</b> : ----</p> <p><b>C-O-C number</b> : ----</p> <p><b>Sampler</b> : Leroy Wolford</p> <p><b>Site</b> : ----</p> <p><b>Quote number</b> : VA24-EBAE100-013</p> <p><b>No. of samples received</b> : 1</p> <p><b>No. of samples analysed</b> : 1</p>	<p><b>Page</b> : 1 of 5</p> <p><b>Laboratory</b> : ALS Environmental - Fort St. John</p> <p><b>Account Manager</b> : Brent Mack</p> <p><b>Address</b> : 11007 Alaska Road Fort St. John, British Columbia Canada V1J 6P3</p> <p><b>Telephone</b> : 778-370-3279</p> <p><b>Date Samples Received</b> : 20-Nov-2024 12:45</p> <p><b>Issue Date</b> : 27-Nov-2024 10:04</p>
---	--

This report is automatically generated by the ALS LIMS (Laboratory Information Management System) through evaluation of Quality Control (QC) results and other QA parameters associated with this submission, and is intended to facilitate rapid data validation by auditors or reviewers. The report highlights any exceptions and outliers to ALS Data Quality Objectives, provides holding time details and exceptions, summarizes QC sample frequencies, and lists applicable methodology references and summaries.

**Key**

- Anonymous: Refers to samples which are not part of this work order, but which formed part of the QC process lot.
- CAS Number: Chemical Abstracts Service number is a unique identifier assigned to discrete substances.
- DQO: Data Quality Objective.
- LOR: Limit of Reporting (detection limit).
- RPD: Relative Percent Difference.

### ***Workorder Comments***

Holding times are displayed as "----" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

### ***Summary of Outliers***

#### ***Outliers : Quality Control Samples***

- No Method Blank value outliers occur.
- No Duplicate outliers occur.
- No Laboratory Control Sample (LCS) outliers occur
- No Test sample Surrogate recovery outliers exist.

#### ***Outliers: Reference Material (RM) Samples***

- No Reference Material (RM) Sample outliers occur.

#### ***Outliers : Analysis Holding Time Compliance (Breaches)***

- No Analysis Holding Time Outliers exist.

## ***Outliers : Frequency of Quality Control Samples***

- No Quality Control Sample Frequency Outliers occur.



## Analysis Holding Time Compliance

This report summarizes extraction / preparation and analysis times and compares each with ALS recommended holding times, which are selected to meet known provincial and /or federal requirements. In the absence of regulatory hold times, ALS establishes recommendations based on guidelines published by organizations such as CCME, US EPA, APHA Standard Methods, ASTM, or Environment Canada (where available). Dates and holding times reported below represent the first dates of extraction or analysis. If subsequent tests or dilutions exceeded holding times, qualifiers are added (refer to COA).

If samples are identified below as having been analyzed or extracted outside of recommended holding times, measurement uncertainties may be increased, and this should be taken into consideration when interpreting results.

Where actual sampling date is not provided on the chain of custody, the date of receipt with time at 00:00 is used for calculation purposes.

Where only the sample date without time is provided on the chain of custody, the sampling date at 00:00 is used for calculation purposes.

Matrix: Air

Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis			
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval
				Rec	Actual			Rec	Actual	
<b>Field Tests : Air Canister Information</b>										
<b>Canister</b> Location 3	EF001	20-Nov-2024	----	----	----		22-Nov-2024	----	2 days	
<b>Permanent Gases : Permanent Gases (Methane, CO2, CO, N2, and O2) in Air (Routine Level, %)</b>										
<b>Canister</b> Location 3	E629B-H	20-Nov-2024	----	----	----		26-Nov-2024	30 days	6 days	✔
<b>Sulfur Compounds : Reduced Sulfur Compounds in Passivated Canisters by GC-SCD (All List) (ppbV)</b>										
<b>Canister</b> Location 3	E630	20-Nov-2024	----	----	----		22-Nov-2024	7 days	2 days	✔

### Legend & Qualifier Definitions

Rec. HT: ALS recommended hold time (see units).



## Quality Control Parameter Frequency Compliance

The following report summarizes the frequency of laboratory QC samples analyzed within the analytical batches (QC lots) in which the submitted samples were processed. The actual frequency should be greater than or equal to the expected frequency.

Matrix: Air

Evaluation: ✖ = QC frequency outside specification; ✔ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		
			QC	Regular	Actual	Expected	Evaluation
<b>Analytical Methods</b>							
<b>Laboratory Duplicates (DUP)</b>							
Permanent Gases (Methane, CO <sub>2</sub> , CO, N <sub>2</sub> , and O <sub>2</sub> ) in Air (Routine Level, %)	E629B-H	1784037	1	1	100.0	5.0	✔
Reduced Sulfur Compounds in Passivated Canisters by GC-SCD (All List) (ppbV)	E630	1779200	1	1	100.0	5.0	✔
<b>Laboratory Control Samples (LCS)</b>							
Permanent Gases (Methane, CO <sub>2</sub> , CO, N <sub>2</sub> , and O <sub>2</sub> ) in Air (Routine Level, %)	E629B-H	1784037	1	1	100.0	5.0	✔
Reduced Sulfur Compounds in Passivated Canisters by GC-SCD (All List) (ppbV)	E630	1779200	1	1	100.0	5.0	✔
<b>Method Blanks (MB)</b>							
Air Canister Information	EF001	1779225	1	20	5.0	5.0	✔
Permanent Gases (Methane, CO <sub>2</sub> , CO, N <sub>2</sub> , and O <sub>2</sub> ) in Air (Routine Level, %)	E629B-H	1784037	1	1	100.0	5.0	✔
Reduced Sulfur Compounds in Passivated Canisters by GC-SCD (All List) (ppbV)	E630	1779200	1	1	100.0	5.0	✔



## Methodology References and Summaries

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Reference methods may incorporate modifications to improve performance (indicated by "mod").

Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Permanent Gases (Methane, CO <sub>2</sub> , CO, N <sub>2</sub> , and O <sub>2</sub> ) in Air (Routine Level, %)	E629B-H  ALS Environmental - Waterloo	Air	EPA Method 3C & ASTM D1946	This analysis is performed using procedures adapted from EPA Method 3C & ASTM D1946. Air samples are collected into cleaned evacuated canisters. A volume of air is removed from the canister and injected by means of a gas-sampling/backflush valve onto a series of packed GC columns and measured using a thermal conductivity detector (TCD).  Oxygen is not separated from Argon.  Canister samples will be retained for 7 calendar days after final report. If you require a longer canister storage time, please contact your account manager.
Reduced Sulfur Compounds in Passivated Canisters by GC-SCD (All List) (ppbV)	E630  ALS Environmental - Waterloo	Air	ASTM D5504	This analysis is performed using procedures adapted from ASTM D5504. Air samples are collected into cleaned evacuated silica-coated canisters. By means of a loop system, a volume of air is transferred from the canister and cryofocused before determining the sulfur compounds by GC-SCD. Silica coated passivated canisters may allow for reliable sample analysis after 24 hours. In such cases, analysis is recommended within 7 days of collection.  Canister samples will be retained for 7 calendar days after final report. If you require a longer canister storage time, please contact your Project Manager.
Reduced Sulfur Compounds in Passivated Canisters by GC-SCD (All List) (ug/m <sup>3</sup> )	EC630  ALS Environmental - Waterloo	Air	ASTM D5504	convert ppbv to ug/m <sup>3</sup>
Air Canister Information	EF001  ALS Environmental - Waterloo	Air	In-house	Air canister information provided by client and recorded on ALS report may affect the validity of results.

## QUALITY CONTROL REPORT

<b>Work Order</b>	<b>: FJ2403535</b>	<b>Page</b>	: 1 of 5
<b>Client</b>	: Tetra Tech Canada Inc.	<b>Laboratory</b>	: ALS Environmental - Fort St. John
<b>Contact</b>	: Andrea McMillan	<b>Account Manager</b>	: Brent Mack
<b>Address</b>	: 110, 140 Quarry Park Blvd SE Calgary AB Canada T2C 3G3	<b>Address</b>	: 11007 Alaska Road Fort St. John, British Columbia Canada V1J 6P3
<b>Telephone</b>	: ----	<b>Telephone</b>	: 778-370-3279
<b>Project</b>	: 704-ENW.GENV03704-02, Task 001	<b>Date Samples Received</b>	: 20-Nov-2024 12:45
<b>PO</b>	: ----	<b>Date Analysis Commenced</b>	: 22-Nov-2024
<b>C-O-C number</b>	: ----	<b>Issue Date</b>	: 27-Nov-2024 10:04
<b>Sampler</b>	: Leroy Wolford		
<b>Site</b>	: ----		
<b>Quote number</b>	: VA24-EBAE100-013		
<b>No. of samples received</b>	: 1		
<b>No. of samples analysed</b>	: 1		

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Quality Control Report contains the following information:

- Laboratory Duplicate (DUP) Report; Relative Percent Difference (RPD) and Data Quality Objectives
- Method Blank (MB) Report; Recovery and Data Quality Objectives
- Laboratory Control Sample (LCS) Report; Recovery and Data Quality Objectives

### Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

<i>Signatories</i>	<i>Position</i>	<i>Laboratory Department</i>
David Tremblett	VOC Section Supervisor	Waterloo Air Quality, Waterloo, Ontario

Page : 2 of 5  
Work Order : FJ2403535  
Client : Tetra Tech Canada Inc.  
Project : 704-ENW.GENV03704-02, Task 001

---



## General Comments

The ALS Quality Control (QC) report is optionally provided to ALS clients upon request. ALS test methods include comprehensive QC checks with every analysis to ensure our high standards of quality are met. Each QC result has a known or expected target value, which is compared against predetermined Data Quality Objectives (DQOs) to provide confidence in the accuracy of associated test results. This report contains detailed results for all QC results applicable to this sample submission. Please refer to the ALS Quality Control Interpretation report (QCI) for applicable method references and methodology summaries.

### Key :

Anonymous = Refers to samples which are not part of this work order, but which formed part of the QC process lot.

CAS Number = Chemical Abstracts Service number is a unique identifier assigned to discrete substances.

DQO = Data Quality Objective.

LOR = Limit of Reporting (detection limit).

RPD = Relative Percent Difference

# = Indicates a QC result that did not meet the ALS DQO.

## Workorder Comments

---

Holding times are displayed as "---" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

---





### Laboratory Duplicate (DUP) Report

A Laboratory Duplicate (DUP) is a randomly selected intralaboratory replicate sample. Laboratory Duplicates provide information regarding method precision and sample heterogeneity. ALS DQOs for Laboratory Duplicates are expressed as test-specific limits for Relative Percent Difference (RPD), or as an absolute difference limit of 2 times the LOR for low concentration duplicates within ~ 4-10 times the LOR (cut-off is test-specific).

Sub-Matrix: Air

					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
<b>Sulfur Compounds (QC Lot: 1779200)</b>											
FJ2403535-001	Location 3	Carbon disulfide	75-15-0	E630	2.0	ppbv	<2.0	<2.0	0	Diff <2x LOR	----
		Carbonyl sulfide	463-58-1	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Diethyl disulfide	110-81-6	E630	2.0	ppbv	<2.0	<2.0	0	Diff <2x LOR	----
		Diethyl sulfide	352-93-2	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Dimethyl disulfide	624-92-0	E630	2.0	ppbv	<2.0	<2.0	0	Diff <2x LOR	----
		Dimethyl sulfide	75-18-3	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Dimethylthiophene, 2,5-	638-02-8	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Ethyl mercaptan	75-08-1	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Ethyl methyl sulfide	624-89-5	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Ethylthiophene, 2-	872-55-9	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Hydrogen sulfide	7783-06-4	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Isobutyl mercaptan	513-44-0	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Isopropyl mercaptan	75-33-2	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Methyl mercaptan	74-93-1	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Methylthiophene, 2-	554-14-3	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Methylthiophene, 3-	616-44-4	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		n-Butyl mercaptan	109-79-5	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Propyl mercaptan	107-03-9	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		sec-butyl mercaptan + thiophene	----	E630	6.0	ppbv	<6.0	<6.0	0	Diff <2x LOR	----
		t-Butyl mercaptan	75-66-1	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
		Tetrahydrothiophene	110-01-0	E630	4.0	ppbv	<4.0	<4.0	0	Diff <2x LOR	----
<b>Permanent Gases (QC Lot: 1784037)</b>											
FJ2403535-001	Location 3	Methane	74-82-8	E629B-H	0.050	%	<0.050	<0.050	0	Diff <2x LOR	----



## Method Blank (MB) Report

A Method Blank is an analyte-free matrix that undergoes sample processing identical to that carried out for test samples. Method Blank results are used to monitor and control for potential contamination from the laboratory environment and reagents. For most tests, the DQO for Method Blanks is for the result to be < LOR.

Sub-Matrix: Air

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
<b>Field Tests (QCLot: 1779225)</b>						
Pressure on receipt	---	EF001	0.1	Inches Hg	-30.0	---
<b>Sulfur Compounds (QCLot: 1779200)</b>						
Carbon disulfide	75-15-0	E630	2	ppbv	<2.0	---
Carbonyl sulfide	463-58-1	E630	4	ppbv	<4.0	---
Diethyl disulfide	110-81-6	E630	2	ppbv	<2.0	---
Diethyl sulfide	352-93-2	E630	4	ppbv	<4.0	---
Dimethyl disulfide	624-92-0	E630	2	ppbv	<2.0	---
Dimethyl sulfide	75-18-3	E630	4	ppbv	<4.0	---
Dimethylthiophene, 2,5-	638-02-8	E630	4	ppbv	<4.0	---
Ethyl mercaptan	75-08-1	E630	4	ppbv	<4.0	---
Ethyl methyl sulfide	624-89-5	E630	4	ppbv	<4.0	---
Ethylthiophene, 2-	872-55-9	E630	4	ppbv	<4.0	---
Hydrogen sulfide	7783-06-4	E630	4	ppbv	<4.0	---
Isobutyl mercaptan	513-44-0	E630	4	ppbv	<4.0	---
Isopropyl mercaptan	75-33-2	E630	4	ppbv	<4.0	---
Methyl mercaptan	74-93-1	E630	4	ppbv	<4.0	---
Methylthiophene, 2-	554-14-3	E630	4	ppbv	<4.0	---
Methylthiophene, 3-	616-44-4	E630	4	ppbv	<4.0	---
n-Butyl mercaptan	109-79-5	E630	4	ppbv	<4.0	---
Propyl mercaptan	107-03-9	E630	4	ppbv	<4.0	---
sec-butyl mercaptan + thiophene	---	E630	6	ppbv	<6.0	---
t-Butyl mercaptan	75-66-1	E630	4	ppbv	<4.0	---
Tetrahydrothiophene	110-01-0	E630	4	ppbv	<4.0	---
<b>Permanent Gases (QCLot: 1784037)</b>						
Methane	74-82-8	E629B-H	0.05	%	<0.050	---



## Laboratory Control Sample (LCS) Report

A Laboratory Control Sample (LCS) is an analyte-free matrix that has been fortified (spiked) with test analytes at known concentration and processed in an identical manner to test samples. LCS results are expressed as percent recovery, and are used to monitor and control test method accuracy and precision, independent of test sample matrix.

Sub-Matrix: Air

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
<b>Sulfur Compounds (QCLot: 1779200)</b>									
Carbonyl sulfide	463-58-1	E630	4	ppbv	104 ppbv	96.8	60.0	140	----
Hydrogen sulfide	7783-06-4	E630	4	ppbv	112 ppbv	118	60.0	140	----
Methyl mercaptan	74-93-1	E630	4	ppbv	101 ppbv	66.9	60.0	140	----
<b>Permanent Gases (QCLot: 1784037)</b>									
Methane	74-82-8	E629B-H	0.05	%	15 %	103	70.0	130	----

FJAE Shipping & Receiving

Call Out Expedite

Priority

# of Coolers Air

# of Carboys Ground

Environmental Division  
Fort St. John  
Work Order Reference  
FJ2403535



Telephone : +1 250 261 5517

Page \_\_\_ of \_\_\_

60 NORTHLAND ROAD,  
WATERLOO, ON N2V 2B8

Phone: (519) 886-6910  
Fax: (519) 886-9047  
Toll Free: 1-800-668-9878



AIR QUALITY CHAIN OF CUSTODY FORM - Canister/Tube Sampling

Note: All TAT Quoted is in business days which exclude statutory holidays and weekends. TAT of samples received past 3:00 pm or Saturday / Sunday begin the next day.

DATE REQUIRED	SERVICE REQUESTED		Rush 3 day (100%)	<input type="checkbox"/>
	10 day (regular)	<input type="checkbox"/>	Rush 2 day (200%)	<input type="checkbox"/>
	Rush 5 day (50%)	<input type="checkbox"/>	Rush 1 day (300%) - Enquire	<input type="checkbox"/>

COMPANY NAME: Tetra Tech Canada Inc.

OFFICE:

PROJECT MANAGER:

PROJECT #: VA24-EBAE100-013

PHONE: FAX:

ACCOUNT #:

QUOTATION #: PO #:

SAMPLING INFORMATION

Date (dd-mmm-yy)	Time (24hr) (hh:mm)	Canister or Tube ID# (e.g. 060000-XXXX or G0XXXXXXSVI)	Regulator Serial # (CS1200-XXXX or GXX)	Matrix Type
20-11-2024	11:10am	01400-0216	G289	

REGULATION:

CRITERIA:

OTHER INFORMATION:

REPORT FORMAT/DISTRIBUTION

EMAIL: FAX: BOTH:

SELECT: PDF DIGITAL BOTH

EMAIL 1:

EMAIL 2:

SAMPLE DESCRIPTION TO APPEAR ON REPORT

TUBE AIR VOLUME - L or m<sup>3</sup>

STARTING PRESSURE - Pre-Sampling ("Hg)

ENDING PRESSURE - Post Sampling ("Hg)

COLLECTION TIME (HRS)

All rush work requires lab approval before sample submission

SUBMISSION #:

ENTERED BY:

DATE/TIME ENTERED:

BIN #:

Field Conditions (Rain/Wind/Dust/Odour)

Field PID Reading

LAB ID

SPECIAL INSTRUCTIONS/COMMENTS: This Chain of Custody Form is only to be used for Air Quality Samples

SAMPLE CONDITION AS RECEIVED

Matrix Type	Soil Gas Vapour = SG	Indoor Air = IA	FROZEN	MEAN TEMP
	Ambient Air = AA	Industrial Hygiene = IH	COLD	
			COOLING INITIATED	

AMBIENT

OBSERVATIONS: Yes  No  If yes add SIF

INIT

SAMPLED BY: LEROY WOLFORD

RELINQUISHED BY:

DATE & TIME: 20-11-2024

RECEIVED BY:

DATE & TIME:

RECEIVED AT LAB BY:

DATE & TIME:

Notes

- Quote number must be provided to ensure proper pricing
- TAT may vary dependent on complexity of analysis and lab workload at time of submission. Please contact the lab to confirm TATs.
- Any known or suspected hazards relating to a sample must be noted on the chain of custody in comments section.

REV6-2015

ALS FSJ - [REDACTED] Nov 20/24 - 12:45pm

# AIR SAMPLING MEDIA REQUEST FORM



COMPLETE Blue sections. Gray sections are for INTERNAL USE ONLY

Form MUST be reviewed & initiated by an ALS Account Manager prior to submission to NAWTR AIRMEDIA REQUEST (nawtr.airmediarequest@alsglobal.com)

SHIPPING INFO:  pls ship PUROLATOR Express Friday 9SEPT for delivery 9 SEPT latest for client plus

CLIENT: TetraTech  
 CLIENT CONTACT: Andrea McMillan  
 CLIENT PROJECT/PO: Gas and GW sampling  
 QUOTE #: (mandatory) VA24-EBAE100-013  
 DELIVERY TO: ALS Fort St John BC, 11007 Alaska Road, Fort St John, BC, V1J 6P3 for client P/U  
 TELEPHONE NUMBER: 687-830-1121  
 SHIP TO (include email): andrea.mcmillan@tetratech.com

ORDER TAKEN BY: Brent Meck  
 ORDER DATE: 5-Sep-24  
 AM REVIEWER: DSTASTNY  
 CLIENT EXPECT DATE: 9-Sep-24  
 ORDER FILLED BY: AR21  
 PEER REVIEWER: YB  
 DATE COMPLETED: 5-Sep-24

Shipping Method: (Select one)  
 Regular (ALS will cover shipping cost)  
 RUSH (Client will be billed for shipping costs, please confirm with Account Manager)  
 External Courier  
 Pickup at ALS  
 Location:   
 ALS Drivers

Shipping Company:  
 FedEx  
 Purolator  
 DHL  
 UPS  
 Other  
 N/A

Tracking Number:

Completion of all Sections is Mandatory

1. What type of air is being sampled? **Check all appropriate types in the Additional Information Box below**
  2. Please provide a list of compounds and reporting limits that are required. **Include regulation & target list (attach to email)**
  3. What is your planned canister sampling time? **Options listed under Regulator Times**
  4. Trip blanks will be shipped pre-filled unless specifically requested below.
- Note: If analysis required is DIFFERENT than what is LISTED on this form, email nawtr.airmediarequest@alsglobal.com ASAP to confirm the media was adequately proofed.**

Canister Size/Tube	Regulator Times	Regulator Quantity	Parameters/ Product Codes	Canister/Tube Identification #	Initial Pressure/Flow (mmHg/mL per min)	Controller Identification #
6L Canister	24 hr		Methane, S628M, Full Sulfur Scan S630	01400-0216	-28.7	G289
	12 hr					
	8 hr					
	4 hr					
	1 hr					
	0.5 hr					
Number of Canisters	Trip Blank					
1.4L Canister	60 mins		Methane, S628M, Full Sulfur Scan S630	01400-0320	-28.7	G33
	20 mins					
	10 mins	2				
	4 mins					
	No Restrictor					
Number of Canisters	2					
Bottle Vacs	40 mins					
	14 mins					
	7 mins					
	3 mins					
	No Restrictor					
Number of Canisters	Trip Blank					
Passive CarboPak X Tubes						
Diffusive Caps						
Active SVI Tubes						
Calibration Tube for SVI (yes/no)						

Other Sampling Supplies	Quantity	ID #	Additional Information & Special Instructions or Requests			
Pressure Gauge	1	PG59	Check all that apply:	<input type="checkbox"/> Indoor Air	<input type="checkbox"/> Sub-Slab	<input type="checkbox"/> Industrial
Caplok Tool			<input checked="" type="checkbox"/> Ambient Air	<input type="checkbox"/> Landfill	<input type="checkbox"/> Commercial	
Canister Stands			<input type="checkbox"/> Probe/Well	<input type="checkbox"/> Crawlspace	<input type="checkbox"/> Residential	
Valve Adaptor for Soil Vapour			<input type="checkbox"/> Other (specify):			

Chargeable Supplies	Quantity	COMMENTS:
Duplicate Sampler - \$45 canister		Methane :\$100, Sulfurs \$242, Canister 2WEEK rental \$105
Valve Adaptor for Soil Vapour \$5		
Teflon Tubing - \$3 per foot	-Total length (ft) -Length per section (ft)	
Nut & Ferrule Sets - \$8 per set		
Tedlar Bags (contact the lab before SUBMITTING)	-\$28 unpurged -\$45 purged	
Siloxane Kit - \$100 each (Kit: \$50, TD tube prep/rental: \$50)		
Rush Order Prep Charge (<48 hour notice, not including shipping)	\$50	
Include sampling supplies from other ALS location (yes/no)		
SEE COMMENTS		

RENTAL COSTS: Canister Rental is 2 WEEKS only. After this time additional rental fees apply.  
 MEDIA REPLACEMENT COSTS: (Media lost or damaged will be charged to the client)  
 1) TD SORBENT TUBE & CAPS - \$190.00 2) TD DIFFUSION CAP - \$30.00 3) CAPLOK TOOL SET - \$95.00 4) VACUUM GAUGE - \$240.00 5) BOTTLEVAC CANISTER - \$135.00  
 6) PROTECTIVE CAP - \$35.00 7) CANISTER - 6L: \$650.00; 1.4L: \$450.00 8) CONTROLLER - TWA: \$1000.00 GRAB: \$650.00 9) CANISTER STAND - \$75.00 10) DUPLICATE SAMPLER - \$550.00



**CERTIFICATE OF ANALYSIS**

<b>Work Order</b>	: <b>FJ2403536</b>		
<b>Client</b>	: <b>Tetra Tech Canada Inc.</b>	<b>Laboratory</b>	: ALS Environmental - Vancouver
<b>Contact</b>	: Andrea McMillan	<b>Account Manager</b>	: Brent Mack
<b>Address</b>	: 110, 140 Quarry Park Blvd SE Calgary Alberta Canada T2C 3G3	<b>Address</b>	: 8081 Lougheed Highway Burnaby BC Canada V5A 1W9
<b>Telephone</b>	: ----	<b>Telephone</b>	: 778-370-3279
<b>Project</b>	: 704-ENW.GENV03704-02, Task 001	<b>Date Samples Received</b>	: 20-Nov-2024 12:45
<b>PO</b>	: ----	<b>Date Analysis Commenced</b>	: 21-Nov-2024
<b>C-O-C number</b>	: 20-964972	<b>Issue Date</b>	: 22-Nov-2024 16:46
<b>Sampler</b>	: Leroy Wolford		
<b>Site</b>	: ----		
<b>Quote number</b>	: VA24-EBAE100-013		
<b>No. of samples received</b>	: 1		
<b>No. of samples analysed</b>	: 1		

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Certificate of Analysis contains the following information:

- General Comments
- Analytical Results

Additional information pertinent to this report will be found in the following separate attachments: Quality Control Report, QC Interpretive report to assist with Quality Review and Sample Receipt Notification (SRN).

**Signatories**

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

<i>Signatories</i>	<i>Position</i>	<i>Laboratory Department</i>
Erika Vanegas	Lab Assistant	Metals, Burnaby, British Columbia
Kate Dimitrova	Supervisor - Inorganic	Inorganics, Burnaby, British Columbia
Kim Jensen	Department Manager - Metals	Metals, Burnaby, British Columbia
Monica Ko	Lab Assistant	Inorganics, Burnaby, British Columbia
Owen Cheng		Metals, Burnaby, British Columbia
Tracy Harley	Supervisor - Water Quality Instrumentation	Inorganics, Burnaby, British Columbia



## General Comments

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Refer to the ALS Quality Control Interpretive report (QCI) for applicable references and methodology summaries. Reference methods may incorporate modifications to improve performance.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis.

Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

Please refer to Quality Control Interpretive report (QCI) for information regarding Holding Time compliance.

Key: CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances.  
 LOR: Limit of Reporting (detection limit).

Unit	Description
mg/L	milligrams per litre
pH units	pH units
µS/cm	microsiemens per centimetre
NTU	nephelometric turbidity units
CU	colour units (1 cu = 1 mg/l pt)
AU/cm	absorbance units per centimetre
% T/cm	% transmittance per centimetre
-	no units

<: less than.

>: greater than.

Surrogate: An analyte that is similar in behavior to target analyte(s), but that does not occur naturally in environmental samples. For applicable tests, surrogates are added to samples prior to analysis as a check on recovery.

Test results reported relate only to the samples as received by the laboratory.

UNLESS OTHERWISE STATED on SRN or QCI Report, ALL SAMPLES WERE RECEIVED IN ACCEPTABLE CONDITION.

## Sample Comments

Sample	Client Id	Comment
FJ2403536-001	Location 3	Water sample for total mercury analysis was not submitted in glass or PTFE container with HCl preservative. Results may be biased low.



## Qualifiers

<u>Qualifier</u>	<u>Description</u>
DLA	Detection Limit adjusted for required dilution.
DLDS	Detection Limit Raised: Dilution required due to high Dissolved Solids / Electrical Conductivity.





## Analytical Results

Sub-Matrix: Water (Matrix: Water)					Client sample ID	Location 3	---	---	---	---
					Client sampling date / time	20-Nov-2024 11:30	---	---	---	---
Analyte	CAS Number	Method/Lab	LOR	Unit	FJ2403536-001	---	---	---	---	
					Result	---	---	---	---	
<b>Physical Tests</b>										
Absorbance, UV (@ 254nm)	---	E404/VA	0.0050	AU/cm	0.0830	---	---	---	---	
Alkalinity, bicarbonate (as CaCO3)	---	E290/VA	1.0	mg/L	933	---	---	---	---	
Alkalinity, carbonate (as CaCO3)	---	E290/VA	1.0	mg/L	13.3	---	---	---	---	
Alkalinity, hydroxide (as CaCO3)	---	E290/VA	1.0	mg/L	<1.0	---	---	---	---	
Alkalinity, phenolphthalein (as CaCO3)	---	E290/VA	1.0	mg/L	6.7	---	---	---	---	
Alkalinity, total (as CaCO3)	---	E290/VA	1.0	mg/L	946	---	---	---	---	
Colour, true	---	E329/VA	5.0	CU	<5.0	---	---	---	---	
Conductivity	---	E100/VA	2.0	µS/cm	1890	---	---	---	---	
Hardness (as CaCO3), dissolved	---	EC100/VA	0.60	mg/L	238	---	---	---	---	
Hardness (as CaCO3), from total Ca/Mg	---	EC100A/VA	0.60	mg/L	251	---	---	---	---	
pH	---	E108/VA	0.10	pH units	8.34	---	---	---	---	
Solids, total dissolved [TDS]	---	E162/VA	10	mg/L	1230	---	---	---	---	
Turbidity	---	E121/VA	0.10	NTU	26.0	---	---	---	---	
Transmittance, UV (@ 254nm)	---	E404/VA	1.0	% T/cm	82.6	---	---	---	---	
<b>Anions and Nutrients</b>										
Bromide	24959-67-9	E235.Br-L/VA	0.050	mg/L	<0.500 <sup>DLDS</sup>	---	---	---	---	
Chloride	16887-00-6	E235.Cl/VA	0.50	mg/L	38.6	---	---	---	---	
Fluoride	16984-48-8	E235.F/VA	0.020	mg/L	0.629	---	---	---	---	
Nitrate (as N)	14797-55-8	E235.NO3-L/VA	0.0050	mg/L	<0.0500 <sup>DLDS</sup>	---	---	---	---	
Nitrite (as N)	14797-65-0	E235.NO2-L/VA	0.0010	mg/L	<0.0100 <sup>DLDS</sup>	---	---	---	---	
Sulfate (as SO4)	14808-79-8	E235.SO4/VA	0.30	mg/L	120	---	---	---	---	



## Analytical Results

Sub-Matrix: Water  
 (Matrix: Water)

					Client sample ID	Location 3	----	----	----	----
					Client sampling date / time	20-Nov-2024 11:30	----	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	FJ2403536-001	----	----	----	----	
						Result	----	----	----	----
<b>Cyanides</b>										
Cyanide, strong acid dissociable (Total)	----	E333/VA	0.0050	mg/L	<0.0050	----	----	----	----	
<b>Organic / Inorganic Carbon</b>										
Carbon, dissolved organic [DOC]	----	E358-L/VA	0.50	mg/L	4.00	----	----	----	----	
Carbon, total organic [TOC]	----	E355-L/VA	0.50	mg/L	3.74	----	----	----	----	
<b>Total Sulfides</b>										
Sulfide, total (as H2S)	7783-06-4	E395-H/VA	0.011	mg/L	<0.011	----	----	----	----	
Sulfide, total (as S)	18496-25-8	E395-H/VA	0.010	mg/L	<0.010	----	----	----	----	
<b>Total Metals</b>										
Aluminum, total	7429-90-5	E420/VA	0.0030	mg/L	0.165	----	----	----	----	
Antimony, total	7440-36-0	E420/VA	0.00010	mg/L	0.00696	----	----	----	----	
Arsenic, total	7440-38-2	E420/VA	0.00010	mg/L	0.0214	----	----	----	----	
Barium, total	7440-39-3	E420/VA	0.00010	mg/L	0.467	----	----	----	----	
Beryllium, total	7440-41-7	E420/VA	0.000100	mg/L	<0.000100	----	----	----	----	
Bismuth, total	7440-69-9	E420/VA	0.000050	mg/L	<0.000100 <sup>DLA</sup>	----	----	----	----	
Boron, total	7440-42-8	E420/VA	0.010	mg/L	0.352	----	----	----	----	
Cadmium, total	7440-43-9	E420/VA	0.0000050	mg/L	0.000116	----	----	----	----	
Calcium, total	7440-70-2	E420/VA	0.050	mg/L	41.0	----	----	----	----	
Cesium, total	7440-46-2	E420/VA	0.000010	mg/L	0.000125	----	----	----	----	
Chromium, total	7440-47-3	E420/VA	0.00050	mg/L	<0.00100 <sup>DLA</sup>	----	----	----	----	
Cobalt, total	7440-48-4	E420/VA	0.00010	mg/L	0.00190	----	----	----	----	
Copper, total	7440-50-8	E420/VA	0.00050	mg/L	0.00264	----	----	----	----	



### Analytical Results

Sub-Matrix: Water  
 (Matrix: Water)

					Client sample ID	Location 3	----	----	----	----
					Client sampling date / time	20-Nov-2024 11:30	----	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	FJ2403536-001	----	----	----	----	----
						Result	----	----	----	----
<b>Total Metals</b>										
Iron, total	7439-89-6	E420/VA	0.010	mg/L	3.17	----	----	----	----	----
Lead, total	7439-92-1	E420/VA	0.000050	mg/L	0.000556	----	----	----	----	----
Lithium, total	7439-93-2	E420/VA	0.0010	mg/L	0.0154	----	----	----	----	----
Magnesium, total	7439-95-4	E420/VA	0.0050	mg/L	36.2	----	----	----	----	----
Manganese, total	7439-96-5	E420/VA	0.00010	mg/L	0.115	----	----	----	----	----
Mercury, total	7439-97-6	E508/VA	0.0000050	mg/L	<0.0000050	----	----	----	----	----
Molybdenum, total	7439-98-7	E420/VA	0.000050	mg/L	0.0335	----	----	----	----	----
Nickel, total	7440-02-0	E420/VA	0.00050	mg/L	0.0119	----	----	----	----	----
Phosphorus, total	7723-14-0	E420/VA	0.050	mg/L	<0.100 <sup>DLA</sup>	----	----	----	----	----
Potassium, total	7440-09-7	E420/VA	0.050	mg/L	3.39	----	----	----	----	----
Rubidium, total	7440-17-7	E420/VA	0.00020	mg/L	0.00270	----	----	----	----	----
Selenium, total	7782-49-2	E420/VA	0.000050	mg/L	0.00315	----	----	----	----	----
Silicon, total	7440-21-3	E420/VA	0.10	mg/L	4.68	----	----	----	----	----
Silver, total	7440-22-4	E420/VA	0.000010	mg/L	<0.000020 <sup>DLA</sup>	----	----	----	----	----
Sodium, total	7440-23-5	E420/VA	0.050	mg/L	395	----	----	----	----	----
Strontium, total	7440-24-6	E420/VA	0.00020	mg/L	0.665	----	----	----	----	----
Sulfur, total	7704-34-9	E420/VA	0.50	mg/L	48.8	----	----	----	----	----
Tellurium, total	13494-80-9	E420/VA	0.00020	mg/L	<0.00040 <sup>DLA</sup>	----	----	----	----	----
Thallium, total	7440-28-0	E420/VA	0.000010	mg/L	0.000028	----	----	----	----	----
Thorium, total	7440-29-1	E420/VA	0.00010	mg/L	<0.00020 <sup>DLA</sup>	----	----	----	----	----
Tin, total	7440-31-5	E420/VA	0.00010	mg/L	<0.00020 <sup>DLA</sup>	----	----	----	----	----



## Analytical Results

Sub-Matrix: Water  
 (Matrix: Water)

					Client sample ID	Location 3	----	----	----	----
					Client sampling date / time	20-Nov-2024 11:30	----	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	FJ2403536-001	----	----	----	----	----
						Result	----	----	----	----
<b>Total Metals</b>										
Titanium, total	7440-32-6	E420/VA	0.00030	mg/L	0.00554	----	----	----	----	----
Tungsten, total	7440-33-7	E420/VA	0.00010	mg/L	0.00033	----	----	----	----	----
Uranium, total	7440-61-1	E420/VA	0.000010	mg/L	0.00695	----	----	----	----	----
Vanadium, total	7440-62-2	E420/VA	0.00050	mg/L	0.00127	----	----	----	----	----
Zinc, total	7440-66-6	E420/VA	0.0030	mg/L	0.0092	----	----	----	----	----
Zirconium, total	7440-67-7	E420/VA	0.00020	mg/L	0.00064	----	----	----	----	----
<b>Dissolved Metals</b>										
Aluminum, dissolved	7429-90-5	E421/VA	0.0010	mg/L	0.0027	----	----	----	----	----
Antimony, dissolved	7440-36-0	E421/VA	0.00010	mg/L	0.00671	----	----	----	----	----
Arsenic, dissolved	7440-38-2	E421/VA	0.00010	mg/L	0.00623	----	----	----	----	----
Barium, dissolved	7440-39-3	E421/VA	0.00010	mg/L	0.418	----	----	----	----	----
Beryllium, dissolved	7440-41-7	E421/VA	0.000100	mg/L	<0.000100	----	----	----	----	----
Bismuth, dissolved	7440-69-9	E421/VA	0.000050	mg/L	<0.000100 <sup>DLA</sup>	----	----	----	----	----
Boron, dissolved	7440-42-8	E421/VA	0.010	mg/L	0.329	----	----	----	----	----
Cadmium, dissolved	7440-43-9	E421/VA	0.0000050	mg/L	0.0000734	----	----	----	----	----
Calcium, dissolved	7440-70-2	E421/VA	0.050	mg/L	38.9	----	----	----	----	----
Cesium, dissolved	7440-46-2	E421/VA	0.000010	mg/L	0.000078	----	----	----	----	----
Chromium, dissolved	7440-47-3	E421/VA	0.00050	mg/L	<0.00100 <sup>DLA</sup>	----	----	----	----	----
Cobalt, dissolved	7440-48-4	E421/VA	0.00010	mg/L	0.00174	----	----	----	----	----
Copper, dissolved	7440-50-8	E421/VA	0.00020	mg/L	0.00055	----	----	----	----	----
Iron, dissolved	7439-89-6	E421/VA	0.010	mg/L	0.787	----	----	----	----	----



### Analytical Results

Sub-Matrix: Water  
 (Matrix: Water)

					Client sample ID	Location 3	----	----	----	----
					Client sampling date / time	20-Nov-2024 11:30	----	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	FJ2403536-001	----	----	----	----	----
						Result	----	----	----	----
<b>Dissolved Metals</b>										
Lead, dissolved	7439-92-1	E421/VA	0.000050	mg/L	<0.000100 <sup>DLA</sup>	----	----	----	----	----
Lithium, dissolved	7439-93-2	E421/VA	0.0010	mg/L	0.0141	----	----	----	----	----
Magnesium, dissolved	7439-95-4	E421/VA	0.0050	mg/L	34.2	----	----	----	----	----
Manganese, dissolved	7439-96-5	E421/VA	0.00010	mg/L	0.112	----	----	----	----	----
Mercury, dissolved	7439-97-6	E509/VA	0.0000050	mg/L	<0.0000050	----	----	----	----	----
Molybdenum, dissolved	7439-98-7	E421/VA	0.000050	mg/L	0.0304	----	----	----	----	----
Nickel, dissolved	7440-02-0	E421/VA	0.00050	mg/L	0.0111	----	----	----	----	----
Phosphorus, dissolved	7723-14-0	E421/VA	0.050	mg/L	<0.100 <sup>DLA</sup>	----	----	----	----	----
Potassium, dissolved	7440-09-7	E421/VA	0.050	mg/L	3.39	----	----	----	----	----
Rubidium, dissolved	7440-17-7	E421/VA	0.00020	mg/L	0.00238	----	----	----	----	----
Selenium, dissolved	7782-49-2	E421/VA	0.000050	mg/L	0.00301	----	----	----	----	----
Silicon, dissolved	7440-21-3	E421/VA	0.050	mg/L	4.07	----	----	----	----	----
Silver, dissolved	7440-22-4	E421/VA	0.000010	mg/L	<0.000020 <sup>DLA</sup>	----	----	----	----	----
Sodium, dissolved	7440-23-5	E421/VA	0.050	mg/L	401	----	----	----	----	----
Strontium, dissolved	7440-24-6	E421/VA	0.00020	mg/L	0.598	----	----	----	----	----
Sulfur, dissolved	7704-34-9	E421/VA	0.50	mg/L	42.8	----	----	----	----	----
Tellurium, dissolved	13494-80-9	E421/VA	0.00020	mg/L	<0.00040 <sup>DLA</sup>	----	----	----	----	----
Thallium, dissolved	7440-28-0	E421/VA	0.000010	mg/L	0.000023	----	----	----	----	----
Thorium, dissolved	7440-29-1	E421/VA	0.00010	mg/L	<0.00020 <sup>DLA</sup>	----	----	----	----	----
Tin, dissolved	7440-31-5	E421/VA	0.00010	mg/L	<0.00020 <sup>DLA</sup>	----	----	----	----	----
Titanium, dissolved	7440-32-6	E421/VA	0.00030	mg/L	<0.00060 <sup>DLA</sup>	----	----	----	----	----



**Analytical Results**

**Sub-Matrix: Water**  
**(Matrix: Water)**

					Client sample ID	Location 3	----	----	----	----
					Client sampling date / time	20-Nov-2024 11:30	----	----	----	----
Analyte	CAS Number	Method/Lab	LOR	Unit	FJ2403536-001	----	----	----	----	----
						Result	----	----	----	----
<b>Dissolved Metals</b>										
<b>Tungsten, dissolved</b>	7440-33-7	E421/VA	0.00010	mg/L	0.00030	----	----	----	----	----
<b>Uranium, dissolved</b>	7440-61-1	E421/VA	0.000010	mg/L	0.00624	----	----	----	----	----
<b>Vanadium, dissolved</b>	7440-62-2	E421/VA	0.00050	mg/L	<0.00100 <sup>DLA</sup>	----	----	----	----	----
<b>Zinc, dissolved</b>	7440-66-6	E421/VA	0.0010	mg/L	0.0043	----	----	----	----	----
<b>Zirconium, dissolved</b>	7440-67-7	E421/VA	0.00020	mg/L	0.00041	----	----	----	----	----
<b>Dissolved mercury filtration location</b>	----	EP509/VA	-	-	Field	----	----	----	----	----
<b>Dissolved metals filtration location</b>	----	EP421/VA	-	-	Field	----	----	----	----	----

Please refer to the General Comments section for an explanation of any result qualifiers detected.

---

## QUALITY CONTROL INTERPRETIVE REPORT

---

<p><b>Work Order</b> : <b>FJ2403536</b></p> <p><b>Client</b> : <b>Tetra Tech Canada Inc.</b></p> <p><b>Contact</b> : Andrea McMillan</p> <p><b>Address</b> : 110, 140 Quarry Park Blvd SE Calgary AB Canada T2C 3G3</p> <p><b>Telephone</b> : ----</p> <p><b>Project</b> : 704-ENW.GENV03704-02, Task 001</p> <p><b>PO</b> : ----</p> <p><b>C-O-C number</b> : 20-964972</p> <p><b>Sampler</b> : Leroy Wolford</p> <p><b>Site</b> : ----</p> <p><b>Quote number</b> : VA24-EBAE100-013</p> <p><b>No. of samples received</b> : 1</p> <p><b>No. of samples analysed</b> : 1</p>	<p><b>Page</b> : 1 of 11</p> <p><b>Laboratory</b> : ALS Environmental - Fort St. John</p> <p><b>Account Manager</b> : Brent Mack</p> <p><b>Address</b> : 11007 Alaska Road Fort St. John, British Columbia Canada V1J 6P3</p> <p><b>Telephone</b> : 778-370-3279</p> <p><b>Date Samples Received</b> : 20-Nov-2024 12:45</p> <p><b>Issue Date</b> : 22-Nov-2024 16:46</p>
--	---

---

This report is automatically generated by the ALS LIMS (Laboratory Information Management System) through evaluation of Quality Control (QC) results and other QA parameters associated with this submission, and is intended to facilitate rapid data validation by auditors or reviewers. The report highlights any exceptions and outliers to ALS Data Quality Objectives, provides holding time details and exceptions, summarizes QC sample frequencies, and lists applicable methodology references and summaries.

**Key**

- Anonymous: Refers to samples which are not part of this work order, but which formed part of the QC process lot.
- CAS Number: Chemical Abstracts Service number is a unique identifier assigned to discrete substances.
- DQO: Data Quality Objective.
- LOR: Limit of Reporting (detection limit).
- RPD: Relative Percent Difference.

---

### ***Workorder Comments***

Holding times are displayed as "----" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

---

### ***Summary of Outliers***

#### ***Outliers : Quality Control Samples***

- No Method Blank value outliers occur.
- No Duplicate outliers occur.
- No Laboratory Control Sample (LCS) outliers occur
- No Matrix Spike outliers occur.
- No Test sample Surrogate recovery outliers exist.

#### ***Outliers: Reference Material (RM) Samples***

- No Reference Material (RM) Sample outliers occur.

***Outliers : Analysis Holding Time Compliance (Breaches)***

- Analysis Holding Time Outliers exist - please see following pages for full details.

***Outliers : Frequency of Quality Control Samples***

- Quality Control Sample Frequency Outliers occur - please see following pages for full details.





## Analysis Holding Time Compliance

This report summarizes extraction / preparation and analysis times and compares each with ALS recommended holding times, which are selected to meet known provincial and /or federal requirements. In the absence of regulatory hold times, ALS establishes recommendations based on guidelines published by organizations such as CCME, US EPA, APHA Standard Methods, ASTM, or Environment Canada (where available). Dates and holding times reported below represent the first dates of extraction or analysis. If subsequent tests or dilutions exceeded holding times, qualifiers are added (refer to COA).

If samples are identified below as having been analyzed or extracted outside of recommended holding times, measurement uncertainties may be increased, and this should be taken into consideration when interpreting results.

Where actual sampling date is not provided on the chain of custody, the date of receipt with time at 00:00 is used for calculation purposes.

Where only the sample date without time is provided on the chain of custody, the sampling date at 00:00 is used for calculation purposes.

Matrix: **Water** Evaluation: ✖ = Holding time exceedance ; ✔ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis				
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval	
				Rec	Actual			Rec	Actual		
<b>Anions and Nutrients : Bromide in Water by IC (Low Level)</b>											
HDPE Location 3	E235.Br-L	20-Nov-2024	22-Nov-2024	28 days	2 days	✔	22-Nov-2024	28 days	2 days	✔	
<b>Anions and Nutrients : Chloride in Water by IC</b>											
HDPE Location 3	E235.Cl	20-Nov-2024	22-Nov-2024	28 days	2 days	✔	22-Nov-2024	28 days	2 days	✔	
<b>Anions and Nutrients : Fluoride in Water by IC</b>											
HDPE Location 3	E235.F	20-Nov-2024	22-Nov-2024	28 days	2 days	✔	22-Nov-2024	28 days	2 days	✔	
<b>Anions and Nutrients : Nitrate in Water by IC (Low Level)</b>											
HDPE Location 3	E235.NO3-L	20-Nov-2024	22-Nov-2024	3 days	2 days	✔	22-Nov-2024	3 days	2 days	✔	
<b>Anions and Nutrients : Nitrite in Water by IC (Low Level)</b>											
HDPE Location 3	E235.NO2-L	20-Nov-2024	22-Nov-2024	3 days	2 days	✔	22-Nov-2024	3 days	2 days	✔	
<b>Anions and Nutrients : Sulfate in Water by IC</b>											
HDPE Location 3	E235.SO4	20-Nov-2024	22-Nov-2024	28 days	2 days	✔	22-Nov-2024	28 days	2 days	✔	
<b>Cyanides : Total Cyanide</b>											
UV-inhibited HDPE - total (sodium hydroxide) Location 3	E333	20-Nov-2024	22-Nov-2024	14 days	2 days	✔	22-Nov-2024	14 days	2 days	✔	



Matrix: **Water** Evaluation: \* = Holding time exceedance ; ✓ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis			
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval
				Rec	Actual			Rec	Actual	
<b>Dissolved Metals : Dissolved Mercury in Water by CVAAS</b>										
<b>Glass vial dissolved (hydrochloric acid)</b> Location 3	E509	20-Nov-2024	22-Nov-2024	28 days	2 days	✓	22-Nov-2024	28 days	2 days	✓
<b>Dissolved Metals : Dissolved Metals in Water by CRC ICPMS</b>										
<b>HDPE dissolved (nitric acid)</b> Location 3	E421	20-Nov-2024	22-Nov-2024	180 days	2 days	✓	22-Nov-2024	180 days	2 days	✓
<b>Organic / Inorganic Carbon : Dissolved Organic Carbon by Combustion (Low Level)</b>										
<b>Amber glass dissolved (sulfuric acid)</b> Location 3	E358-L	20-Nov-2024	21-Nov-2024	28 days	1 days	✓	21-Nov-2024	28 days	1 days	✓
<b>Organic / Inorganic Carbon : Total Organic Carbon (Non-Purgeable) by Combustion (Low Level)</b>										
<b>Amber glass total (lab preserved)</b> Location 3	E355-L	20-Nov-2024	21-Nov-2024	3 days	1 days	✓	21-Nov-2024	28 days	0 days	✓
<b>Physical Tests : Alkalinity Species by Titration</b>										
<b>HDPE</b> Location 3	E290	20-Nov-2024	22-Nov-2024	14 days	2 days	✓	22-Nov-2024	14 days	2 days	✓
<b>Physical Tests : Colour (True) by Spectrometer (5 CU)</b>										
<b>HDPE</b> Location 3	E329	20-Nov-2024	22-Nov-2024	3 days	2 days	✓	22-Nov-2024	3 days	2 days	✓
<b>Physical Tests : Conductivity in Water</b>										
<b>HDPE</b> Location 3	E100	20-Nov-2024	22-Nov-2024	28 days	2 days	✓	22-Nov-2024	28 days	2 days	✓
<b>Physical Tests : pH by Meter</b>										
<b>HDPE</b> Location 3	E108	20-Nov-2024	22-Nov-2024	0.25 hrs	38 hrs	* EHTR-FM	22-Nov-2024	0.25 hrs	43 hrs	* EHTR-FM
<b>Physical Tests : TDS by Gravimetry</b>										
<b>HDPE</b> Location 3	E162	20-Nov-2024	----	----	----		21-Nov-2024	7 days	1 days	✓



Matrix: **Water** Evaluation: \* = Holding time exceedance ; ✓ = Within Holding Time

Analyte Group : Analytical Method Container / Client Sample ID(s)	Method	Sampling Date	Extraction / Preparation				Analysis			
			Preparation Date	Holding Times		Eval	Analysis Date	Holding Times		Eval
				Rec	Actual			Rec	Actual	
<b>Physical Tests : Turbidity by Nephelometry</b>										
HDPE Location 3	E121	20-Nov-2024	----	----	----		22-Nov-2024	3 days	2 days	✓
<b>Physical Tests : UV Absorbance and Transmittance by Spectrometry</b>										
HDPE Location 3	E404	20-Nov-2024	----	----	----		22-Nov-2024	3 days	2 days	✓
<b>Total Metals : Total Mercury in Water by CVAAS</b>										
HDPE - total (lab preserved) Location 3	E508	20-Nov-2024	22-Nov-2024	0 hrs	38 hrs	* UCP	22-Nov-2024	0 hrs	38 hrs	* UCP
<b>Total Metals : Total Metals in Water by CRC ICPMS</b>										
HDPE - total (lab preserved) Location 3	E420	20-Nov-2024	22-Nov-2024	180 days	2 days	✓	22-Nov-2024	180 days	2 days	✓
<b>Total Sulfides : Total Sulfide by Colourimetry (Automated Flow)</b>										
HDPE total (zinc acetate+sodium hydroxide) Location 3	E395-H	20-Nov-2024	----	----	----		21-Nov-2024	7 days	1 days	✓

**Legend & Qualifier Definitions**

EHTR-FM: Exceeded ALS recommended hold time prior to sample receipt. Field Measurement recommended

Rec. HT: ALS recommended hold time (see units).

UCP: Unsuitable Container and/or Preservative used (invalidates standard hold time). Maximum hold time of zero applied. Test results may be biased low / unreliable, and may not meet regulatory requirements.



## Quality Control Parameter Frequency Compliance

The following report summarizes the frequency of laboratory QC samples analyzed within the analytical batches (QC lots) in which the submitted samples were processed. The actual frequency should be greater than or equal to the expected frequency.

Matrix: **Water** Evaluation: ✖ = QC frequency outside specification; ✔ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		
			QC	Regular	Actual	Expected	Evaluation
<b>Analytical Methods</b>							
<b>Laboratory Duplicates (DUP)</b>							
Alkalinity Species by Titration	E290	1778435	1	8	12.5	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1778439	1	8	12.5	5.0	✔
Chloride in Water by IC	E235.Cl	1778438	1	9	11.1	5.0	✔
Colour (True) by Spectrometer (5 CU)	E329	1778443	1	1	100.0	5.0	✔
Conductivity in Water	E100	1778436	1	5	20.0	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1778479	1	20	5.0	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1778107	1	2	50.0	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1777537	1	1	100.0	5.0	✔
Fluoride in Water by IC	E235.F	1778437	1	9	11.1	5.0	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1778440	1	8	12.5	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1778441	1	8	12.5	5.0	✔
pH by Meter	E108	1778434	1	14	7.1	5.0	✔
Sulfate in Water by IC	E235.SO4	1778442	1	11	9.0	5.0	✔
TDS by Gravimetry	E162	1778085	1	18	5.5	5.0	✔
Total Cyanide	E333	1778955	1	1	100.0	5.0	✔
Total Mercury in Water by CVAAS	E508	1778474	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1777978	1	2	50.0	5.0	✔
Total Organic Carbon (Non-Purgeable) by Combustion (Low Level)	E355-L	1777538	1	1	100.0	5.0	✔
Total Sulfide by Colourimetry (Automated Flow)	E395-H	1778131	1	1	100.0	5.0	✔
Turbidity by Nephelometry	E121	1779281	1	20	5.0	5.0	✔
UV Absorbance and Transmittance by Spectrometry	E404	1779752	1	1	100.0	5.0	✔
<b>Laboratory Control Samples (LCS)</b>							
Alkalinity Species by Titration	E290	1778435	1	8	12.5	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1778439	1	8	12.5	5.0	✔
Chloride in Water by IC	E235.Cl	1778438	1	9	11.1	5.0	✔
Colour (True) by Spectrometer (5 CU)	E329	1778443	1	1	100.0	5.0	✔
Conductivity in Water	E100	1778436	1	5	20.0	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1778479	1	20	5.0	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1778107	1	2	50.0	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1777537	1	1	100.0	5.0	✔
Fluoride in Water by IC	E235.F	1778437	1	9	11.1	5.0	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1778440	1	8	12.5	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1778441	1	8	12.5	5.0	✔
pH by Meter	E108	1778434	1	14	7.1	5.0	✔
Sulfate in Water by IC	E235.SO4	1778442	1	11	9.0	5.0	✔
TDS by Gravimetry	E162	1778085	1	18	5.5	5.0	✔



Matrix: **Water**

Evaluation: ✖ = QC frequency outside specification; ✔ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		
			QC	Regular	Actual	Expected	Evaluation
<b>Analytical Methods</b>							
<b>Laboratory Control Samples (LCS) - Continued</b>							
Total Cyanide	E333	1778955	1	1	100.0	5.0	✔
Total Mercury in Water by CVAAS	E508	1778474	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1777978	1	2	50.0	5.0	✔
Total Organic Carbon (Non-Purgeable) by Combustion (Low Level)	E355-L	1777538	1	1	100.0	5.0	✔
Total Sulfide by Colourimetry (Automated Flow)	E395-H	1778131	1	1	100.0	5.0	✔
Turbidity by Nephelometry	E121	1779281	1	20	5.0	5.0	✔
UV Absorbance and Transmittance by Spectrometry	E404	1779752	1	1	100.0	5.0	✔
<b>Method Blanks (MB)</b>							
Alkalinity Species by Titration	E290	1778435	1	8	12.5	5.0	✔
Bromide in Water by IC (Low Level)	E235.Br-L	1778439	1	8	12.5	5.0	✔
Chloride in Water by IC	E235.Cl	1778438	1	9	11.1	5.0	✔
Colour (True) by Spectrometer (5 CU)	E329	1778443	1	1	100.0	5.0	✔
Conductivity in Water	E100	1778436	1	5	20.0	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1778479	1	20	5.0	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1778107	1	2	50.0	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1777537	1	1	100.0	5.0	✔
Fluoride in Water by IC	E235.F	1778437	1	9	11.1	5.0	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1778440	1	8	12.5	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1778441	1	8	12.5	5.0	✔
Sulfate in Water by IC	E235.SO4	1778442	1	11	9.0	5.0	✔
TDS by Gravimetry	E162	1778085	1	18	5.5	5.0	✔
Total Cyanide	E333	1778955	1	1	100.0	5.0	✔
Total Mercury in Water by CVAAS	E508	1778474	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1777978	1	2	50.0	5.0	✔
Total Organic Carbon (Non-Purgeable) by Combustion (Low Level)	E355-L	1777538	1	1	100.0	5.0	✔
Total Sulfide by Colourimetry (Automated Flow)	E395-H	1778131	1	1	100.0	5.0	✔
Turbidity by Nephelometry	E121	1779281	1	20	5.0	5.0	✔
UV Absorbance and Transmittance by Spectrometry	E404	1779752	1	1	100.0	5.0	✔
<b>Matrix Spikes (MS)</b>							
Bromide in Water by IC (Low Level)	E235.Br-L	1778439	1	8	12.5	5.0	✔
Chloride in Water by IC	E235.Cl	1778438	1	9	11.1	5.0	✔
Dissolved Mercury in Water by CVAAS	E509	1778479	1	20	5.0	5.0	✔
Dissolved Metals in Water by CRC ICPMS	E421	1778107	1	2	50.0	5.0	✔
Dissolved Organic Carbon by Combustion (Low Level)	E358-L	1777537	0	1	0.0	5.0	✖
Fluoride in Water by IC	E235.F	1778437	1	9	11.1	5.0	✔
Nitrate in Water by IC (Low Level)	E235.NO3-L	1778440	1	8	12.5	5.0	✔
Nitrite in Water by IC (Low Level)	E235.NO2-L	1778441	1	8	12.5	5.0	✔
Sulfate in Water by IC	E235.SO4	1778442	1	11	9.0	5.0	✔
Total Cyanide	E333	1778955	0	1	0.0	5.0	✖



Matrix: **Water** Evaluation: ✘ = QC frequency outside specification; ✔ = QC frequency within specification.

Quality Control Sample Type	Method	QC Lot #	Count		Frequency (%)		
			QC	Regular	Actual	Expected	Evaluation
<i>Analytical Methods</i>							
<b>Matrix Spikes (MS) - Continued</b>							
Total Mercury in Water by CVAAS	E508	1778474	1	20	5.0	5.0	✔
Total Metals in Water by CRC ICPMS	E420	1777978	1	2	50.0	5.0	✔
Total Organic Carbon (Non-Purgeable) by Combustion (Low Level)	E355-L	1777538	0	1	0.0	5.0	✘
Total Sulfide by Colourimetry (Automated Flow)	E395-H	1778131	0	1	0.0	5.0	✘



## Methodology References and Summaries

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Reference methods may incorporate modifications to improve performance (indicated by "mod").

Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Conductivity in Water	E100 ALS Environmental - Vancouver	Water	APHA 2510 (mod)	Conductivity, also known as Electrical Conductivity (EC) or Specific Conductance, is measured by immersion of a conductivity cell with platinum electrodes into a water sample. Conductivity measurements are temperature-compensated to 25°C.
pH by Meter	E108 ALS Environmental - Vancouver	Water	APHA 4500-H (mod)	pH is determined by potentiometric measurement with a pH electrode, and is conducted at ambient laboratory temperature (normally 20 ± 5°C). For high accuracy test results, pH should be measured in the field within the recommended 15 minute hold time.
Turbidity by Nephelometry	E121 ALS Environmental - Vancouver	Water	APHA 2130 B (mod)	Turbidity is measured by the nephelometric method, by measuring the intensity of light scatter under defined conditions.
TDS by Gravimetry	E162 ALS Environmental - Vancouver	Water	APHA 2540 C (mod)	Total Dissolved Solids (TDS) are determined by filtering a sample through a glass fibre filter, with evaporation of the filtrate at 180 ± 2°C for 16 hours or to constant weight, with gravimetric measurement of the residue.
Bromide in Water by IC (Low Level)	E235.Br-L ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Chloride in Water by IC	E235.Cl ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Fluoride in Water by IC	E235.F ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Nitrite in Water by IC (Low Level)	E235.NO2-L ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Nitrate in Water by IC (Low Level)	E235.NO3-L ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.
Sulfate in Water by IC	E235.SO4 ALS Environmental - Vancouver	Water	EPA 300.1 (mod)	Inorganic anions are analyzed by Ion Chromatography with conductivity and/or UV detection.



Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Alkalinity Species by Titration	E290 ALS Environmental - Vancouver	Water	APHA 2320 B (mod)	Total alkalinity is determined by potentiometric titration to a pH 4.5 endpoint. Bicarbonate, carbonate and hydroxide alkalinity are calculated from phenolphthalein alkalinity and total alkalinity values.
Colour (True) by Spectrometer (5 CU)	E329 ALS Environmental - Vancouver	Water	APHA 2120 C (mod)	Colour (True Colour) is determined by filtering a sample through a 0.45 micron membrane filter followed by analysis of the filtrate using the platinum-cobalt colourimetric method. Colour measurements can be highly pH dependent, and apply to the pH of the sample as received (at time of testing), without pH adjustment.
Total Cyanide	E333 ALS Environmental - Vancouver	Water	ISO 14403 (mod)	Total or Strong Acid Dissociable (SAD) Cyanide is determined by Continuous Flow Analyzer (CFA) with in-line UV digestion followed by colourimetric analysis.  Method Limitation: High levels of thiocyanate (SCN) may cause positive interference (up to 0.5% of SCN concentration).
Total Organic Carbon (Non-Purgeable) by Combustion (Low Level)	E355-L ALS Environmental - Vancouver	Water	APHA 5310 B (mod)	Total Organic Carbon (Non-Purgeable), also known as NPOC (total), is a direct measurement of TOC after an acidified sample has been purged to remove inorganic carbon (IC). Analysis is by high temperature combustion with infrared detection of CO <sub>2</sub> . NPOC does not include volatile organic species that are purged off with IC. For samples where the majority of total carbon (TC) is comprised of IC (which is common), this method is more accurate and more reliable than the TOC by subtraction method (i.e. TC minus TIC).
Dissolved Organic Carbon by Combustion (Low Level)	E358-L ALS Environmental - Vancouver	Water	APHA 5310 B (mod)	Dissolved Organic Carbon (Non-Purgeable), also known as NPOC (dissolved), is a direct measurement of DOC after a filtered (0.45 micron) sample has been acidified and purged to remove inorganic carbon (IC). Analysis is by high temperature combustion with infrared detection of CO <sub>2</sub> . NPOC does not include volatile organic species that are purged off with IC. For samples where the majority of DC (dissolved carbon) is comprised of IC (which is common), this method is more accurate and more reliable than the DOC by subtraction method (i.e. DC minus DIC).
Total Sulfide by Colourimetry (Automated Flow)	E395-H ALS Environmental - Vancouver	Water	APHA 4500 -S E-Auto-Colorimetry	Sulfide is determined using the gas dialysis automated methylene blue colourimetric method. Results expressed "as H <sub>2</sub> S" if reported represent the maximum possible H <sub>2</sub> S concentration based on the total sulfide concentration in the sample. The H <sub>2</sub> S calculation converts Total Sulphide as (S <sub>2</sub> -) and reports it as Total Sulphide as (H <sub>2</sub> S)
UV Absorbance and Transmittance by Spectrometry	E404 ALS Environmental - Vancouver	Water	APHA 5910 B (mod)	UV Absorbance is determined by first filtering a sample through a 0.45 micron filter, followed by UV absorbance measurement in a quartz cell at 254 nm. The analysis is carried out without pH adjustment.
Total Metals in Water by CRC ICPMS	E420 ALS Environmental - Vancouver	Water	EPA 200.2/6020B (mod)	Water samples are digested with nitric and hydrochloric acids, and analyzed by Collision/Reaction Cell ICPMS.  Method Limitation (re: Sulfur): Sulfide and volatile sulfur species may not be recovered by this method.





Analytical Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Dissolved Metals in Water by CRC ICPMS	E421 ALS Environmental - Vancouver	Water	APHA 3030B/EPA 6020B (mod)	Water samples are filtered (0.45 um), preserved with nitric acid, and analyzed by Collision/Reaction Cell ICPMS.  Method Limitation (re: Sulfur): Sulfide and volatile sulfur species may not be recovered by this method.
Total Mercury in Water by CVAAS	E508 ALS Environmental - Vancouver	Water	EPA 1631E (mod)	Water samples undergo a cold-oxidation using bromine monochloride prior to reduction with stannous chloride, and analyzed by CVAAS
Dissolved Mercury in Water by CVAAS	E509 ALS Environmental - Vancouver	Water	APHA 3030B/EPA 1631E (mod)	Water samples are filtered (0.45 um), preserved with HCl, then undergo a cold-oxidation using bromine monochloride prior to reduction with stannous chloride, and analyzed by CVAAS.
Dissolved Hardness (Calculated)	EC100 ALS Environmental - Vancouver	Water	APHA 2340B	"Hardness (as CaCO <sub>3</sub> ), dissolved" is calculated from the sum of dissolved Calcium and Magnesium concentrations, expressed in CaCO <sub>3</sub> equivalents. "Total Hardness" refers to the sum of Calcium and Magnesium Hardness. Hardness is normally or preferentially calculated from dissolved Calcium and Magnesium concentrations, because it is a property of water due to dissolved divalent cations.
Hardness (Calculated) from Total Ca/Mg	EC100A ALS Environmental - Vancouver	Water	APHA 2340B	"Hardness (as CaCO <sub>3</sub> ), from total Ca/Mg" is calculated from the sum of total Calcium and Magnesium concentrations, expressed in CaCO <sub>3</sub> equivalents. "Total Hardness" refers to the sum of Calcium and Magnesium Hardness. Hardness is normally or preferentially calculated from dissolved Calcium and Magnesium concentrations, because it is a property of water due to dissolved divalent cations. Hardness from total Ca/Mg is normally comparable to Dissolved Hardness in non-turbid waters.

Preparation Methods	Method / Lab	Matrix	Method Reference	Method Descriptions
Preparation for Total Organic Carbon by Combustion	EP355 ALS Environmental - Vancouver	Water		Preparation for Total Organic Carbon by Combustion
Preparation for Dissolved Organic Carbon for Combustion	EP358 ALS Environmental - Vancouver	Water	APHA 5310 B (mod)	Preparation for Dissolved Organic Carbon
Dissolved Metals Water Filtration	EP421 ALS Environmental - Vancouver	Water	APHA 3030B	Water samples are filtered (0.45 um), and preserved with HNO <sub>3</sub> .
Dissolved Mercury Water Filtration	EP509 ALS Environmental - Vancouver	Water	APHA 3030B	Water samples are filtered (0.45 um), and preserved with HCl.

## QUALITY CONTROL REPORT

<b>Work Order</b>	<b>: FJ2403536</b>	<b>Page</b>	: 1 of 17
<b>Client</b>	: Tetra Tech Canada Inc.	<b>Laboratory</b>	: ALS Environmental - Fort St. John
<b>Contact</b>	: Andrea McMillan	<b>Account Manager</b>	: Brent Mack
<b>Address</b>	: 110, 140 Quarry Park Blvd SE Calgary AB Canada T2C 3G3	<b>Address</b>	: 11007 Alaska Road Fort St. John, British Columbia Canada V1J 6P3
<b>Telephone</b>	: ----	<b>Telephone</b>	: 778-370-3279
<b>Project</b>	: 704-ENW.GENV03704-02, Task 001	<b>Date Samples Received</b>	: 20-Nov-2024 12:45
<b>PO</b>	: ----	<b>Date Analysis Commenced</b>	: 21-Nov-2024
<b>C-O-C number</b>	: 20-964972	<b>Issue Date</b>	: 22-Nov-2024 16:46
<b>Sampler</b>	: Leroy Wolford		
<b>Site</b>	: ----		
<b>Quote number</b>	: VA24-EBAE100-013		
<b>No. of samples received</b>	: 1		
<b>No. of samples analysed</b>	: 1		

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Quality Control Report contains the following information:

- Laboratory Duplicate (DUP) Report; Relative Percent Difference (RPD) and Data Quality Objectives
- Matrix Spike (MS) Report; Recovery and Data Quality Objectives
- Method Blank (MB) Report; Recovery and Data Quality Objectives
- Laboratory Control Sample (LCS) Report; Recovery and Data Quality Objectives

### Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

<i>Signatories</i>	<i>Position</i>	<i>Laboratory Department</i>
Erika Vanegas	Lab Assistant	Vancouver Metals, Burnaby, British Columbia
Kate Dimitrova	Supervisor - Inorganic	Vancouver Inorganics, Burnaby, British Columbia
Kim Jensen	Department Manager - Metals	Vancouver Metals, Burnaby, British Columbia
Monica Ko	Lab Assistant	Vancouver Inorganics, Burnaby, British Columbia
Owen Cheng		Vancouver Metals, Burnaby, British Columbia
Tracy Harley	Supervisor - Water Quality Instrumentation	Vancouver Inorganics, Burnaby, British Columbia

Page : 2 of 17  
Work Order : FJ2403536  
Client : Tetra Tech Canada Inc.  
Project : 704-ENW.GENV03704-02, Task 001



---

## General Comments

The ALS Quality Control (QC) report is optionally provided to ALS clients upon request. ALS test methods include comprehensive QC checks with every analysis to ensure our high standards of quality are met. Each QC result has a known or expected target value, which is compared against predetermined Data Quality Objectives (DQOs) to provide confidence in the accuracy of associated test results. This report contains detailed results for all QC results applicable to this sample submission. Please refer to the ALS Quality Control Interpretation report (QCI) for applicable method references and methodology summaries.

### Key :

Anonymous = Refers to samples which are not part of this work order, but which formed part of the QC process lot.

CAS Number = Chemical Abstracts Service number is a unique identifier assigned to discrete substances.

DQO = Data Quality Objective.

LOR = Limit of Reporting (detection limit).

RPD = Relative Percent Difference

# = Indicates a QC result that did not meet the ALS DQO.

---

## Workorder Comments

Holding times are displayed as "---" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

---



### Laboratory Duplicate (DUP) Report

A Laboratory Duplicate (DUP) is a randomly selected intralaboratory replicate sample. Laboratory Duplicates provide information regarding method precision and sample heterogeneity. ALS DQOs for Laboratory Duplicates are expressed as test-specific limits for Relative Percent Difference (RPD), or as an absolute difference limit of 2 times the LOR for low concentration duplicates within ~ 4-10 times the LOR (cut-off is test-specific).

Sub-Matrix: <b>Water</b>					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
<b>Physical Tests (QC Lot: 1778085)</b>											
FJ2403536-001	Location 3	Solids, total dissolved [TDS]	----	E162	20	mg/L	1230	1240	0.727%	20%	----
<b>Physical Tests (QC Lot: 1778434)</b>											
FJ2403536-001	Location 3	pH	----	E108	0.10	pH units	8.34	8.34	0.00%	4%	----
<b>Physical Tests (QC Lot: 1778435)</b>											
FJ2403536-001	Location 3	Alkalinity, bicarbonate (as CaCO <sub>3</sub> )	----	E290	1.0	mg/L	933	934	0.162%	200%	----
		Alkalinity, carbonate (as CaCO <sub>3</sub> )	----	E290	1.0	mg/L	13.3	14.7	10.1%	200%	----
		Alkalinity, hydroxide (as CaCO <sub>3</sub> )	----	E290	1.0	mg/L	<1.0	<1.0	0.00%	200%	----
		Alkalinity, phenolphthalein (as CaCO <sub>3</sub> )	----	E290	1.0	mg/L	6.7	7.4	0.7	Diff <2x LOR	----
		Alkalinity, total (as CaCO <sub>3</sub> )	----	E290	1.0	mg/L	946	949	0.309%	20%	----
<b>Physical Tests (QC Lot: 1778436)</b>											
FJ2403536-001	Location 3	Conductivity	----	E100	2.0	µS/cm	1890	1890	0.106%	10%	----
<b>Physical Tests (QC Lot: 1778443)</b>											
FJ2403536-001	Location 3	Colour, true	----	E329	5.0	CU	<5.0	<5.0	0	Diff <2x LOR	----
<b>Physical Tests (QC Lot: 1779281)</b>											
FJ2403536-001	Location 3	Turbidity	----	E121	0.10	NTU	26.0	26.0	0.00%	15%	----
<b>Physical Tests (QC Lot: 1779752)</b>											
FJ2403536-001	Location 3	Absorbance, UV (@ 254nm)	----	E404	0.0050	AU/cm	0.0830	0.0830	0.00%	20%	----
<b>Anions and Nutrients (QC Lot: 1778437)</b>											
FJ2403536-001	Location 3	Fluoride	16984-48-8	E235.F	0.200	mg/L	0.629	0.604	0.025	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1778438)</b>											
FJ2403536-001	Location 3	Chloride	16887-00-6	E235.Cl	5.00	mg/L	38.6	37.6	0.92	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1778439)</b>											
FJ2403536-001	Location 3	Bromide	24959-67-9	E235.Br-L	0.500	mg/L	<0.500	<0.500	0	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1778440)</b>											
FJ2403536-001	Location 3	Nitrate (as N)	14797-55-8	E235.NO3-L	0.0500	mg/L	<0.0500	<0.0500	0	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1778441)</b>											
FJ2403536-001	Location 3	Nitrite (as N)	14797-65-0	E235.NO2-L	0.0100	mg/L	<0.0100	<0.0100	0	Diff <2x LOR	----
<b>Anions and Nutrients (QC Lot: 1778442)</b>											
FJ2403536-001	Location 3	Sulfate (as SO <sub>4</sub> )	14808-79-8	E235.SO4	3.00	mg/L	120	117	3.07%	20%	----



Sub-Matrix: Water					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
<b>Cyanides (QC Lot: 1778955)</b>											
FJ2403536-001	Location 3	Cyanide, strong acid dissociable (Total)	----	E333	0.0050	mg/L	<0.0050	<0.0050	0	Diff <2x LOR	----
<b>Organic / Inorganic Carbon (QC Lot: 1777537)</b>											
FJ2403536-001	Location 3	Carbon, dissolved organic [DOC]	----	E358-L	0.50	mg/L	4.00	3.67	0.33	Diff <2x LOR	----
<b>Organic / Inorganic Carbon (QC Lot: 1777538)</b>											
FJ2403536-001	Location 3	Carbon, total organic [TOC]	----	E355-L	0.50	mg/L	3.74	3.72	0.02	Diff <2x LOR	----
<b>Total Sulfides (QC Lot: 1778131)</b>											
FJ2403536-001	Location 3	Sulfide, total (as S)	18496-25-8	E395-H	0.010	mg/L	<0.010	<0.010	0	Diff <2x LOR	----
<b>Total Metals (QC Lot: 1777978)</b>											
FJ2403536-001	Location 3	Aluminum, total	7429-90-5	E420	0.0060	mg/L	0.165	0.185	11.2%	20%	----
		Antimony, total	7440-36-0	E420	0.00020	mg/L	0.00696	0.00715	2.66%	20%	----
		Arsenic, total	7440-38-2	E420	0.00020	mg/L	0.0214	0.0216	0.908%	20%	----
		Barium, total	7440-39-3	E420	0.00020	mg/L	0.467	0.464	0.795%	20%	----
		Beryllium, total	7440-41-7	E420	0.000100	mg/L	<0.000100	<0.000100	0	Diff <2x LOR	----
		Bismuth, total	7440-69-9	E420	0.000100	mg/L	<0.000100	<0.000100	0	Diff <2x LOR	----
		Boron, total	7440-42-8	E420	0.020	mg/L	0.352	0.362	2.69%	20%	----
		Cadmium, total	7440-43-9	E420	0.0000100	mg/L	0.000116	0.000119	2.43%	20%	----
		Calcium, total	7440-70-2	E420	0.100	mg/L	41.0	42.7	4.11%	20%	----
		Cesium, total	7440-46-2	E420	0.000020	mg/L	0.000125	0.000131	0.000007	Diff <2x LOR	----
		Chromium, total	7440-47-3	E420	0.00100	mg/L	<0.00100	<0.00100	0	Diff <2x LOR	----
		Cobalt, total	7440-48-4	E420	0.00020	mg/L	0.00190	0.00188	0.00002	Diff <2x LOR	----
		Copper, total	7440-50-8	E420	0.00100	mg/L	0.00264	0.00262	0.00003	Diff <2x LOR	----
		Iron, total	7439-89-6	E420	0.020	mg/L	3.17	3.21	1.19%	20%	----
		Lead, total	7439-92-1	E420	0.000100	mg/L	0.000556	0.000550	0.000006	Diff <2x LOR	----
		Lithium, total	7439-93-2	E420	0.0020	mg/L	0.0154	0.0159	0.0004	Diff <2x LOR	----
		Magnesium, total	7439-95-4	E420	0.0100	mg/L	36.2	35.8	0.987%	20%	----
		Manganese, total	7439-96-5	E420	0.00020	mg/L	0.115	0.116	0.752%	20%	----
		Molybdenum, total	7439-98-7	E420	0.000100	mg/L	0.0335	0.0340	1.43%	20%	----
		Nickel, total	7440-02-0	E420	0.00100	mg/L	0.0119	0.0119	0.106%	20%	----
Phosphorus, total	7723-14-0	E420	0.100	mg/L	<0.100	<0.100	0	Diff <2x LOR	----		
Potassium, total	7440-09-7	E420	0.100	mg/L	3.39	3.31	2.29%	20%	----		
Rubidium, total	7440-17-7	E420	0.00040	mg/L	0.00270	0.00256	0.00014	Diff <2x LOR	----		
Selenium, total	7782-49-2	E420	0.000100	mg/L	0.00315	0.00316	0.394%	20%	----		
Silicon, total	7440-21-3	E420	0.20	mg/L	4.68	4.44	5.10%	20%	----		
Silver, total	7440-22-4	E420	0.000020	mg/L	<0.000020	<0.000020	0	Diff <2x LOR	----		



Sub-Matrix: Water					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
<b>Total Metals (QC Lot: 1777978) - continued</b>											
FJ2403536-001	Location 3	Sodium, total	7440-23-5	E420	0.100	mg/L	395	385	2.38%	20%	---
		Strontium, total	7440-24-6	E420	0.00040	mg/L	0.665	0.674	1.33%	20%	---
		Sulfur, total	7704-34-9	E420	1.00	mg/L	48.8	45.1	7.95%	20%	---
		Tellurium, total	13494-80-9	E420	0.00040	mg/L	<0.00040	<0.00040	0	Diff <2x LOR	---
		Thallium, total	7440-28-0	E420	0.000020	mg/L	0.000028	0.000028	0.0000001	Diff <2x LOR	---
		Thorium, total	7440-29-1	E420	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	---
		Tin, total	7440-31-5	E420	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	---
		Titanium, total	7440-32-6	E420	0.00060	mg/L	0.00554	0.00545	0.00009	Diff <2x LOR	---
		Tungsten, total	7440-33-7	E420	0.00020	mg/L	0.00033	0.00031	0.00002	Diff <2x LOR	---
		Uranium, total	7440-61-1	E420	0.000020	mg/L	0.00695	0.00693	0.341%	20%	---
		Vanadium, total	7440-62-2	E420	0.00100	mg/L	0.00127	0.00135	0.00008	Diff <2x LOR	---
		Zinc, total	7440-66-6	E420	0.0060	mg/L	0.0092	0.0090	0.0001	Diff <2x LOR	---
		Zirconium, total	7440-67-7	E420	0.00040	mg/L	0.00064	0.00062	0.00002	Diff <2x LOR	---
<b>Total Metals (QC Lot: 1778474)</b>											
FJ2403504-007	Anonymous	Mercury, total	7439-97-6	E508	0.0000050	mg/L	<0.0000050	<0.0000050	0	Diff <2x LOR	---
<b>Dissolved Metals (QC Lot: 1778107)</b>											
FJ2403536-001	Location 3	Aluminum, dissolved	7429-90-5	E421	0.0020	mg/L	0.0027	<0.0020	0.0007	Diff <2x LOR	---
		Antimony, dissolved	7440-36-0	E421	0.00020	mg/L	0.00671	0.00665	0.953%	20%	---
		Arsenic, dissolved	7440-38-2	E421	0.00020	mg/L	0.00623	0.00641	2.96%	20%	---
		Barium, dissolved	7440-39-3	E421	0.00020	mg/L	0.418	0.424	1.45%	20%	---
		Beryllium, dissolved	7440-41-7	E421	0.000100	mg/L	<0.000100	<0.000100	0	Diff <2x LOR	---
		Bismuth, dissolved	7440-69-9	E421	0.000100	mg/L	<0.000100	<0.000100	0	Diff <2x LOR	---
		Boron, dissolved	7440-42-8	E421	0.020	mg/L	0.329	0.304	7.90%	20%	---
		Cadmium, dissolved	7440-43-9	E421	0.0000100	mg/L	0.0000734	0.0000759	0.0000025	Diff <2x LOR	---
		Calcium, dissolved	7440-70-2	E421	0.100	mg/L	38.9	38.8	0.244%	20%	---
		Cesium, dissolved	7440-46-2	E421	0.000020	mg/L	0.000078	0.000074	0.000004	Diff <2x LOR	---
		Chromium, dissolved	7440-47-3	E421	0.00100	mg/L	<0.00100	<0.00100	0	Diff <2x LOR	---
		Cobalt, dissolved	7440-48-4	E421	0.00020	mg/L	0.00174	0.00173	0.000008	Diff <2x LOR	---
		Copper, dissolved	7440-50-8	E421	0.00040	mg/L	0.00055	0.00055	0.0000005	Diff <2x LOR	---
		Iron, dissolved	7439-89-6	E421	0.020	mg/L	0.787	0.778	1.09%	20%	---
		Lead, dissolved	7439-92-1	E421	0.000100	mg/L	<0.000100	<0.000100	0	Diff <2x LOR	---
		Lithium, dissolved	7439-93-2	E421	0.0020	mg/L	0.0141	0.0138	0.0002	Diff <2x LOR	---
		Magnesium, dissolved	7439-95-4	E421	0.0100	mg/L	34.2	34.8	1.82%	20%	---
		Manganese, dissolved	7439-96-5	E421	0.00020	mg/L	0.112	0.114	1.59%	20%	---



Sub-Matrix: Water					Laboratory Duplicate (DUP) Report						
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	LOR	Unit	Original Result	Duplicate Result	RPD(%) or Difference	Duplicate Limits	Qualifier
<b>Dissolved Metals (QC Lot: 1778107) - continued</b>											
FJ2403536-001	Location 3	Molybdenum, dissolved	7439-98-7	E421	0.000100	mg/L	0.0304	0.0300	1.08%	20%	----
		Nickel, dissolved	7440-02-0	E421	0.00100	mg/L	0.0111	0.0113	1.99%	20%	----
		Phosphorus, dissolved	7723-14-0	E421	0.100	mg/L	<0.100	<0.100	0	Diff <2x LOR	----
		Potassium, dissolved	7440-09-7	E421	0.100	mg/L	3.39	3.42	0.835%	20%	----
		Rubidium, dissolved	7440-17-7	E421	0.00040	mg/L	0.00238	0.00244	0.00006	Diff <2x LOR	----
		Selenium, dissolved	7782-49-2	E421	0.000100	mg/L	0.00301	0.00306	1.52%	20%	----
		Silicon, dissolved	7440-21-3	E421	0.100	mg/L	4.07	4.00	1.73%	20%	----
		Silver, dissolved	7440-22-4	E421	0.000020	mg/L	<0.000020	<0.000020	0	Diff <2x LOR	----
		Sodium, dissolved	7440-23-5	E421	0.100	mg/L	401	405	0.881%	20%	----
		Strontium, dissolved	7440-24-6	E421	0.00040	mg/L	0.598	0.595	0.558%	20%	----
		Sulfur, dissolved	7704-34-9	E421	1.00	mg/L	42.8	41.8	2.40%	20%	----
		Tellurium, dissolved	13494-80-9	E421	0.00040	mg/L	<0.00040	<0.00040	0	Diff <2x LOR	----
		Thallium, dissolved	7440-28-0	E421	0.000020	mg/L	0.000023	0.000021	0.000002	Diff <2x LOR	----
		Thorium, dissolved	7440-29-1	E421	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	----
		Tin, dissolved	7440-31-5	E421	0.00020	mg/L	<0.00020	<0.00020	0	Diff <2x LOR	----
		Titanium, dissolved	7440-32-6	E421	0.00060	mg/L	<0.00060	<0.00060	0	Diff <2x LOR	----
		Tungsten, dissolved	7440-33-7	E421	0.00020	mg/L	0.00030	0.00029	0.000007	Diff <2x LOR	----
		Uranium, dissolved	7440-61-1	E421	0.000020	mg/L	0.00624	0.00621	0.481%	20%	----
		Vanadium, dissolved	7440-62-2	E421	0.00100	mg/L	<0.00100	<0.00100	0	Diff <2x LOR	----
Zinc, dissolved	7440-66-6	E421	0.0020	mg/L	0.0043	0.0044	0.0001	Diff <2x LOR	----		
Zirconium, dissolved	7440-67-7	E421	0.00040	mg/L	0.00041	<0.00040	0.00001	Diff <2x LOR	----		
<b>Dissolved Metals (QC Lot: 1778479)</b>											
FJ2403504-007	Anonymous	Mercury, dissolved	7439-97-6	E509	0.0000050	mg/L	<0.0000050	<0.0000050	0	Diff <2x LOR	----



## Method Blank (MB) Report

A Method Blank is an analyte-free matrix that undergoes sample processing identical to that carried out for test samples. Method Blank results are used to monitor and control for potential contamination from the laboratory environment and reagents. For most tests, the DQO for Method Blanks is for the result to be < LOR.

Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
<b>Physical Tests (QCLot: 1778085)</b>						
Solids, total dissolved [TDS]	---	E162	10	mg/L	<10	---
<b>Physical Tests (QCLot: 1778435)</b>						
Alkalinity, bicarbonate (as CaCO3)	---	E290	1	mg/L	<1.0	---
Alkalinity, carbonate (as CaCO3)	---	E290	1	mg/L	<1.0	---
Alkalinity, hydroxide (as CaCO3)	---	E290	1	mg/L	<1.0	---
Alkalinity, phenolphthalein (as CaCO3)	---	E290	1	mg/L	<1.0	---
Alkalinity, total (as CaCO3)	---	E290	1	mg/L	<1.0	---
<b>Physical Tests (QCLot: 1778436)</b>						
Conductivity	---	E100	1	µS/cm	<1.0	---
<b>Physical Tests (QCLot: 1778443)</b>						
Colour, true	---	E329	5	CU	<5.0	---
<b>Physical Tests (QCLot: 1779281)</b>						
Turbidity	---	E121	0.1	NTU	<0.10	---
<b>Physical Tests (QCLot: 1779752)</b>						
Absorbance, UV (@ 254nm)	---	E404	0.005	AU/cm	<0.0050	---
<b>Anions and Nutrients (QCLot: 1778437)</b>						
Fluoride	16984-48-8	E235.F	0.02	mg/L	<0.020	---
<b>Anions and Nutrients (QCLot: 1778438)</b>						
Chloride	16887-00-6	E235.Cl	0.5	mg/L	<0.50	---
<b>Anions and Nutrients (QCLot: 1778439)</b>						
Bromide	24959-67-9	E235.Br-L	0.05	mg/L	<0.050	---
<b>Anions and Nutrients (QCLot: 1778440)</b>						
Nitrate (as N)	14797-55-8	E235.NO3-L	0.005	mg/L	<0.0050	---
<b>Anions and Nutrients (QCLot: 1778441)</b>						
Nitrite (as N)	14797-65-0	E235.NO2-L	0.001	mg/L	<0.0010	---
<b>Anions and Nutrients (QCLot: 1778442)</b>						
Sulfate (as SO4)	14808-79-8	E235.SO4	0.3	mg/L	<0.30	---
<b>Cyanides (QCLot: 1778955)</b>						
Cyanide, strong acid dissociable (Total)	---	E333	0.002	mg/L	<0.0020	---
<b>Organic / Inorganic Carbon (QCLot: 1777537)</b>						
Carbon, dissolved organic [DOC]	---	E358-L	0.5	mg/L	<0.50	---
<b>Organic / Inorganic Carbon (QCLot: 1777538)</b>						





Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
<b>Organic / Inorganic Carbon (QCLot: 1777538) - continued</b>						
Carbon, total organic [TOC]	---	E355-L	0.5	mg/L	<0.50	---
<b>Total Sulfides (QCLot: 1778131)</b>						
Sulfide, total (as S)	18496-25-8	E395-H	0.01	mg/L	<0.010	---
<b>Total Metals (QCLot: 1777978)</b>						
Aluminum, total	7429-90-5	E420	0.003	mg/L	<0.0030	---
Antimony, total	7440-36-0	E420	0.0001	mg/L	<0.00010	---
Arsenic, total	7440-38-2	E420	0.0001	mg/L	<0.00010	---
Barium, total	7440-39-3	E420	0.0001	mg/L	<0.00010	---
Beryllium, total	7440-41-7	E420	0.00002	mg/L	<0.000020	---
Bismuth, total	7440-69-9	E420	0.00005	mg/L	<0.000050	---
Boron, total	7440-42-8	E420	0.01	mg/L	<0.010	---
Cadmium, total	7440-43-9	E420	0.000005	mg/L	<0.0000050	---
Calcium, total	7440-70-2	E420	0.05	mg/L	<0.050	---
Cesium, total	7440-46-2	E420	0.00001	mg/L	<0.000010	---
Chromium, total	7440-47-3	E420	0.0005	mg/L	<0.00050	---
Cobalt, total	7440-48-4	E420	0.0001	mg/L	<0.00010	---
Copper, total	7440-50-8	E420	0.0005	mg/L	<0.00050	---
Iron, total	7439-89-6	E420	0.01	mg/L	<0.010	---
Lead, total	7439-92-1	E420	0.00005	mg/L	<0.000050	---
Lithium, total	7439-93-2	E420	0.001	mg/L	<0.0010	---
Magnesium, total	7439-95-4	E420	0.005	mg/L	<0.0050	---
Manganese, total	7439-96-5	E420	0.0001	mg/L	<0.00010	---
Molybdenum, total	7439-98-7	E420	0.00005	mg/L	<0.000050	---
Nickel, total	7440-02-0	E420	0.0005	mg/L	<0.00050	---
Phosphorus, total	7723-14-0	E420	0.05	mg/L	<0.050	---
Potassium, total	7440-09-7	E420	0.05	mg/L	<0.050	---
Rubidium, total	7440-17-7	E420	0.0002	mg/L	<0.00020	---
Selenium, total	7782-49-2	E420	0.00005	mg/L	<0.000050	---
Silicon, total	7440-21-3	E420	0.1	mg/L	<0.10	---
Silver, total	7440-22-4	E420	0.00001	mg/L	<0.000010	---
Sodium, total	7440-23-5	E420	0.05	mg/L	<0.050	---
Strontium, total	7440-24-6	E420	0.0002	mg/L	<0.00020	---
Sulfur, total	7704-34-9	E420	0.5	mg/L	<0.50	---
Tellurium, total	13494-80-9	E420	0.0002	mg/L	<0.00020	---
Thallium, total	7440-28-0	E420	0.00001	mg/L	<0.000010	---



Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
<b>Total Metals (QCLot: 1777978) - continued</b>						
Thorium, total	7440-29-1	E420	0.0001	mg/L	<0.00010	----
Tin, total	7440-31-5	E420	0.0001	mg/L	<0.00010	----
Titanium, total	7440-32-6	E420	0.0003	mg/L	<0.00030	----
Tungsten, total	7440-33-7	E420	0.0001	mg/L	<0.00010	----
Uranium, total	7440-61-1	E420	0.00001	mg/L	<0.000010	----
Vanadium, total	7440-62-2	E420	0.0005	mg/L	<0.00050	----
Zinc, total	7440-66-6	E420	0.003	mg/L	<0.0030	----
Zirconium, total	7440-67-7	E420	0.0002	mg/L	<0.00020	----
<b>Total Metals (QCLot: 1778474)</b>						
Mercury, total	7439-97-6	E508	0.000005	mg/L	<0.0000050	----
<b>Dissolved Metals (QCLot: 1778107)</b>						
Aluminum, dissolved	7429-90-5	E421	0.001	mg/L	<0.0010	----
Antimony, dissolved	7440-36-0	E421	0.0001	mg/L	<0.00010	----
Arsenic, dissolved	7440-38-2	E421	0.0001	mg/L	<0.00010	----
Barium, dissolved	7440-39-3	E421	0.0001	mg/L	<0.00010	----
Beryllium, dissolved	7440-41-7	E421	0.00002	mg/L	<0.000020	----
Bismuth, dissolved	7440-69-9	E421	0.00005	mg/L	<0.000050	----
Boron, dissolved	7440-42-8	E421	0.01	mg/L	<0.010	----
Cadmium, dissolved	7440-43-9	E421	0.000005	mg/L	<0.0000050	----
Calcium, dissolved	7440-70-2	E421	0.05	mg/L	<0.050	----
Cesium, dissolved	7440-46-2	E421	0.00001	mg/L	<0.000010	----
Chromium, dissolved	7440-47-3	E421	0.0005	mg/L	<0.00050	----
Cobalt, dissolved	7440-48-4	E421	0.0001	mg/L	<0.00010	----
Copper, dissolved	7440-50-8	E421	0.0002	mg/L	<0.00020	----
Iron, dissolved	7439-89-6	E421	0.01	mg/L	<0.010	----
Lead, dissolved	7439-92-1	E421	0.00005	mg/L	<0.000050	----
Lithium, dissolved	7439-93-2	E421	0.001	mg/L	<0.0010	----
Magnesium, dissolved	7439-95-4	E421	0.005	mg/L	<0.0050	----
Manganese, dissolved	7439-96-5	E421	0.0001	mg/L	<0.00010	----
Molybdenum, dissolved	7439-98-7	E421	0.00005	mg/L	<0.000050	----
Nickel, dissolved	7440-02-0	E421	0.0005	mg/L	<0.00050	----
Phosphorus, dissolved	7723-14-0	E421	0.05	mg/L	<0.050	----
Potassium, dissolved	7440-09-7	E421	0.05	mg/L	<0.050	----
Rubidium, dissolved	7440-17-7	E421	0.0002	mg/L	<0.00020	----
Selenium, dissolved	7782-49-2	E421	0.00005	mg/L	<0.000050	----



Sub-Matrix: **Water**

Analyte	CAS Number	Method	LOR	Unit	Result	Qualifier
<b>Dissolved Metals (QCLot: 1778107) - continued</b>						
Silicon, dissolved	7440-21-3	E421	0.05	mg/L	<0.050	----
Silver, dissolved	7440-22-4	E421	0.00001	mg/L	<0.000010	----
Sodium, dissolved	7440-23-5	E421	0.05	mg/L	<0.050	----
Strontium, dissolved	7440-24-6	E421	0.0002	mg/L	<0.00020	----
Sulfur, dissolved	7704-34-9	E421	0.5	mg/L	<0.50	----
Tellurium, dissolved	13494-80-9	E421	0.0002	mg/L	<0.00020	----
Thallium, dissolved	7440-28-0	E421	0.00001	mg/L	<0.000010	----
Thorium, dissolved	7440-29-1	E421	0.0001	mg/L	<0.00010	----
Tin, dissolved	7440-31-5	E421	0.0001	mg/L	<0.00010	----
Titanium, dissolved	7440-32-6	E421	0.0003	mg/L	<0.00030	----
Tungsten, dissolved	7440-33-7	E421	0.0001	mg/L	<0.00010	----
Uranium, dissolved	7440-61-1	E421	0.00001	mg/L	<0.000010	----
Vanadium, dissolved	7440-62-2	E421	0.0005	mg/L	<0.00050	----
Zinc, dissolved	7440-66-6	E421	0.001	mg/L	<0.0010	----
Zirconium, dissolved	7440-67-7	E421	0.0002	mg/L	<0.00020	----
<b>Dissolved Metals (QCLot: 1778479)</b>						
Mercury, dissolved	7439-97-6	E509	0.000005	mg/L	<0.0000050	----



## Laboratory Control Sample (LCS) Report

A Laboratory Control Sample (LCS) is an analyte-free matrix that has been fortified (spiked) with test analytes at known concentration and processed in an identical manner to test samples. LCS results are expressed as percent recovery, and are used to monitor and control test method accuracy and precision, independent of test sample matrix.

Sub-Matrix: Water

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
<b>Physical Tests (QCLot: 1778085)</b>									
Solids, total dissolved [TDS]	---	E162	10	mg/L	1000 mg/L	107	85.0	115	---
<b>Physical Tests (QCLot: 1778434)</b>									
pH	---	E108	---	pH units	7 pH units	100	98.0	102	---
<b>Physical Tests (QCLot: 1778435)</b>									
Alkalinity, phenolphthalein (as CaCO <sub>3</sub> )	---	E290	1	mg/L	229 mg/L	124	75.0	125	---
Alkalinity, total (as CaCO <sub>3</sub> )	---	E290	1	mg/L	500 mg/L	104	85.0	115	---
<b>Physical Tests (QCLot: 1778436)</b>									
Conductivity	---	E100	1	µS/cm	147 µS/cm	99.4	90.0	110	---
<b>Physical Tests (QCLot: 1778443)</b>									
Colour, true	---	E329	5	CU	100 CU	104	85.0	115	---
<b>Physical Tests (QCLot: 1779281)</b>									
Turbidity	---	E121	0.1	NTU	200 NTU	99.5	85.0	115	---
<b>Physical Tests (QCLot: 1779752)</b>									
Absorbance, UV (@ 254nm)	---	E404	0.005	AU/cm	0.693 AU/cm	93.8	85.0	115	---
Transmittance, UV (@ 254nm)	---	E404	---	% T/cm	20.3 % T/cm	110	85.0	115	---
<b>Anions and Nutrients (QCLot: 1778437)</b>									
Fluoride	16984-48-8	E235.F	0.02	mg/L	1 mg/L	97.9	90.0	110	---
<b>Anions and Nutrients (QCLot: 1778438)</b>									
Chloride	16887-00-6	E235.Cl	0.5	mg/L	100 mg/L	99.2	90.0	110	---
<b>Anions and Nutrients (QCLot: 1778439)</b>									
Bromide	24959-67-9	E235.Br-L	0.05	mg/L	0.5 mg/L	104	85.0	115	---
<b>Anions and Nutrients (QCLot: 1778440)</b>									
Nitrate (as N)	14797-55-8	E235.NO3-L	0.005	mg/L	2.5 mg/L	97.9	90.0	110	---
<b>Anions and Nutrients (QCLot: 1778441)</b>									
Nitrite (as N)	14797-65-0	E235.NO2-L	0.001	mg/L	0.5 mg/L	97.7	90.0	110	---
<b>Anions and Nutrients (QCLot: 1778442)</b>									
Sulfate (as SO <sub>4</sub> )	14808-79-8	E235.SO4	0.3	mg/L	100 mg/L	99.1	90.0	110	---
<b>Cyanides (QCLot: 1778955)</b>									
Cyanide, strong acid dissociable (Total)	---	E333	0.002	mg/L	0.25 mg/L	97.1	80.0	120	---



Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
<b>Organic / Inorganic Carbon (QCLot: 1777537)</b>									
Carbon, dissolved organic [DOC]	---	E358-L	0.5	mg/L	8.57 mg/L	99.6	80.0	120	---
<b>Organic / Inorganic Carbon (QCLot: 1777538)</b>									
Carbon, total organic [TOC]	---	E355-L	0.5	mg/L	8.57 mg/L	99.8	80.0	120	---
<b>Total Sulfides (QCLot: 1778131)</b>									
Sulfide, total (as H2S)	7783-06-4	E395-H	---	mg/L	0.085 mg/L	93.8	80.0	120	---
Sulfide, total (as S)	18496-25-8	E395-H	0.01	mg/L	0.08 mg/L	94.4	80.0	120	---
<b>Total Metals (QCLot: 1777978)</b>									
Aluminum, total	7429-90-5	E420	0.003	mg/L	2 mg/L	106	80.0	120	---
Antimony, total	7440-36-0	E420	0.0001	mg/L	1 mg/L	101	80.0	120	---
Arsenic, total	7440-38-2	E420	0.0001	mg/L	1 mg/L	106	80.0	120	---
Barium, total	7440-39-3	E420	0.0001	mg/L	0.25 mg/L	101	80.0	120	---
Beryllium, total	7440-41-7	E420	0.00002	mg/L	0.1 mg/L	104	80.0	120	---
Bismuth, total	7440-69-9	E420	0.00005	mg/L	1 mg/L	105	80.0	120	---
Boron, total	7440-42-8	E420	0.01	mg/L	1 mg/L	101	80.0	120	---
Cadmium, total	7440-43-9	E420	0.000005	mg/L	0.1 mg/L	102	80.0	120	---
Calcium, total	7440-70-2	E420	0.05	mg/L	50 mg/L	102	80.0	120	---
Cesium, total	7440-46-2	E420	0.00001	mg/L	0.05 mg/L	104	80.0	120	---
Chromium, total	7440-47-3	E420	0.0005	mg/L	0.25 mg/L	105	80.0	120	---
Cobalt, total	7440-48-4	E420	0.0001	mg/L	0.25 mg/L	103	80.0	120	---
Copper, total	7440-50-8	E420	0.0005	mg/L	0.25 mg/L	103	80.0	120	---
Iron, total	7439-89-6	E420	0.01	mg/L	1 mg/L	101	80.0	120	---
Lead, total	7439-92-1	E420	0.00005	mg/L	0.5 mg/L	107	80.0	120	---
Lithium, total	7439-93-2	E420	0.001	mg/L	0.25 mg/L	104	80.0	120	---
Magnesium, total	7439-95-4	E420	0.005	mg/L	50 mg/L	103	80.0	120	---
Manganese, total	7439-96-5	E420	0.0001	mg/L	0.25 mg/L	103	80.0	120	---
Molybdenum, total	7439-98-7	E420	0.00005	mg/L	0.25 mg/L	104	80.0	120	---
Nickel, total	7440-02-0	E420	0.0005	mg/L	0.5 mg/L	103	80.0	120	---
Phosphorus, total	7723-14-0	E420	0.05	mg/L	10 mg/L	116	80.0	120	---
Potassium, total	7440-09-7	E420	0.05	mg/L	50 mg/L	104	80.0	120	---
Rubidium, total	7440-17-7	E420	0.0002	mg/L	0.1 mg/L	104	80.0	120	---
Selenium, total	7782-49-2	E420	0.00005	mg/L	1 mg/L	105	80.0	120	---
Silicon, total	7440-21-3	E420	0.1	mg/L	10 mg/L	108	80.0	120	---
Silver, total	7440-22-4	E420	0.00001	mg/L	0.1 mg/L	100	80.0	120	---
Sodium, total	7440-23-5	E420	0.05	mg/L	50 mg/L	104	80.0	120	---



Sub-Matrix: **Water**

Laboratory Control Sample (LCS) Report

Analyte	CAS Number	Method	LOR	Unit	Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		Qualifier
					Target Concentration	LCS	Low	High	
<b>Total Metals (QCLot: 1777978) - continued</b>									
Strontium, total	7440-24-6	E420	0.0002	mg/L	0.25 mg/L	106	80.0	120	----
Sulfur, total	7704-34-9	E420	0.5	mg/L	50 mg/L	106	80.0	120	----
Tellurium, total	13494-80-9	E420	0.0002	mg/L	0.1 mg/L	107	80.0	120	----
Thallium, total	7440-28-0	E420	0.00001	mg/L	1 mg/L	106	80.0	120	----
Thorium, total	7440-29-1	E420	0.0001	mg/L	0.1 mg/L	108	80.0	120	----
Tin, total	7440-31-5	E420	0.0001	mg/L	0.5 mg/L	102	80.0	120	----
Titanium, total	7440-32-6	E420	0.0003	mg/L	0.25 mg/L	102	80.0	120	----
Tungsten, total	7440-33-7	E420	0.0001	mg/L	0.1 mg/L	106	80.0	120	----
Uranium, total	7440-61-1	E420	0.00001	mg/L	0.005 mg/L	112	80.0	120	----
Vanadium, total	7440-62-2	E420	0.0005	mg/L	0.5 mg/L	105	80.0	120	----
Zinc, total	7440-66-6	E420	0.003	mg/L	0.5 mg/L	104	80.0	120	----
Zirconium, total	7440-67-7	E420	0.0002	mg/L	0.1 mg/L	104	80.0	120	----
<b>Total Metals (QCLot: 1778474)</b>									
Mercury, total	7439-97-6	E508	0.000005	mg/L	0 mg/L	94.8	80.0	120	----
<b>Dissolved Metals (QCLot: 1778107)</b>									
Aluminum, dissolved	7429-90-5	E421	0.001	mg/L	2 mg/L	99.5	80.0	120	----
Antimony, dissolved	7440-36-0	E421	0.0001	mg/L	1 mg/L	96.0	80.0	120	----
Arsenic, dissolved	7440-38-2	E421	0.0001	mg/L	1 mg/L	106	80.0	120	----
Barium, dissolved	7440-39-3	E421	0.0001	mg/L	0.25 mg/L	101	80.0	120	----
Beryllium, dissolved	7440-41-7	E421	0.00002	mg/L	0.1 mg/L	96.5	80.0	120	----
Bismuth, dissolved	7440-69-9	E421	0.00005	mg/L	1 mg/L	99.8	80.0	120	----
Boron, dissolved	7440-42-8	E421	0.01	mg/L	1 mg/L	93.3	80.0	120	----
Cadmium, dissolved	7440-43-9	E421	0.000005	mg/L	0.1 mg/L	104	80.0	120	----
Calcium, dissolved	7440-70-2	E421	0.05	mg/L	50 mg/L	96.6	80.0	120	----
Cesium, dissolved	7440-46-2	E421	0.00001	mg/L	0.05 mg/L	94.0	80.0	120	----
Chromium, dissolved	7440-47-3	E421	0.0005	mg/L	0.25 mg/L	101	80.0	120	----
Cobalt, dissolved	7440-48-4	E421	0.0001	mg/L	0.25 mg/L	98.7	80.0	120	----
Copper, dissolved	7440-50-8	E421	0.0002	mg/L	0.25 mg/L	99.0	80.0	120	----
Iron, dissolved	7439-89-6	E421	0.01	mg/L	1 mg/L	101	80.0	120	----
Lead, dissolved	7439-92-1	E421	0.00005	mg/L	0.5 mg/L	103	80.0	120	----
Lithium, dissolved	7439-93-2	E421	0.001	mg/L	0.25 mg/L	95.4	80.0	120	----
Magnesium, dissolved	7439-95-4	E421	0.005	mg/L	50 mg/L	99.8	80.0	120	----
Manganese, dissolved	7439-96-5	E421	0.0001	mg/L	0.25 mg/L	100	80.0	120	----
Molybdenum, dissolved	7439-98-7	E421	0.00005	mg/L	0.25 mg/L	95.0	80.0	120	----
Nickel, dissolved	7440-02-0	E421	0.0005	mg/L	0.5 mg/L	97.9	80.0	120	----



Sub-Matrix: **Water**

					Laboratory Control Sample (LCS) Report				
					Spike	Recovery (%)	Recovery Limits (%)		
Analyte	CAS Number	Method	LOR	Unit	Target Concentration	LCS	Low	High	Qualifier
<b>Dissolved Metals (QCLot: 1778107) - continued</b>									
Phosphorus, dissolved	7723-14-0	E421	0.05	mg/L	10 mg/L	104	80.0	120	----
Potassium, dissolved	7440-09-7	E421	0.05	mg/L	50 mg/L	99.9	80.0	120	----
Rubidium, dissolved	7440-17-7	E421	0.0002	mg/L	0.1 mg/L	103	80.0	120	----
Selenium, dissolved	7782-49-2	E421	0.00005	mg/L	1 mg/L	102	80.0	120	----
Silicon, dissolved	7440-21-3	E421	0.05	mg/L	10 mg/L	107	80.0	120	----
Silver, dissolved	7440-22-4	E421	0.00001	mg/L	0.1 mg/L	88.2	80.0	120	----
Sodium, dissolved	7440-23-5	E421	0.05	mg/L	50 mg/L	104	80.0	120	----
Strontium, dissolved	7440-24-6	E421	0.0002	mg/L	0.25 mg/L	96.4	80.0	120	----
Sulfur, dissolved	7704-34-9	E421	0.5	mg/L	50 mg/L	95.6	80.0	120	----
Tellurium, dissolved	13494-80-9	E421	0.0002	mg/L	0.1 mg/L	94.9	80.0	120	----
Thallium, dissolved	7440-28-0	E421	0.00001	mg/L	1 mg/L	99.1	80.0	120	----
Thorium, dissolved	7440-29-1	E421	0.0001	mg/L	0.1 mg/L	100	80.0	120	----
Tin, dissolved	7440-31-5	E421	0.0001	mg/L	0.5 mg/L	96.4	80.0	120	----
Titanium, dissolved	7440-32-6	E421	0.0003	mg/L	0.25 mg/L	99.7	80.0	120	----
Tungsten, dissolved	7440-33-7	E421	0.0001	mg/L	0.1 mg/L	102	80.0	120	----
Uranium, dissolved	7440-61-1	E421	0.00001	mg/L	0.005 mg/L	97.3	80.0	120	----
Vanadium, dissolved	7440-62-2	E421	0.0005	mg/L	0.5 mg/L	103	80.0	120	----
Zinc, dissolved	7440-66-6	E421	0.001	mg/L	0.5 mg/L	102	80.0	120	----
Zirconium, dissolved	7440-67-7	E421	0.0002	mg/L	0.1 mg/L	90.7	80.0	120	----
Mercury, dissolved	7439-97-6	E509	0.000005	mg/L	0 mg/L	93.9	80.0	120	----



### Matrix Spike (MS) Report

A Matrix Spike (MS) is a randomly selected intra-laboratory replicate sample that has been fortified (spiked) with test analytes at known concentration, and processed in an identical manner to test samples. Matrix Spikes provide information regarding analyte recovery and potential matrix effects. MS DQO exceedances due to sample matrix may sometimes be unavoidable; in such cases, test results for the associated sample (or similar samples) may be subject to bias. ND – Recovery not determined, background level >= 1x spike level.

Sub-Matrix: **Water**

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
<b>Anions and Nutrients (QCLot: 1778437)</b>										
VA24D1699-001	Anonymous	Fluoride	16984-48-8	E235.F	1.05 mg/L	1 mg/L	105	75.0	125	----
<b>Anions and Nutrients (QCLot: 1778438)</b>										
VA24D1699-001	Anonymous	Chloride	16887-00-6	E235.Cl	106 mg/L	100 mg/L	106	75.0	125	----
<b>Anions and Nutrients (QCLot: 1778439)</b>										
VA24D1699-001	Anonymous	Bromide	24959-67-9	E235.Br-L	0.549 mg/L	0.5 mg/L	110	75.0	125	----
<b>Anions and Nutrients (QCLot: 1778440)</b>										
VA24D1699-001	Anonymous	Nitrate (as N)	14797-55-8	E235.NO3-L	2.58 mg/L	2.5 mg/L	103	75.0	125	----
<b>Anions and Nutrients (QCLot: 1778441)</b>										
VA24D1699-001	Anonymous	Nitrite (as N)	14797-65-0	E235.NO2-L	0.520 mg/L	0.5 mg/L	104	75.0	125	----
<b>Anions and Nutrients (QCLot: 1778442)</b>										
VA24D1699-001	Anonymous	Sulfate (as SO4)	14808-79-8	E235.SO4	103 mg/L	100 mg/L	103	75.0	125	----
<b>Total Metals (QCLot: 1777978)</b>										
VA24D1615-001	Anonymous	Aluminum, total	7429-90-5	E420	0.179 mg/L	0.2 mg/L	89.4	70.0	130	----
		Antimony, total	7440-36-0	E420	0.0183 mg/L	0.02 mg/L	91.4	70.0	130	----
		Arsenic, total	7440-38-2	E420	0.0194 mg/L	0.02 mg/L	96.8	70.0	130	----
		Barium, total	7440-39-3	E420	0.0192 mg/L	0.02 mg/L	95.8	70.0	130	----
		Beryllium, total	7440-41-7	E420	0.0395 mg/L	0.04 mg/L	98.8	70.0	130	----
		Bismuth, total	7440-69-9	E420	0.00954 mg/L	0.01 mg/L	95.4	70.0	130	----
		Boron, total	7440-42-8	E420	0.097 mg/L	0.1 mg/L	96.8	70.0	130	----
		Cadmium, total	7440-43-9	E420	0.00399 mg/L	0.004 mg/L	99.8	70.0	130	----
		Calcium, total	7440-70-2	E420	3.87 mg/L	4 mg/L	96.7	70.0	130	----
		Cesium, total	7440-46-2	E420	0.00993 mg/L	0.01 mg/L	99.3	70.0	130	----
		Chromium, total	7440-47-3	E420	0.0389 mg/L	0.04 mg/L	97.3	70.0	130	----
		Cobalt, total	7440-48-4	E420	0.0194 mg/L	0.02 mg/L	96.9	70.0	130	----
		Copper, total	7440-50-8	E420	0.0194 mg/L	0.02 mg/L	96.8	70.0	130	----
		Iron, total	7439-89-6	E420	1.95 mg/L	2 mg/L	97.4	70.0	130	----
		Lead, total	7439-92-1	E420	0.0195 mg/L	0.02 mg/L	97.4	70.0	130	----
		Lithium, total	7439-93-2	E420	0.0973 mg/L	0.1 mg/L	97.3	70.0	130	----
		Magnesium, total	7439-95-4	E420	0.954 mg/L	1 mg/L	95.4	70.0	130	----
		Manganese, total	7439-96-5	E420	0.0190 mg/L	0.02 mg/L	95.0	70.0	130	----
		Molybdenum, total	7439-98-7	E420	0.0191 mg/L	0.02 mg/L	95.4	70.0	130	----
		Nickel, total	7440-02-0	E420	0.0385 mg/L	0.04 mg/L	96.2	70.0	130	----
		Phosphorus, total	7723-14-0	E420	9.69 mg/L	10 mg/L	96.9	70.0	130	----
		Potassium, total	7440-09-7	E420	3.83 mg/L	4 mg/L	95.8	70.0	130	----
		Rubidium, total	7440-17-7	E420	0.0191 mg/L	0.02 mg/L	95.6	70.0	130	----
		Selenium, total	7782-49-2	E420	0.0399 mg/L	0.04 mg/L	99.7	70.0	130	----





Sub-Matrix: **Water**

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
<b>Total Metals (QCLot: 1777978) - continued</b>										
VA24D1615-001	Anonymous	Silicon, total	7440-21-3	E420	9.42 mg/L	10 mg/L	94.2	70.0	130	----
		Silver, total	7440-22-4	E420	0.00392 mg/L	0.004 mg/L	98.1	70.0	130	----
		Sodium, total	7440-23-5	E420	ND mg/L	----	ND	70.0	130	----
		Strontium, total	7440-24-6	E420	0.0202 mg/L	0.02 mg/L	101	70.0	130	----
		Sulfur, total	7704-34-9	E420	18.9 mg/L	20 mg/L	94.3	70.0	130	----
		Tellurium, total	13494-80-9	E420	0.0406 mg/L	0.04 mg/L	101	70.0	130	----
		Thallium, total	7440-28-0	E420	0.00380 mg/L	0.004 mg/L	94.9	70.0	130	----
		Thorium, total	7440-29-1	E420	0.0195 mg/L	0.02 mg/L	97.6	70.0	130	----
		Tin, total	7440-31-5	E420	0.0189 mg/L	0.02 mg/L	94.3	70.0	130	----
		Titanium, total	7440-32-6	E420	0.0381 mg/L	0.04 mg/L	95.2	70.0	130	----
		Tungsten, total	7440-33-7	E420	0.0187 mg/L	0.02 mg/L	93.5	70.0	130	----
		Uranium, total	7440-61-1	E420	0.00390 mg/L	0.004 mg/L	97.4	70.0	130	----
		Vanadium, total	7440-62-2	E420	0.0963 mg/L	0.1 mg/L	96.3	70.0	130	----
		Zinc, total	7440-66-6	E420	0.391 mg/L	0.4 mg/L	97.7	70.0	130	----
		Zirconium, total	7440-67-7	E420	0.0380 mg/L	0.04 mg/L	94.9	70.0	130	----
<b>Total Metals (QCLot: 1778474)</b>										
FJ2403504-008	Anonymous	Mercury, total	7439-97-6	E508	0.0000966 mg/L	0 mg/L	96.6	70.0	130	----
<b>Dissolved Metals (QCLot: 1778107)</b>										
FJ2403537-001	Anonymous	Aluminum, dissolved	7429-90-5	E421	0.189 mg/L	0.2 mg/L	94.6	70.0	130	----
		Antimony, dissolved	7440-36-0	E421	0.0190 mg/L	0.02 mg/L	95.1	70.0	130	----
		Arsenic, dissolved	7440-38-2	E421	0.0204 mg/L	0.02 mg/L	102	70.0	130	----
		Barium, dissolved	7440-39-3	E421	ND mg/L	----	ND	70.0	130	----
		Beryllium, dissolved	7440-41-7	E421	0.0380 mg/L	0.04 mg/L	95.1	70.0	130	----
		Bismuth, dissolved	7440-69-9	E421	0.00920 mg/L	0.01 mg/L	92.0	70.0	130	----
		Boron, dissolved	7440-42-8	E421	0.093 mg/L	0.1 mg/L	92.6	70.0	130	----
		Cadmium, dissolved	7440-43-9	E421	0.00399 mg/L	0.004 mg/L	99.8	70.0	130	----
		Calcium, dissolved	7440-70-2	E421	ND mg/L	----	ND	70.0	130	----
		Cesium, dissolved	7440-46-2	E421	0.00963 mg/L	0.01 mg/L	96.3	70.0	130	----
		Chromium, dissolved	7440-47-3	E421	0.0388 mg/L	0.04 mg/L	97.1	70.0	130	----
		Cobalt, dissolved	7440-48-4	E421	0.0193 mg/L	0.02 mg/L	96.6	70.0	130	----
		Copper, dissolved	7440-50-8	E421	0.0191 mg/L	0.02 mg/L	95.5	70.0	130	----
		Iron, dissolved	7439-89-6	E421	1.91 mg/L	2 mg/L	95.3	70.0	130	----
		Lead, dissolved	7439-92-1	E421	0.0190 mg/L	0.02 mg/L	95.2	70.0	130	----
		Lithium, dissolved	7439-93-2	E421	0.0947 mg/L	0.1 mg/L	94.7	70.0	130	----
		Magnesium, dissolved	7439-95-4	E421	ND mg/L	----	ND	70.0	130	----
		Manganese, dissolved	7439-96-5	E421	0.0192 mg/L	0.02 mg/L	96.0	70.0	130	----
		Molybdenum, dissolved	7439-98-7	E421	0.0192 mg/L	0.02 mg/L	96.1	70.0	130	----
		Nickel, dissolved	7440-02-0	E421	0.0379 mg/L	0.04 mg/L	94.9	70.0	130	----
		Phosphorus, dissolved	7723-14-0	E421	9.80 mg/L	10 mg/L	98.0	70.0	130	----
		Potassium, dissolved	7440-09-7	E421	3.90 mg/L	4 mg/L	97.4	70.0	130	----
		Rubidium, dissolved	7440-17-7	E421	0.0198 mg/L	0.02 mg/L	98.8	70.0	130	----
		Selenium, dissolved	7782-49-2	E421	0.0399 mg/L	0.04 mg/L	99.7	70.0	130	----
		Silicon, dissolved	7440-21-3	E421	9.02 mg/L	10 mg/L	90.2	70.0	130	----



Sub-Matrix: **Water**

					Matrix Spike (MS) Report					
					Spike		Recovery (%)	Recovery Limits (%)		
Laboratory sample ID	Client sample ID	Analyte	CAS Number	Method	Concentration	Target	MS	Low	High	Qualifier
<b>Dissolved Metals (QCLot: 1778107) - continued</b>										
FJ2403537-001	Anonymous	Silver, dissolved	7440-22-4	E421	0.00385 mg/L	0.004 mg/L	96.3	70.0	130	----
		Sodium, dissolved	7440-23-5	E421	2.04 mg/L	2 mg/L	102	70.0	130	----
		Strontium, dissolved	7440-24-6	E421	ND mg/L	----	ND	70.0	130	----
		Sulfur, dissolved	7704-34-9	E421	19.4 mg/L	20 mg/L	97.1	70.0	130	----
		Tellurium, dissolved	13494-80-9	E421	0.0394 mg/L	0.04 mg/L	98.4	70.0	130	----
		Thallium, dissolved	7440-28-0	E421	0.00370 mg/L	0.004 mg/L	92.4	70.0	130	----
		Thorium, dissolved	7440-29-1	E421	0.0198 mg/L	0.02 mg/L	99.1	70.0	130	----
		Tin, dissolved	7440-31-5	E421	0.0192 mg/L	0.02 mg/L	96.3	70.0	130	----
		Titanium, dissolved	7440-32-6	E421	0.0395 mg/L	0.04 mg/L	98.8	70.0	130	----
		Tungsten, dissolved	7440-33-7	E421	0.0190 mg/L	0.02 mg/L	95.3	70.0	130	----
		Uranium, dissolved	7440-61-1	E421	0.00365 mg/L	0.004 mg/L	91.2	70.0	130	----
		Vanadium, dissolved	7440-62-2	E421	0.0984 mg/L	0.1 mg/L	98.4	70.0	130	----
		Zinc, dissolved	7440-66-6	E421	0.392 mg/L	0.4 mg/L	98.0	70.0	130	----
		Zirconium, dissolved	7440-67-7	E421	0.0380 mg/L	0.04 mg/L	95.1	70.0	130	----
<b>Dissolved Metals (QCLot: 1778479)</b>										
FJ2403524-001	Anonymous	Mercury, dissolved	7439-97-6	E509	0.0000946 mg/L	0 mg/L	94.6	70.0	130	----



# FJAE Shipping & Receiving

Call Out Expedite

Priority

# of Coolers Air

# of Carboys Ground

## Chain of Custody (COC) / Analytical Request Form

Canada Toll Free: 1 800 668 9878

COC Number: 20 - 964972

Page

Environmental Division  
Fort St. John  
Work Order Reference  
**FJ2403536**



Telephone : + 1 250 261 5517

<b>Report To</b> Company: <i>Tetra Tech Canada Inc</i> Contact: Phone: Company address below will appear on the final report		<b>Reports / Recipients</b> Select Report Format: <input type="checkbox"/> PDF <input type="checkbox"/> EXCEL <input type="checkbox"/> EDD (DIGITAL) Merge QC/QCI Reports with COA <input type="checkbox"/> YES <input type="checkbox"/> NO <input type="checkbox"/> N/A <input type="checkbox"/> Compare Results to Criteria on Report - provide details below if box checked Select Distribution: <input type="checkbox"/> EMAIL <input type="checkbox"/> MAIL <input type="checkbox"/> FAX Email 1 or Fax Email 2 Email 3			<b>Turnaround Time (TAT) Requested</b> <input type="checkbox"/> Routine [R] if received by 3pm M-F - no surcharges apply <input type="checkbox"/> 4 day [P4] if received by 3pm M-F - 20% rush surcharge minimum <input type="checkbox"/> 3 day [P3] if received by 3pm M-F - 25% rush surcharge minimum <input type="checkbox"/> 2 day [P2] if received by 3pm M-F - 50% rush surcharge minimum <input type="checkbox"/> 1 day [E] if received by 3pm M-F - 100% rush surcharge minimum <input type="checkbox"/> Same day [E2] if received by 10am M-F - 200% rush surcharge. Addtl may apply for rush requests on weekends, statutory holidays and non-routine <b>Date and Time Required for all E&amp;P TATs:</b>		
<b>Invoice To</b> Same as Report To <input type="checkbox"/> YES <input type="checkbox"/> NO Copy of Invoice with Report <input type="checkbox"/> YES <input type="checkbox"/> NO Company: <i>Tetra Tech Canada Inc</i> Contact:		<b>Invoice Recipients</b> Select Invoice Distribution: <input type="checkbox"/> EMAIL <input type="checkbox"/> MAIL <input type="checkbox"/> FAX Email 1 or Fax Email 2			<b>Analysis Re</b> For all tests with rush TATs requested, please c		
<b>Project Information</b> ALS Account # / Quote #: Job #: <i>VA24-EBAE100-013</i> PO / AFE: LSD:		<b>Oil and Gas Required Fields (client use)</b> AFE/Cost Center: Major/Minor Code: Requisitioner: Location:			<b>NUMBER OF CONTAINERS</b> Indicate Filtered (F), Preserved (P) or Filtered and Preserved (F/P) below		
<b>ALS Lab Work Order # (ALS use only):</b>		<b>ALS Contact:</b>	<b>Sampler:</b>		<b>SAMPLES ON HOLD</b>		
<b>ALS Sample # (ALS use only)</b>	<b>Sample Identification and/or Coordinates (This description will appear on the report)</b>	<b>Date (dd-mmm-yy)</b>	<b>Time (hh:mm)</b>	<b>Sample Type</b>	<b>EXTENDED STORAGE REQUIRE</b>		
	<i>Cyanides</i>	<i>20-11-2024</i>	<i>11:30</i>		<i>P</i>		
	<i>General / TSS / TDS Routine</i>	<i>20-11-2024</i>	<i>11:35</i>			<i>F</i>	
	<i>Metals + Mercury</i>	<i>20-11-2024</i>	<i>11:40</i>			<i>F/P</i>	
	<i>Methane, Ethane, Ethene</i>	<i>20-11-2024</i>	<i>11:45</i>			<i>F/P</i>	
	<i>NUT / DOC / DKN / TDN / TDP / DNH3</i>	<i>20-11-2024</i>	<i>11:50</i>			<i>F/P</i>	
	<i>NUT / TOC / COD / TSS / TN / TP / NH3 / PHEN</i>	<i>20-11-2024</i>	<i>11:55</i>			<i>F/P</i>	
	<i>Sulfide - Total</i>	<i>20-11-2024</i>	<i>12:00</i>			<i>P</i>	
<b>Drinking Water (DW) Samples<sup>1</sup> (client use)</b>		<b>Notes / Specify Limits for result evaluation by selecting from drop-down below (Excel COC only)</b>			<b>SAMPLE RECEIPT DETAILS (ALS use only)</b>		
Are samples taken from a Regulated DW System? <input type="checkbox"/> YES <input type="checkbox"/> NO					Cooling Method: <input type="checkbox"/> NONE <input type="checkbox"/> ICE <input type="checkbox"/> ICE PACKS <input type="checkbox"/> FROZEN <input type="checkbox"/> COOLING INITIATED		
Are samples for human consumption/ use? <input type="checkbox"/> YES <input type="checkbox"/> NO					Submission Comments identified on Sample Receipt Notification: <input type="checkbox"/> YES <input type="checkbox"/> NO		
					Cooler Custody Seals Intact: <input type="checkbox"/> YES <input type="checkbox"/> N/A Sample Custody Seals Intact: <input type="checkbox"/> YES <input type="checkbox"/> N/A		
					INITIAL COOLER TEMPERATURES °C: <i>12.5</i> FINAL COOLER TEMPERATURES °C:		
<b>SHIPMENT RELEASE (client use)</b>		<b>INITIAL SHIPMENT RECEPTION (ALS use only)</b>			<b>FINAL SHIPMENT RECEPTION (ALS use only)</b>		
Released by: <i>LEROY WELFORD</i>	Date: <i>20/11/2024</i>	Time: <i>12:47</i>	Received by: <i>[Redacted]</i>	Date: <i>NOV 20/24</i>	Time: <i>12:45</i>	Received by: <i>[Redacted]</i>	Date: <i>[Redacted]</i>

REFER TO BACK PAGE FOR ALS LOCATIONS AND SAMPLING INFORMATION

WHITE - LABORATORY COPY YELLOW - CLIENT COPY

Failure to complete all portions of this form may delay analysis. Please fill in this form LEGIBLY. By the use of this form the user acknowledges and agrees with the Terms and Conditions as specified on the back page of the white - report copy.

1. If any water samples are taken from a Regulated Drinking Water (DW) System, please submit using an Authorized DW COC form.

ALS 2023 FORM



# FJAE Shipping & Receiving

Call Out  Expedite

Priority

# of Coolers  Air

# of Carboys  Ground

## Chain of Custody (COC) / Analytical Request Form

Canada Toll Free: 1 800 668 9878

COC Number: 20 - 964972

Page

Environmental Division  
Fort St. John  
Work Order Reference  
**FJ2403536**



Telephone : + 1 250 261 5517

<b>Report To</b> Company: <i>Tetra Tech Canada Inc</i> Contact: Phone: Company address below will appear on the final report		<b>Reports / Recipients</b> Select Report Format: <input type="checkbox"/> PDF <input type="checkbox"/> EXCEL <input type="checkbox"/> EDD (DIGITAL) Merge QC/QCI Reports with COA <input type="checkbox"/> YES <input type="checkbox"/> NO <input type="checkbox"/> N/A <input type="checkbox"/> Compare Results to Criteria on Report - provide details below if box checked Select Distribution: <input type="checkbox"/> EMAIL <input type="checkbox"/> MAIL <input type="checkbox"/> FAX Email 1 or Fax Email 2 Email 3		<b>Turnaround Time (TAT) Requested</b> <input type="checkbox"/> Routine (R) if received by 3pm M-F - no surcharges apply <input type="checkbox"/> 4 day (P4) if received by 3pm M-F - 20% rush surcharge minimum <input type="checkbox"/> 3 day (P3) if received by 3pm M-F - 25% rush surcharge minimum <input type="checkbox"/> 2 day (P2) if received by 3pm M-F - 50% rush surcharge minimum <input type="checkbox"/> 1 day (E) if received by 3pm M-F - 100% rush surcharge minimum <input type="checkbox"/> Same day (E2) if received by 10am M-S - 200% rush surcharge. Additional charges may apply to rush requests on weekends, statutory holidays and non-routine requests. Date and Time Required for all E&P TATs: _____	
<b>Invoice To</b> Same as Report To <input type="checkbox"/> YES <input type="checkbox"/> NO Copy of Invoice with Report <input type="checkbox"/> YES <input type="checkbox"/> NO		<b>Invoice Recipients</b> Select Invoice Distribution: <input type="checkbox"/> EMAIL <input type="checkbox"/> MAIL <input type="checkbox"/> FAX Email 1 or Fax Email 2		<b>Analysis Re</b> For all tests with rush TATs requested, please c	
Company: <i>Tetra Tech Canada Inc</i> Contact:		Project Information		Oil and Gas Required Fields (client use)	
ALS Account # / Quote #		AFE/Cost Center:		PO#	
Job #: <i>VA24-EBAE100-013</i>		Major/Minor Code:		Routing Code:	
PO / AFE:		Requisitioner:		Location:	
LSD:		ALS Contact:		Sampler:	
ALS Lab Work Order # (ALS use only):					
ALS Sample # (ALS use only)	Sample Identification and/or Coordinates (This description will appear on the report)	Date (dd-mmm-yy)	Time (hh:mm)	Sample Type	
	<i>Cyanides</i>	<i>20-11-2024</i>	<i>11:30</i>		<i>P</i>
	<i>General / TSS / TDS Routine</i>	<i>20-11-2024</i>	<i>11:35</i>		<i>F</i>
	<i>Metals + Mercury</i>	<i>20-11-2024</i>	<i>11:40</i>		<i>F/P</i>
	<i>Methane, Ethane, Ethene</i>	<i>20-11-2024</i>	<i>11:45</i>		<i>F/P</i>
	<i>NUT / DOC / DKN / TDN / TDP / DNH3</i>	<i>20-11-2024</i>	<i>11:50</i>		<i>P</i>
	<i>NUT / TOC / COD / TKN / TN / TP / NH3 / PHEN</i>	<i>20-11-2024</i>	<i>11:55</i>		
	<i>Sulfide - Total</i>	<i>20-11-2024</i>	<i>12:00</i>		
<b>Drinking Water (DW) Samples<sup>1</sup> (client use)</b>		Notes / Specify Limits for result evaluation by selecting from drop-down below (Excel COC only)		<b>SAMPLE RECEIPT DETAILS (ALS use only)</b>	
Are samples taken from a Regulated DW System? <input type="checkbox"/> YES <input type="checkbox"/> NO				Cooling Method: <input type="checkbox"/> NONE <input type="checkbox"/> ICE <input type="checkbox"/> ICE PACKS <input type="checkbox"/> FROZEN <input type="checkbox"/> COOLING INITIATED	
Are samples for human consumption/ use? <input type="checkbox"/> YES <input type="checkbox"/> NO				Submission Comments identified on Sample Receipt Notification: <input type="checkbox"/> YES <input type="checkbox"/> NO	
				Cooler Custody Seals Intact: <input type="checkbox"/> YES <input checked="" type="checkbox"/> N/A Sample Custody Seals Intact: <input type="checkbox"/> YES <input checked="" type="checkbox"/> N/A	
				INITIAL COOLER TEMPERATURES °C: <i>12.5</i> FINAL COOLER TEMPERATURES °C: <i>5</i>	
<b>SHIPMENT RELEASE (client use)</b>		<b>INITIAL SHIPMENT RECEPTION (ALS use only)</b>		<b>FINAL SHIPMENT</b>	
Released by: <i>LEROY LILFORD</i>	Date: <i>20/11/2024</i>	Time: <i>12:47</i>	Received by: <i>[Redacted]</i>	Date: <i>NOV 20/24</i>	Time: <i>12:45</i>
				Received by: <i>[Signature]</i>	Date: <i>Rcvd 21Nov2024</i>
					Time: <i>10am</i>

REFER TO BACK PAGE FOR ALS LOCATIONS AND SAMPLING INFORMATION  
WHITE - LABORATORY COPY YELLOW - CLIENT COPY  
Failure to complete all portions of this form may delay analysis. Please fill in this form LEGIBLY. By the use of this form the user acknowledges and agrees with the Terms and Conditions as specified on the back page of the white - report copy.  
1. If any water samples are taken from a Regulated Drinking Water (DW) System, please submit using an Authorized DW COC form.

## APPENDIX C

### TETRA TECH'S LIMITATIONS ON THE USE OF THIS DOCUMENT

# LIMITATIONS ON USE OF THIS DOCUMENT

## GEOENVIRONMENTAL

### 1.1 USE OF DOCUMENT AND OWNERSHIP

This document pertains to a specific site, a specific development, and a specific scope of work. The document may include plans, drawings, profiles and other supporting documents that collectively constitute the document (the "Professional Document").

The Professional Document is intended for the sole use of TETRA TECH's Client (the "Client") as specifically identified in the TETRA TECH Services Agreement or other Contractual Agreement entered into with the Client (either of which is termed the "Contract" herein). TETRA TECH does not accept any responsibility for the accuracy of any of the data, analyses, recommendations or other contents of the Professional Document when it is used or relied upon by any party other than the Client, unless authorized in writing by TETRA TECH.

Any unauthorized use of the Professional Document is at the sole risk of the user. TETRA TECH accepts no responsibility whatsoever for any loss or damage where such loss or damage is alleged to be or, is in fact, caused by the unauthorized use of the Professional Document.

Where TETRA TECH has expressly authorized the use of the Professional Document by a third party (an "Authorized Party"), consideration for such authorization is the Authorized Party's acceptance of these Limitations on Use of this Document as well as any limitations on liability contained in the Contract with the Client (all of which is collectively termed the "Limitations on Liability"). The Authorized Party should carefully review both these Limitations on Use of this Document and the Contract prior to making any use of the Professional Document. Any use made of the Professional Document by an Authorized Party constitutes the Authorized Party's express acceptance of, and agreement to, the Limitations on Liability.

The Professional Document and any other form or type of data or documents generated by TETRA TECH during the performance of the work are TETRA TECH's professional work product and shall remain the copyright property of TETRA TECH.

The Professional Document is subject to copyright and shall not be reproduced either wholly or in part without the prior, written permission of TETRA TECH. Additional copies of the Document, if required, may be obtained upon request.

### 1.2 ALTERNATIVE DOCUMENT FORMAT

Where TETRA TECH submits electronic file and/or hard copy versions of the Professional Document or any drawings or other project-related documents and deliverables (collectively termed TETRA TECH's "Instruments of Professional Service"), only the signed and/or sealed versions shall be considered final. The original signed and/or sealed electronic file and/or hard copy version archived by TETRA TECH shall be deemed to be the original. TETRA TECH will archive a protected digital copy of the original signed and/or sealed version for a period of 10 years.

Both electronic file and/or hard copy versions of TETRA TECH's Instruments of Professional Service shall not, under any circumstances, be altered by any party except TETRA TECH. TETRA TECH's Instruments of Professional Service will be used only and exactly as submitted by TETRA TECH.

Electronic files submitted by TETRA TECH have been prepared and submitted using specific software and hardware systems. TETRA TECH makes no representation about the compatibility of these files with the Client's current or future software and hardware systems.

### 1.3 STANDARD OF CARE

Services performed by TETRA TECH for the Professional Document have been conducted in accordance with the Contract, in a manner

consistent with the level of skill ordinarily exercised by members of the profession currently practicing under similar conditions in the jurisdiction in which the services are provided. Professional judgment has been applied in developing the conclusions and/or recommendations provided in this Professional Document. No warranty or guarantee, express or implied, is made concerning the test results, comments, recommendations, or any other portion of the Professional Document.

If any error or omission is detected by the Client or an Authorized Party, the error or omission must be immediately brought to the attention of TETRA TECH.

### 1.4 DISCLOSURE OF INFORMATION BY CLIENT

The Client acknowledges that it has fully cooperated with TETRA TECH with respect to the provision of all available information on the past, present, and proposed conditions on the site, including historical information respecting the use of the site. The Client further acknowledges that in order for TETRA TECH to properly provide the services contracted for in the Contract, TETRA TECH has relied upon the Client with respect to both the full disclosure and accuracy of any such information.

### 1.5 INFORMATION PROVIDED TO TETRA TECH BY OTHERS

During the performance of the work and the preparation of this Professional Document, TETRA TECH may have relied on information provided by third parties other than the Client.

While TETRA TECH endeavours to verify the accuracy of such information, TETRA TECH accepts no responsibility for the accuracy or the reliability of such information even where inaccurate or unreliable information impacts any recommendations, design or other deliverables and causes the Client or an Authorized Party loss or damage.

### 1.6 GENERAL LIMITATIONS OF DOCUMENT

This Professional Document is based solely on the conditions presented and the data available to TETRA TECH at the time the data were collected in the field or gathered from available databases.

The Client, and any Authorized Party, acknowledges that the Professional Document is based on limited data and that the conclusions, opinions, and recommendations contained in the Professional Document are the result of the application of professional judgment to such limited data.

The Professional Document is not applicable to any other sites, nor should it be relied upon for types of development other than those to which it refers. Any variation from the site conditions present, or variation in assumed conditions which might form the basis of design or recommendations as outlined in this report, at or on the development proposed as of the date of the Professional Document requires a supplementary exploration, investigation, and assessment.

TETRA TECH is neither qualified to, nor is it making, any recommendations with respect to the purchase, sale, investment or development of the property, the decisions on which are the sole responsibility of the Client.

### 1.7 NOTIFICATION OF AUTHORITIES

In certain instances, the discovery of hazardous substances or conditions and materials may require that regulatory agencies and other persons be informed and the client agrees that notification to such bodies or persons as required may be done by TETRA TECH in its reasonably exercised discretion.